
#### **MECH FLOW SUPPLIES**


































#### JINAN MEIDE CASTING CO., LTD.


Address: Meide Science & Technology Park, Industrial Park Pingyin, Jinan, China 250400 Phone: (86)531 87879384 87885036 87885067

Email: info@meide-casting.com

Fax: (86)531 87879387 Http://www.meide-casting.com





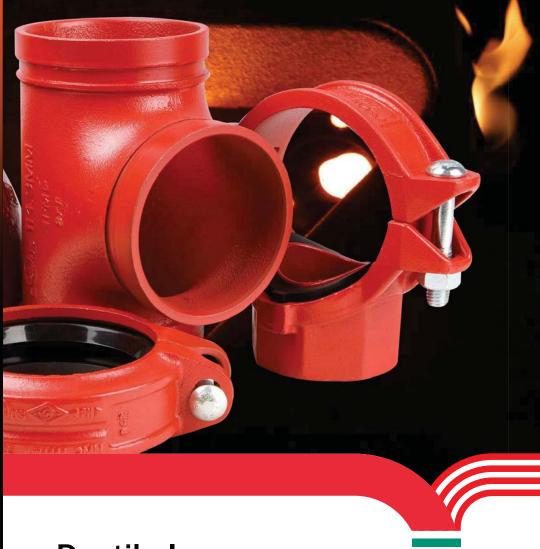

# **Ductile Iron Grooved Fittings** and Couplings

To Provide Safe & Reliable Products and Smart & Complete Solutions for Clients in Fluid Conveying Industry Across the Globe.





# More than 50 years of Foundry Experience

# Company **Profile**

Jinan Meide Casting Co. Ltd. was established in 1961. In the past decades, Jinan Meide has seized each opportunity to consolidate its strength, and has finally developed into what it is today, a large-scale enterprise group with advanced technology, equipment and strong comprehensive strength, known for its complete range of products, large producing capacity, high quality and strong R&D strength. The company owns altogether one main factory, three branch factories, two independent accounting steel pipe companys, and a science & technology park.

The company is the well-known manufacturer in the fitting industry with the most complete range of products, supplying malleable iron fittings, grooved fittings, grooved couplings, valves, cast iron fittings, ductile iron fittings, steel pipe nipples and couplings, stainless steel nipples, brass pipe nipples, cast bronze fittings, steel pipes, pipe hangers and supports, electric fittings, etc.

Over 50 years, Jinan Meide has been a trusted name in piping solutions by offering high-quality products, service and support to the PVF industry continuously. We provide expertise and product solutions for a wide range of applications, plumbing, mechanical, industrial, air-conditioning and refrigeration, mining, oil, gas, fire protection, equipment and power system. Many of the company's application technology are advanced in the world, with more than 20 patents registered each year, and the company has presided over and participated in the drafting of many important national standards of


We organize the whole production process in accordance with ISO 9001 and ISO 14001. It has also the most complete certificates in the PVF industry, including UL/FM/NSF of US, CRN/cUL of Canada, DVGW/TUV/CE/VdS of Germany, BSI/LPCB of UK, SII of Israel, JIS of Japan, ABNT of Brazil, GOST-R of Russia, CNBOP of Poland, KS of South Korea, TSE of Turkey, PSB of Singapore, SIRIM of Malaysia, SABS of South Africa etc. The products are well distributed in more than 130 countries and regions.

As an industry leader and key high-tech enterprise of the national torch plan, the company attaches great importance to environmental protection, energysaving and emission-reduction. US-EEC recognizes MECH brand malleable iron pipe fittings as "the product to promote for the technology exchange of environmental protection". Protecting the environment is the duty of the company.

Customer satisfaction has always been the company's top objective, and we constantly stick to the principle: to provide customers with a value-added solution rather than simply delivering products.





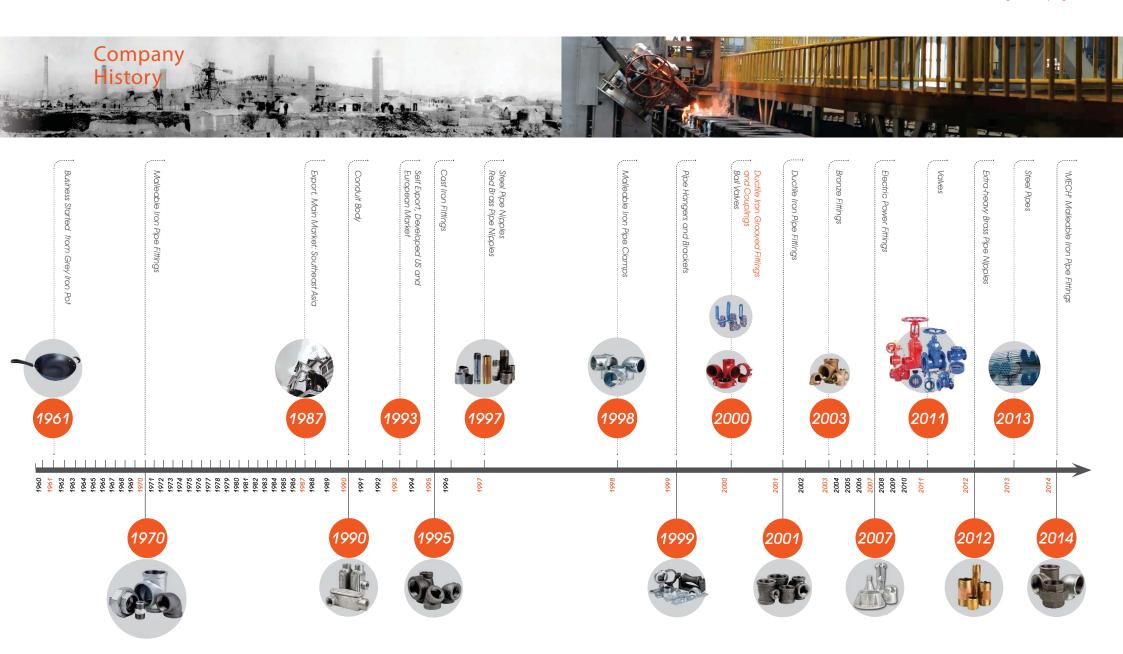




# State of the Art Equipment

High precision equipment is quality assurance.

Jinan Meide's 8 factories are all equipped with the most advanced facilities and equipment in the industry. The main production facilities include Sinto automatic molding line, Tokyu automatic molding line, Chinese 416 automatic vertical molding line, automatic molding sand mixers, cupola furnaces, electric furnaces, water-cooled longevous cupola furnaces, CNC vertical machining centers, CNC machines, NC vertical lathes, radial drills, Jinan Meide proprietary automatic machines, hot-dipped galvanization line, automatic box sealing line, stereoscopic warehouse and so on.

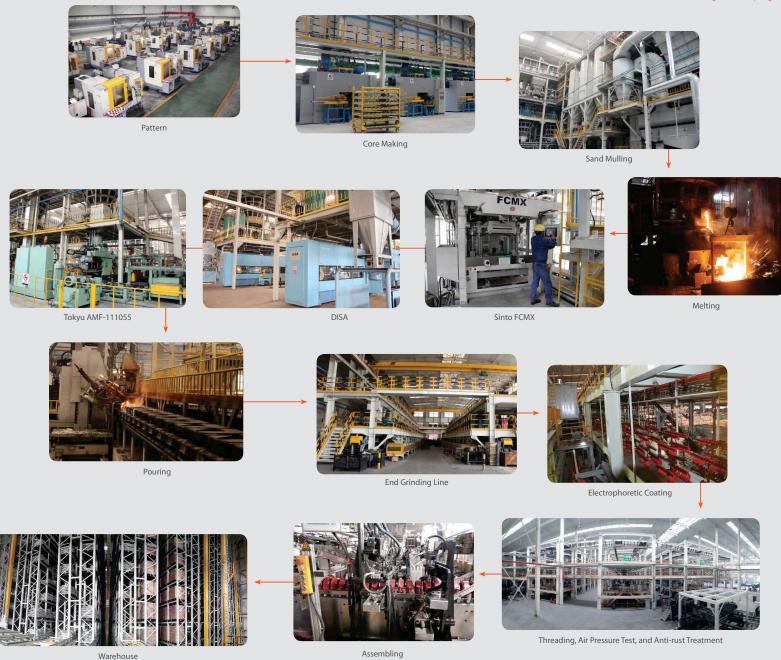

# Reliable Quality **Assurance**

Jinan Meide is honored as the National enterprise technical center and is capable and qualified to conduct full series of tests and inspections including chemical checking, etc.

Inspection facilities include: spectrometer, carbon sulfur analyzer, metallurgical microscope, tensile strength testing equipment, pressure testing equipment, adhesive force testing equipment, CMM, hardness tester, etc.

From incoming inspection to finished product, quality is checked and monitored in the whole process. Each step of the manufacturing process is carefully documented, regularly reviewed for revision control and updating standard. Quality procedures are constantly monitored and updated to assure that only the highest and most consistent quality products are supplied to our valued customers.



3D Printer



3D Scanner



Metallurgical Microscope



Spectrometer







CMM

The Length of The Test Instrument

Roughness Tester





Tensile Strength Testing Equipment



Sand Testing Instrument



## Certificates







政德集团有限公司

B-40-0 BISB: TUNNISMITTING

ISO 14001:2004

HITCHENGERS.

nni na milliottoperalessa, on unbasis ene eta ana titopen, verio senget navana bilega producento producto estas e de tito

3mm

SEXTENSIVE DE LA COLUMNICATION DE LA COLUMNICA

555 No. 100 II FORM

ANAB

\*\*\*\*\* 登邮运报件,用门具和关电缆,进款登标序、研验、均断用项层等供收 每个物理产生力或或取引实现计,生产



























# Ductile Iron Grooved Fittings and Couplings

Material: ASTM A536, GRADE 65-45-12, QT450-10 Threads: ASME B1.20.1, ISO 7-1, GB 7306

Size Available: 1"-24"

Surface Treatment:
P: Painted E: Electroplated
B: Black S: Epoxy G: Hot-dip Galvanized






# 1N


Standard Flexible Coupling











Nominal	Pipe	Working	Max. End	Pipe End		Dimensior	ıs	Bolt Size	
Size mm/in	O.D mm/in	Pressure PSI/MPa	Load kN/Lbs	Separation mm/in	A mm/in	B mm/in	C mm/in	NoSize mm	Certificate
25 1	33.7 1.327	500 3.45	3.0/680	0-1.6 0-0.06	55 2.16	92 3.62	42 1.65	2-3/8×55 2-M10×57	UL FM VdS LPCB
32 1¼	42.4 1.669	500 3.45	4.8/1080	0-1.6 0-0.06	65 2.56	104 4.14	44 1.74	2-3/8×55 2-M10×57	UL FM VdS LPCB
40 1½	48.3 1.900	500 3.45	6.3/1420	0-3.2 0-0.13	70 2.75	110 4.33	44 1.74	2-3/8×55 2-M10×57	UL FM VdS LPCB
50 2	60.3 2.375	500 3.45	9.8/2210	0-3.2 0-0.13	83 3.27	125 4.92	44 1.74	2-3/8×55 2-M10×57	UL FM VdS LPCB
65 2½	73.0 2.875	500 3.45	14.4/3240	0-3.2 0-0.13	96 3.78	143 5.63	45 1.78	2-3/8×55 2-M10×57	UL FM LPCB
65 2½	76.1 3.000	500 3.45	15.7/3520	0-3.2 0-0.13	100 3.94	145 5.71	45 1.78	2-3/8×55 2-M10×57	UL FM VdS LPCB
80 3	88.9 3.500	500 3.45	21.4/4810	0-3.2 0-0.13	115 4.53	160 6.30	45 1.78	2-1/2×70 2-M12×70	UL FM VdS LPCB
100 4	108.0 4.250	500 3.45	31.5/7100	0-3.2 0-0.13	138 5.43	190 7.48	50 1.97	2-1/2×70 2-M12×70	UL FM LPCB
100 4	114.3 4.500	500 3.45	35.4/7960	0-3.2 0-0.13	145 5.71	198 7.80	50 1.97	2-1/2×70 2-M12×70	UL FM VdS LPCB
125 5	133 5.250	300 2.07	28.7/6460	0-3.2 0-0.13	162 6.38	225 8.86	51.0 2.01	2-5/8×80 2-M16×85	UL FM LPCB
125 5	139.7 5.500	500 3.45	52.9/11800	0-3.2 0-0.13	169 6.65	230 9.06	52 2.05	2-5/8×80 2-M16×85	UL FM VdS LPCB
125 5	141.3 5.563	500 3.45	54.1/12100	0-3.2 0-0.13	170 6.69	232 9.13	51 2.01	2-5/8×80 2-M16×85	UL FM LPCB
150	159.0 6.250	300 2.07	41.0/9240	0-3.2 0-0.13	190 7.48	256 10.08	52 2.05	2-5/8×85 2-M16×85	UL FM LPCB
150	165.1 6.500	500 3.45	73.8/16610	0-3.2 0-0.13	196 7.72	260 10.24	52 2.05	2-5/8×85 2-M16×85	UL FM LPCB
150	168.3 6.625	500 3.45	76.7/17260	0-3.2 0-0.13	200	265 10.43	52 2.05	2-5/8×85 2-M16×85	UL FM VdS LPCB
200	216.3 8.516	300 2.07	76.0/17100	0-3.2 0-0.13	254 10.00	320 12.60	59 2.32	2-5/8×85 2-M16×85	UL FM
200	219.1 8.625	450 3.10	116.9/26280	0-3.2 0-0.13	258 10.24	342 13.46	60 2.37	2-3/4×115 2-M20×115	UL FM VdS LPCB
250 10	267.4 10.528	300 2.07	116.2/26140	0-3.2 0-0.13	308.5 12.15	403 15.87	64 2.52	2-3/4×115 2-M20×115	UL FM
250 10	273.0 10.750	300 2.07	121.0/27210	0-3.2 0-0.13	337 13.27	406 16.00	65 2.56	2-7/8×140 2-M22×140	UL FM VdS
300 12	318.5 12.539	300 2.07	164.8/37090	0-3.2 0-0.13	363 14.29	460 18.11	63 2.48	2-7/8×140 2-M22×140	UL FM
300 12	323.9 12.750	300 2.07	170.3/38280	0-3.2 0-0.13	378 14.96	465 18.31	65 2.56	2-7/8×140 2-M22×140	UL FM
350 14	355.6 14.000	300 2.07	205.5/46220	0-3.2 0-0.13	402 15.83	493 19.41	72 2.83	3-7/8×140 3-M22×140	_
350 14	377.0 14.843	225	178.5/40160	0-3.2 0-0.13	428 16.85	520 20.45	72 2.85	3-7/8X140 3-M22X140	_
400 16	406.4 16.000	300 2.07	268.4/60370	0-3.2 0-0.13	458 18.03	547 21.54	72 2.85	3-7/8×140 3-M22×140	
400 16	426.0 16.772	225 1.6	227.9/51270	0-3.2 0-0.13	476 18.74	566 22.28	73 2.87	3-7/8X140 3-M22X140	
450 18	457.2 18.000	300 2.07	262.5/59060	0-0.13 0-3.2 0-0.13	505 19.88	598 23.54	78 3.07	3-7/8×140 3-M22×140	_
500	508.0	300	324.1/72910	0-3.2	550	648	78	4-7/8×140	_
20 600 24	20.000 609.6 24.000	2.07 300 2.07	466.7/104990	0-0.13 0-3.2 0-0.13	21.65 662 26.06	25.51 774 30.47	3.07 78 3.07	4-M22×140 4-1X140	

# **1N**

Standard Reducing Flexible Coupling







Nominal	Pipe	Working	Max. End	Pipe End		imension	s	Bolt Size	
Size mm/in	O.D mm/in	Pressure PSI/MPa	Load kN/Lbs	Separation mm/in	A mm/in	B mm/in	C mm/in	NoSize mm	Certificate
50×40 2×1½	60.3×48.3 2.375×1.900	300 2.07	5.9/1330	0-3.2 0-0.13	86 3.39	125 4.93	44 1.74	2-3/8×55 2-M10×57	UL FM LPCB
65×25 2½×1	73.0×33.7 2.875×1.327	300 2.07	8.7/1950	0-3.2 0-0.13	100 3.94	138 5.44	45 1.78	2-3/8×55 2-M10×57	UL FM
65×50 2½×2	73.0×60.3 2.875×2.375	300 2.07	8.7/1950	0-3.2 0-0.13	100 3.94	138 5.43	45 1.78	2-3/8×55 2-M10×57	UL FM LPCB
65×25 2½×1	76.1×33.7 3.000×1.327	300 2.07	9.4/2120	0-3.2 0-0.13	102 4.02	140 5.51	45 1.78	2-3/8×55 2-M10×57	UL FM
65×40 2½×1½	76.1×48.3 3.000×1.900	300 2.07	9.4/2120	0-3.2 0-0.13	102 4.02	140 5.51	45 1.78	2-3/8×55 2-M10×57	UL FM LPCB
65×50 2½×2	76.1×60.3 3.000×2.375	300 2.07	9.4/2120	0-3.2 0-0.13	102 4.02	144 5.67	45 1.78	2-3/8×55 2-M10×57	UL FM VdS LPCB
80×25 3×1	88.9×33.7 3.500×1.327	300 2.07	12.8/2885	0-3.2 0-0.13	115 4.53	168 6.61	46 1.81	2-1/2×70 2-M12×70	UL FM
80×50 3×2	88.9×60.3 3.500×2.375	300 2.07	12.8/2885	0-3.2 0-0.13	115 4.53	168 6.61	46 1.81	2-1/2×70 2-M12×70	UL FM VdS LPCB
80×65 3×2½	88.9×73.0 3.500×2.875	300 2.07	12.8/2885	0-3.2 0-0.13	115 4.53	168 6.61	46 1.81	2-1/2×70 2-M12×70	UL FM LPCB
80×65 3×2½	88.9×76.1 3.500×3.000	300 2.07	12.8/2885	0-3.2 0-0.13	115 4.53	172 6.77	46 1.81	2-1/2×70 2-M12×70	UL FM VdS LPCB
100×25 4×1	114.3×33.7 4.500×1.327	300 2.07	21.2/4770	0-3.2 0-0.13	144 5.67	198 7.80	50 1.97	2-1/2×70 2-M12×70	UL FM
100×50 4×2	114.3×60.3 4.500×2.375	300 2.07	21.2/4770	0-3.2 0-0.13	144 5.67	198 7.80	50 1.97	2-1/2×70 2-M12×70	UL FM VdS LPCB
100×65 4×2½	114.3×73.0 4.500×2.875	300 2.07	21.2/4770	0-3.2 0-0.13	144 5.67	198 7.80	50 1.97	2-1/2×70 2-M12×70	UL FM LPCB
100×65 4×2½	114.3×76.1 4.500×3.000	300 2.07	21.2/4770	0-3.2 0-0.13	144 5.67	202 7.95	50 1.97	2-1/2×70 2-M12×70	UL FM VdS LPCB
100×80 4×3	114.3×88.9 4.500×3.500	300 2.07	21.2/4770	0-3.2 0-0.13	148 5.83	198 7.80	50 1.97	2-1/2×70 2-M12×70	UL FM VdS LPCB
150 X 80 6×3	165.1×88.9 6.500×3.500	300 2.07	44.3/9960	0-3.2 0-0.13	200 7.87	260 10.24	51 2.01	2-3/4 × 115 2-M20 × 115	
150×100 6×4	165.1 × 114.3 6.500 × 4.500	300 2.07	44.3/9960	0-3.2 0-0.13	197 7.75	260 10.24	51 2.01	2-5/8×85 2-M16×85	UL FM LPCB
150×80 6×3	168.3×88.9 6.625×3.500	300 2.07	46.0/10340	0-3.2 0-0.13	200 7.87	268 10.55	51 2.01	2-5/8×85 2-M16×85	UL FM
150×100 6×4	168.3×114.3 6.625×4.500	300 2.07	46.0/10340	0-3.2 0-0.13	202.5 7.97	268 10.55	52.5 2.07	2-5/8×85 2-M16×85	UL FM VdS LPCB
150×150 6×6	168.3×165.1 6.625×6.500	300 2.07	46.0/10340	0-3.2 0-0.13	204 8.031	268 10.551	52.5 2.066	2-5/8×85 2-M16×85	
200×150 8×6	219.1×165.1 8.625×6.500	300 2.07	77.8/17500	0-3.2 0-0.13	257 10.12	335 13.19	60 2.36	2-3/4 × 115 2-M20 × 115	UL FM LPCB
200×150 8×6	219.1×168.3 8.625×6.625	300 2.07	77.8/17500	0-3.2 0-0.13	260 10.24	338 13.31	60 2.36	2-3/4×115 2-M20×115	UL FM LPCB

# 1NH

Heavy-duty Flexible Coupling





Nominal	Pipe	Working	Max. End	Pipe End	D	imensior	18	Bolt Size	
Size mm/in	O.D mm/in	Pressure PSI/MPa	Load kN/Lbs	Separation mm/in	A mm/ in	B mm/ in	C mm/ in	NoSize mm	Certificate
50 2	60.3 2.375	750 5.17	14.8/3320	0-3.2 0-0.13	90 3.54	134 5.28	45 1.77	2-1/2X75 2-M12X76	UL FM
65 2½	73.0 2.875	750 5.17	21.6/4860	0-3.2 0-0.13	100 3.94	150 5.91	45 1.77	2-1/2X75 2-M12X76	UL FM
65 2½	76.1 3.000	750 5.17	23.5/5280	0-3.2 0-0.13	102 4.02	154 6.06	45 1.77	2-1/2X75 2-M12X76	UL FM
80 3	88.9 3.500	750 5.17	32.1/7210	0-3.2 0-0.13	121 4.76	172 6.78	45 1.77	2-1/2X75 2-M12X76	UL FM
100 4	114.3 4.500	750 5.17	53.0/11900	0-3.2 0-0.13	151 5.95	214 8.43	50 1.97	2-5/8X85 2-M16X85	UL FM
125 5	141.3 5.563	750 5.17	81.0/18200	0-3.2 0-0.13	180 7.09	248 9.76	51 2.00	2-3/4X115 2-M20X115	UL FM
150 6	165.1 6.500	750 5.17	110.6/24800	0-3.2 0-0.13	205 8.07	278 10.95	51 2.00	2-3/4X115 2-M20X115	UL FM
150 6	168.3 6.625	750 5.17	115.0/25800	0-3.2 0-0.13	208 8.20	284 11.18	51 2.00	2-3/4X115 2-M20X115	UL FM
200 8	219.1 8.625	750 5.17	194.8/43800	0-3.2 0-0.13	268 10.56	354 13.94	61 2.40	2-7/8X140 2-M22X140	UL FM



# 1NS

Light-duty Flexible Coupling



Nominal	Pipe	Working	Max. End Pipe End			Dimension	ıs	Bolt Size	
Size mm/in	O.D mm/in	Pressure PSI/MPa	Load kN/Lbs	Separation mm/in	A mm/in	B mm/in	C mm/in	NoSize mm	Certificate
100 4	114.3 4.500	300 2.07	21.2/4770	0+3.2 0-0.13	139 5.47	182 7.16	50 1.97	2-3/8X55 2-M10X57	UL FM
125 5	139.7 5.500	450 3.10	47.5/10680	0+3.2 0-0.13	168 6.61	228 8.98	51 2.01	2-5/8X80 2-M16X85	UL FM
165 6	165.1 6.500	300 2.07	44.3/9960	0-3.2 0-0.13	192 7.56	244 9.61	51 2.01	2-1/2X75 2-M12X76	UL FM
165 6	168.3 6.625	300 2.07	46.0/10340	0-3.2 0-0.13	200 7.87	266 10.47	52 2.05	2-5/8X85 2-M16X85	UL FM
250 10	273.0 10.750	300 2.07	121.0/27210	0-3.2 0-0.13	320 12.60	398.0 15.67	64 2.52	2-3/4X120 2-M20X115	UL FM





## H305 HDPE Coupling







Nominal	Pipe		Dimensions		Bolt Size
Size	O.D	A	B	C	NoSize
mm/in	mm/in	mm/in	mm/in	mm/in	mm
50	60.3	86.5	133	116	4-1/2X70
2	2.375	3.406	5.24	4.567	
80	88.9	118	165	116	4-1/2X75
3	3.5	4.65	6.5	4.567	
100	114.3	148	202	146	4-1/2X75
4	4.5	5.827	7.953	5.75	
150	168.3	203	273	149	4-5/8X85
6	6.625	7.99	10.75	5.87	
200	219.1	263	333	152	4-5/8X85
8	8.625	10.35	13.11	5.98	
250	273.0	321	399	165	4-3/4X120
10	10.75	12.65	15.709	6.496	
300	323.9	372	452	185	4-3/4X120
12	12.75	14.656	17.795	7.28	

## H307 HDPE Transition Coupling






Nominal	Pipe		Bolt Size		
Size	O.D	A	B	C	NoSize
mm/in	mm/in	mm/in	mm/in	mm/in	mm
50	60.3	86.5	147	79	4-1/2X70
2	2.375	3.406	5.787	3.11	
80	88.9	116	176	79	4-1/2X75
3	3.5	4.567	6.929	3.11	
100	114.3	148	209	95	4-1/2X75
4	4.5	5.827	8.228	3.75	
150	168.3	202	280	95	4-5/8X85
6	6.625	7.95	11.02	3.74	
200	219.1	264	342	107.5	4-5/8X85
8	8.625	10.39	13.46	4.23	
250	273.0	321	424	127	4-3/4X120
10	10.75	12.65	16.693	5	
300	323.9	372	483	127	4-3/4X120
12	12.75	14.656	19.016	5	

# 1**G** Standard Rigid Coupling
















Nominal	Pipe	Working	Max. End	Pipe End		Dimension	s	Bolt Size	
Size mm/in	O.D mm/in	Pressure PSI/MPa	Load kN/Lbs	Separation mm/in	A mm/in	B mm/in	C mm/in	NoSize mm	Certificate
25 1	33.7 1.327	500 3.45	3.0/680	0-1.6 0-0.06	59 2.33	100 3.94	44 1.74	2-3/8X55 2-M10X57	UL FM VdS LPCB
32 1¼	42.4 1.669	500 3.45	4.8/1080	0-1.6 0-0.06	66 2.60	109.5 4.31	45 1.78	2-3/8X55 2-M10X57	UL FM VdS LPCB
40 1½	48.3 1.900	500 3.45	6.3/1420	0-3.2 0-0.13	72 2.84	115 4.53	45 1.78	2-3/8X55 2-M10X57	UL FM VdS LPCB
50 2	60.3 2.375	500 3.45	9.8/2210	0-3.2 0-0.13	85 3.35	131 5.16	45 1.78	2-3/8X55 2-M10X57	UL FM VdS LPCB
65 2½	73.0 2.875	500 3.45	14.4/3240	0-3.2 0-0.13	98 3.86	145 5.71	45 1.78	2-3/8X55 2-M10X57	UL FM LPCB
65 2½	76.1 3.000	500 3.45	15.7/3520	0-3.2 0-0.13	101 3.98	147 5.78	45 1.77	2-3/8X55 2-M10X57	UL FM VdS LPCB
80 3	88.9 3.500	500 3.45	21.4/4810	0-3.2 0-0.13	115.0 4.53	170 6.69	46 1.82	2-1/2X70 2-M12X70	UL FM VdS LPCB
100 4	108.0 4.250	500 3.45	31.5/7100	0-3.2 0-0.13	140 5.51	197 7.76	52 2.05	2-1/2X70 2-M12X70	UL FM LPCB
100 4	114.3 4.500	500 3.45	35.4/7960	0-3.2 0-0.13	146 5.75	200 7.88	52 2.05	2-1/2X70 2-M12X70	UL FM VdS LPCB
125 5	133 5.250	300 2.07	28.7/6460	0-3.2 0-0.13	165 6.50	232 9.13	52 2.05	2-5/8X85 2-M16X85	UL FM LPCB
125 5	139.7 5.500	500 3.45	52.9/11800	0-3.2 0-0.13	170 6.69	238 9.37	52 2.05	2-5/8X85 2-M16X85	UL FM VdS LPCB
125 5	141.3 5.563	500 3.45	54.1/12100	0-3.2 0-0.13	172 6.77	236.5 9.31	52 2.05	2-5/8X85 2-M16X85	UL FM LPCB
150 6	159.0 6.250	300 2.07	41.0/9240	0-3.2 0-0.13	190 7.48	258 10.16	52 2.05	2-5/8X85 2-M16X85	UL FM LPCB
150 6	165.1 6.500	500 3.45	73.8/16610	0-3.2 0-0.13	198 7.80	266 10.47	52 2.05	2-5/8X85 2-M16X85	UL FM LPCB
150 6	168.3 6.625	500 3.45	76.7/17260	0-3.2 0-0.13	202.0 7.95	270 10.63	52 2.05	2-5/8X85 2-M16X85	UL FM VdS LPCB
200 8	219.1 8.625	450 3.10	116.9/26280	0-3.2 0-0.13	260.0 10.24	346 13.625	62 2.44	2-3/4X115 2-M20X115	UL FM VdS LPCB
250A 10	267.4 10.528	300 2.07	116/26130	0-3.2 0-0.13	318 12.52	396 15.60	63 2.48	2-3/4X120 2-M20X115	UL FM
250 10	273.0 10.750	400 2.8	163.8/36800	0-3.2 0-0.13	327 12.88	420 16.54	63 2.48	2-7/8X125 2-M22X125	UL FM VdS
300A 12	318.5 12.539	300 2.07	164.8/37080	0-3.2 0-0.13	364 14.33	456 17.95	63 2.48	2-7/8X140 2-M22X140	UL FM
300 12	323.9 12.750	400 2.8	230.6/51880	0-3.2 0-0.13	378 14.88	466 18.35	63 2.48	2-7/8X140 2-M22X140	UL FM
350 14	355.6 14.000	300 2.07	205.5/46220	0-3.2 0-0.13	415 16.34	510 20.08	72 2.84	3-7/8X140 3-M22X140	UL FM
400 16	406.4 16.000	300 2.07	268.4/60370	0-3.2 0-0.13	468 18.43	575 22.64	72 2.84	3-7/8X140 3-M22X140	UL FM
450 18	457.2 18.000	225 1.6	262.5/59060	0-3.2 0-0.13	508 20	608 23.94	78 3.07	3-7/8X140 3-M22X140	_
500 20	508.0 20.0	225 1.6	324.1/72910	0-3.2 0-0.13	563 22.17	660 25.98	78 3.07	4-7/8X140 4-M22X140	_
600 24	609.6 24.000	225 1.6	466.7/104990	0-3.2 0-0.13	668 26.30	772 30.40	78 3.07	4-1X140	








































# 1GS

Light-duty Rigid Coupling







Nominal	Pipe	Working	Max. End	Pipe End		Dimension	ıs	Bolt Size	
Size mm/in	O.D mm/in	Pressure PSI/MPa	Load kN/Lbs	Separation mm/in	A mm/in	B mm/in	C mm/in	NoSize mm	Certificate
80 3	88.9 3.500	350 2.41	15.0/3360	0-3.2 0-0.13	114 4.50	160 6.30	45 1.78	2-3/8X55 2-M10X57	UL FM VdS LPCB
100 4	108.0 4.250	300 2.07	18.9/4260	0-3.2 0-0.13	135 5.30	185 7.28	50 1.97	2-1/2X70 2-M12X70	UL FM LPCB
100 4	114.3 4.500	350 2.41	24.7/5560	0-3.2 0-0.13	140 5.51	192 7.56	46.5 1.83	2-1/2X70 2-M12X70	UL FM VdS LPCB
125 5	139.7 5.500	350 2.41	36.9/8300	0-3.2 0-0.13	168 6.62	225 8.86	50 1.97	2-1/2X75 2-M12X76	UL FM LPCB
125 5	141.3 5.563	350 2.41	37.8/8490	0-3.2 0-0.13	170 6.69	225 8.86	50 1.97	2-1/2X75 2-M12X76	U L FM LPCB
150 6	159.0 6.250	300 2.07	41.0/9240	0-3.2 0-0.13	190 7.48	252 9.92	50 1.97	2-5/8X80 2-M16X85	UL FM LPCB
150 6	165.1 6.500	350 2.41	51.6/11600	0-3.2 0-0.13	195 7.68	250 9.84	50 1.97	2-1/2X75 2-M12X76	UL FM LPCB
150 6	168.3 6.625	350 2.41	53.6/12000	0-3.2 0-0.13	200 7.87	255 10.04	50 1.97	2-1/2X75 2-M12X76	UL FM LPCB
200A 8	216.3 8.516	300 2.07	76.0/17100	0-3.2 0-0.13	255 10.04	320 12.60	58 2.28	2-5/8X85 2-M16X85	UL FM
200 8	219.1 8.625	350 2.41	90.8/20430	0-3.2 0-0.13	255 10.05	324 12.76	58 2.28	2-5/8X85 2-M16X85	UL FM LPCB
250 10	273.0 10.750	300 2.07	121.0/27210	0-3.2 0-0.13	318 12.52	410 16.14	63 2.48	2-3/4X120 2-M20X115	UL FM

# 1GK Angle Pad Coupling







Nominal	Pipe	Working	Max. End	Pipe End		Dimension	s	Bolt Size	
Size mm/in	O.D mm/in	Pressure PSI/MPa	Load kN/Lbs	Separation mm/in	A mm/in	B mm/in	C mm/in	NoSize mm	Certificate
32 1¼	42.4 1.669	500 3.45	4.8/1080	0-1.6 0-0.06	64 2.52	99 3.90	46.5 1.83	2-M10X55	UL FM
40 1½	48.3 1.900	500 3.45	6.3/1420	0-3.2 0-0.13	70 2.76	105 4.13	46.5 1.83	2-M10X55	UL FM
50 2	60.3 2.375	500 3.45	9.8/2210	0-3.2 0-0.13	85 3.35	121 4.76	46.5 1.83	2-M10X55	UL FM
65 2½	73.0 2.875	300 2.07	8.7/1950	0-3.2 0-0.13	99 3.90	134 5.28	47.5 1.87	2-M10X63	UL FM
65 2½	76.1 3.000	500 3.45	15.7/3520	0-3.2 0-0.13	102 4.02	137 5.39	47.5 1.87	2-M10X63	UL FM
80 3	88.9 3.500	500 3.45	21.4/4810	0-3.2 0-0.13	115 4.53	150 5.91	47.5 1.87	2-M10X60	UL FM
100 4	114.3 4.500	500 3.45	35.4/7960	0-3.2 0-0.13	142 5.59	180 7.09	50 1.97	2-M10X65	UL FM
125 5	139.7 5.500	300 2.07	31.7/7130	0-3.2 0-0.13	171 6.73	214 8.43	52.5 2.07	2-M12X75	UL FM
150 6	165.1 6.500	300 2.07	44.3/9960	0-3.2 0-0.13	198 7.80	242 9.53	52.5 2.07	2-M12X75	UL FM
150 6	168.3 6.625	300 2.07	46.0/10340	0-3.2 0-0.13	201 7.91	245 9.65	52.5 2.07	2-M12X75	UL FM
200 8	219.1 8.625	300 2.07	77.8/17500	0-3.2 0-0.13	258 10.16	331 13.03	63.5 2.50	2-M20X110	UL FM
250 10	273.0 10.750	300 2.07	121.0/27210	0-3.2 0-0.13	321 12.64	406 15.98	64.5 2.54	2-M22X140	UL

## 90 90° Elbow







Nominal	Pipe	Working	Dimensions	Certificate
Size	O.D	Pressure	L	
mm/in	mm/in	PSI/MPa	mm/in	
25	33.7	500	57	UL FM VdS LPCB
1	1.315	3.45	2.24	
32	42.4	500	70	UL FM VdS LPCB
1¼	1.660	3.45	2.75	
40	48.3	500	70	UL FM VdS LPCB
1½	1.900	3.45	2.75	
50	60.3	500	82.5	UL FM VdS LPCB
2	2.375	3.45	3.25	
65	73.0	500	95	UL FM
2½	2.875	3.45	3.74	
65	76.1	500	95	UL FM VdS LPCB
2½	3.000	3.45	3.74	
80	88.9	500	108	UL FM VdS LPCB
3	3.500	3.45	4.25	
100	114.3	500	127	UL FM VdS LPCB
4	4.500	3.45	5.00	
125	133.0	500	122	UL FM
5	5.250	3.45	4.80	
125	139.7	500	140	UL FM VdS LPCB
5	5.500	3.45	5.50	
125	141.3	500	140	UL FM
5	5.563	3.45	5.50	
150	165.1	500	165	UL FM LPCB
6	6.500	3.45	6.50	
150	168.3	500	165	UL FM VdS LPCB
6	6.625	3.45	6.50	
200	219.1	500	197	UL FM VdS LPCB
8	8.625	3.45	7.75	
250	267.4	300	229	UL FM
10	10.528	2.07	9.00	
250	273.0	300	229	UL FM VdS
10	10.750	2.07	9.00	
300	318.5	300	254	UL FM
12	12.539	2.07	10.00	
300	323.9	300	254	UL FM VdS
12	12.750	2.07	10.00	
350	355.6	300	280	_
14	14.000	2.07	11.02	
350	377.0	300	279	_
14	14.84	2.07	10.98	
400	406.4	300	305	
16	16.000	2.07	12.00	
400	426.0	300	305	
16	16.77	2.07	12.00	
450	457.2	300	394	_
18	18.000	2.07	15.50	
450	480.0	300	335	_
18	18.90	2.07	13.19	
500	508.0	300	438	_
20	20.000	2.07	17.25	
600	609.6	300	508	_
24	24.000	2.07	20.00	



# 90C

90° Hydrant Elbow



Nominal	Pipe	Working				
Size mm/in	O.D mm/in	Pressure PSI/MPa	А	L 1 mm/in	L 2 mm/in	Certificate
100X80X25	114.3X88.9X33.7	300	1-11.5NPT	102	95	UL FM
4X3X1	4.500X3.500X1.327	2.07	Rp1-ISO7/1	4.016	3.74	
150x80X25	165.1X88.9X33.7	300	1-11.5NPT	130	130	UL FM
6X3X1	6.500X3.500X1.327	2.07	Rp1-ISO7/1	5.118	5.118	









90C 90° Drain Elbow



Nominal	Pipe	Working		Dimensions		
Size	O.D	Pressure	L	D	E	Certificate
mm/in	mm/in	PSI/MPa	mm/in	mm/in	mm/in	
50	60.3	300	82.5	57	40	_
2	2.375	2.07	3.248	2.244	1.575	
65	73	300	95	70	43	_
21/2	2.875	2.07	3.74	2.756	1.693	
80	88.9	300	108	70	53	_
3	3.500	2.07	4.25	2.756	2.087	
100	114.3	300	127	70	66	_
4	4.5	2.07	5	2.756	2.598	
150	168.3	300	165	70	93	_
6	6.625	2.07	6.496	2.756	3.661	
200	219.1	300	197	70	126	_
8	8.625	2.07	7.756	2.756	4.961	





## 90R

90° Reducing Elbow



Nominal	Pipe	Working	Dimensions	Certificate
Size	O.D	Pressure	L	
mm/in	mm/in	PSI/MPa	mm/in	
80X65	88.9X76.1	500	108	UL FM
3X2 <sup>1</sup> / <sub>2</sub>	3.500X3.000	3.45	4.25	
100X65	114.3X76.1	500	127	UL FM
4X2 <sup>1</sup> / <sub>2</sub>	4.500X3.000	3.45	5.00	
100X80	114.3X88.9	500	127	UL FM
4X3	4.500X3.500	3.45	5.00	
150X100	165.1X114.3	500	165	UL FM
6X4	6.500X4.500	3.45	6.50	
150X100	168.3X114.3	500	165	UL FM
6X4	6.625X4.500	3.45	6.50	

## 90S Light-duty 90° Elbow







Nominal	Pipe	Working	Dimensions	Certificate	
Size	O.D	Pressure	L		
mm/in	mm/in	PSI/MPa	mm/in		
50	60.3	300	70	UL FM VdS LPCB	
2	2.375	2.07	2.75		
65	73.0	300	76	ULFM	
2½	2.875	2.07	3.00		
65	76.1	300	76	UL FM VdS LPCB	
2½	3.000	2.07	3.00		
80	88.9	300	85.5	UL FM VdS LPCB	
3	3.500	2.07	3.37		
100	108.0	500	101	ULFM	
4	4.500	3.45	3.98		
100	114.3	365	101	UL FM VdS LPCB	
4	4.500	2.52	3.98		
125	139.7	300	124	UL FM VdS LPCB	
5	5.500	2.07	4.88		
150	159.0	300	140	ULFM	
6	6.500	2.07	5.50		
150	165.1	365	140	UL FM LPCB	
6	6.500	2.52	5.50		
150	168.3	300	140	UL FM VdS LPCB	
6	6.625	2.07	5.50		
200	216.3	300	175	UL FM	
8	8.625	2.07	6.89		
200	219.1	300	165	UL FM VdS LPCB	
8	8.625	2.07	6.50		








# 91R

90° END-ALL Elbow







Nominal	Pipe	Working		Dimensions		
Size mm/in	O.D mm/in	Pressure PSI/MPa	A (NPT/BSP)	L1 mm/in	L2 mm/in	Certificate
32X15 11/4X1/2	42.4X21.3 1.660X0.825	300 2.07	1/2	35.1 1.382	44.5 1.752	UL
32X20 11/4X3/4	42.4X26.9 1.660X1.050	300 2.07	3/4	34.9 1.374	47.6 1.874	UL
32X25 11/4X1	42.4X33.7 1.660X1.315	300 2.07	1	38.1 1.5	51.6 2.031	UL
40X15 11/2X1/2	48.3X21.3 1.900X0.825	300 2.07	1/2	34.9 1.374	44.5 1.752	UL
40X20 11/2X3/4	48.3X26.9 1.900X1.050	300 2.07	3/4	34.9 1.374	47.6 1.874	UL
40X25 11/2X1	48.3X33.7 1.900X1.315	300 2.07	1	38.1 1.5	51.6 2.031	UL
50X15 2X1/2	60.3X21.3 2.375X0.825	300 2.07	1/2	41.4 1.63	44.5 1.752	UL
50X20 2X3/4	60.3X26.9 2.375X1.050	300 2.07	3/4	41.3 1.626	47.6 1.874	UL
50X25 2X1	60.3X33.7 2.375X1.315	300 2.07	1	44.5 1.752	51.6 2.031	UL
65X15 21/2X1/2	73.0X21.3 2.875X0.825	300 2.07	1/2	46 1.811	44.5 1.752	UL
65X20 21/2X3/4	73.0X26.9 2.875X1.050	300 2.07	3/4	46 1.811	47.6 1.874	UL
65X25 21/2X1	73.0X33.7 2.875X1.315	300 2.07	1	49.2 1.937	51.6 2.031	UL
80X20 3X3/4	88.9X26.9 3.500X1.050	300 2.07	3/4	60.3 2.374	52.4 2.063	UL
80X25 3X1	88.9X33.7 3.500X1.315	300 2.07	1	63.5 2.5	52.4 2.063	UL

# 105

11.25° Elbow








Nominal	Pipe	Working	Dimensions	Certificate
Size	O.D	Pressure	L	
mm/in	mm/in	PSI/MPa	mm/in	
32	42.4	500	35	UL FM
1 <sup>1</sup> / <sub>4</sub>	1.660	3.45	1.38	
40	48.3	500	35	UL FM
1 <sup>1</sup> / <sub>2</sub>	1.900	3.45	1.38	
50	60.3	500	35	UL FM VdS LPCB
2	2.375	3.45	1.38	
65	73.0	500	38	UL FM
2 <sup>1</sup> / <sub>2</sub>	2.875	3.45	1.506	
65	76.1	500	38	UL FM VdS LPCB
2 <sup>1</sup> / <sub>2</sub>	3.000	3.45	1.506	
80	88.9	500	38	UL FM VdS LPCB
3	3.500	3.45	1.50	
100	108.0	500	44	UL FM
4	4.250	3.45	1.73	
100	114.3	500	44	UL FM VdS LPCB
4	4.500	3.45	1.73	
125	139.7	500	51	UL FM VdS LPCB
5	5.500	3.45	2.00	
150	159.0	500	51	UL FM
6	6.250	3.45	2.00	
150	165.1	500	51	UL FM LPCB
6	6.500	3.45	2.00	
150	168.3	500	51	UL FM VdS
6	6.625	3.45	2.00	
200	219.1	500	51	UL FM VdS LPCB
8	8.625	3.45	2.00	

## 110 22.5° Elbow







Nominal	Pipe	Working	Dimensions	Certificate
Size	O.D	Pressure	L	
mm/in	mm/in	PSI/MPa	mm/in	
32	42.4	500	45	ULFM
1¼	1.660	3.45	1.77	
40	48.3	500	45	ULFM
1½	1.900	3.45	1.77	
50	60.3	500	48	ULFM
2	2.375	3.45	1.89	
65	73.0	500	51	ULFM
2½	2.875	3.45	2.00	
65	76.1	500	51	UL FM VdS LPCB
2½	3.000	3.45	2.00	
80	88.9	500	57	UL FM VdS LPCB
3	3.500	3.45	2.24	
100	108.0	500	73	ULFM
4	4.250	3.45	2.87	
100	114.3	500	73	UL FM VdS LPCB
4	4.500	3.45	2.87	
125	139.7	500	73	UL FM VdS LPCB
5	5.500	3.45	2.87	
150	159.0	500	79	ULFM
6	6.250	3.45	3.11	
150	165.1	500	79	UL FM LPCB
6	6.500	3.45	3.11	
150	168.3	500	79	UL FM VdS
6	6.625	3.45	3.11	
200	219.1	500	98	UL FM VdS LPCB
8	8.625	3.45	3.86	



120

45° Elbow








Nominal			Dimensions	
Size		Pressure	L	Certificate
mm/in	mm/in	PSI/MPa	mm/in	
25	33.7	500	44.5	
1	1.315	3.45	1.75	UL FM VdS LPCB
32	42.4	500	44.5	
11/4	1.660	3.45	1.75	UL FM VdS LPCB
40	48.3	500	44.5	
11/2	1.900	3.45	1.75	UL FM VdS LPCB
50	60.3	500	51	
2	2.375	3.45	2.00	UL FM VdS LPCB
65	73.0	500	57	514
21/2	2.875	3.45	2.24	UL FM
65	76.1	500	57	III EMANGE LIDED
21/2	3.000	3.45	2.24	UL FM VdS LPCB
80	88.9	500	63.5	LIL EM VAC I DOD
3	3.500	3.45	2.50	UL FM VdS LPCB
100	108.0	500	76	UL FM
4	4.250	3.45	3.00	ULFM
100	114.3	500	76	UL FM VdS LPCB
4	4.500	3.45	3.00	OL FWI VOS EFGB
125	133.0	500	82.5	
5	5.250	3.45	3.25	
125	139.7	500	82.5	UL FM VdS LPCB
5	5.500	3.45	3.25	OL FW VOS LFGB
125	141.3	500	82.5	UL FM
5	5.563	3.45	3.25	OLTW
150	159.0	500	89	ULFM
6	6.250	3.45	3.50	OLTW
150	165.1	500	89	UL FM LPCB
6	6.500	3.45	3.50	OET III EI OB
150	168.3	500	89	UL FM VdS LPCB
6	6.625	3.45	3.50	OET III VOO EI OD
200	216.3	500	108	ULFM
8	8.516	3.45	4.25	
200	219.1	500	108	UL FM VdS LPCB
8	8.625	3.45	4.25	OET III VOO EI OD
250	267.4	300	120.5	ULFM
10	10.528	2.07	4.75	
250	273.0	500	120.5	UL FM VdS
10	10.750	3.45	4.75	
300	318.5	300	133	UL FM
12	12.750	2.07	5.25	
300	323.9	500	133	UL FM VdS
12	12.750	3.45	5.25	
350	377	300	122	_
14	14.843	2.07	4.80	
350	355.6	300	152	_
14	14.000	2.07	6.00	
400 16	406.4 16.000	300 2.07	184 7.25	
450 18	457.2 18.000	300 2.07	203 8.00	
500 20	508.0 20.000	300 2.07	229 9.00	
600 24	609.6 24.000	300 2.07	280 11.00	
	24.000	2.01	11.00	l .

130

Tee







Nominal	Pipe	Working	Pressure L	
Size	O.D	Pressure		
mm/in	mm/in	PSI/MPa		
25	33.7	500	57	UL FM VdS LPCB
1	1.315	3.45	2.24	
32	42.4	500	70	UL FM VdS LPCB
1¼	1.660	3.45	2.75	
40	48.3	500	70	UL FM VdS LPCB
1½	1.900	3.45	2.75	
50	60.3	500	82.5	UL FM VdS LPCB
2	2.375	3.45	3.25	
65	73.0	500	95	UL FM
2½	2.875	3.45	3.74	
65	76.1	500	95	UL FM VdS LPCB
2½	3.000	3.45	3.74	
80	88.9	500	108	UL FM VdS LPCB
3	3.500	3.45	4.25	
100	114.3	500	127	UL FM VdS LPCB
4	4.500	3.45	5.00	
125	133.0	500	122	UL FM
5	5.250	3.45	4.80	
125	139.7	500	140	UL FM VdS LPCB
5	5.500	3.45	5.50	
125	141.3	500	140	UL FM
5	5.563	3.45	5.50	
150	165.1	500	165	UL FM LPCB
6	6.500	3.45	6.50	
150	168.3 6.625	500 3.45	165 6.50	UL FM VdS LPCB
200	219.1 8.625	500 3.45	197 7.75	UL FM VdS LPCB
250	267.4	500	229	UL FM
10	10.528	3.45	9.00	
250	273.0	500	229	UL FM VdS
10	10.750	3.45	9.00	
300	318.5	500	254	_
12	12.539	3.45	10.00	
300	323.9	500	254	UL FM VdS
12	12.750	3.45	10.00	
350	355.6	300	280	_
14	14.000	2.07	11.02	
350	377.0	300	279	_
14	14.84	2.07	10.98	
400	406.4	300	305	_
16	16.000	2.07	12.00	
400	426.0	300	285	_
16	16.77	2.07	11.22	
450	457.2	300	342	_
18	18.000	2.07	13.46	
450	480.0	300	335	_
18	18.90	2.07	13.19	
500	508.0	300	381	_
20	20.000	2.07	15.00	
600	609.6	300	432	_
24	24.000	2.07	17.01	





130C

Reducing tee



Nominal Size mm/in	Pipe	Working			Dimensions			
	O.D mm/in		A	L mm/in	D mm/in	E mm/in	M mm/in	Certificate
100X80X25	114.3X88.9X33.7	300	1-11.5NPT	160	102	102	60	UL FM
4X3X1	4.5X3.5X1.327	2.07	Rp1-IS07/1	6.3	4.02	4.02	2.36	
150X80X25	165.1X88.9X33.7	300	1-11.5NPT	165	130	130	60	UL FM
6X3X1	6.5X3.5X1.327	2.07	Rp1-ISO7/1	6.5	5.12	5.12	2.36	






130D Reducing tee



Nominal	Pipe Working								
Size mm/in	O.D mm/in	Pressure PSI/MPa	A	L mm/in	D mm/in	E mm/in	M mm/in	Certificate	
100X80X25	114.3X88.9X33.7	300	1-11.5NPT	102	102	102	67	UL FM	
4X3X1	4.5X3.5X1.327	2.07	Rp1-IS07/1	4.02	4.02	4.02	2.638		
150X80X25	165.1X88.9X33.7	300	1-11.5NPT	130	130	130	91	UL FM	
6X3X1	6.5X3.5X1.327	2.07	Rp1-IS07/1	5.12	5.12	5.12	3.58		








# 130S

Light-duty Tee








Nominal	Pipe	Working	Dimensions	Certificate	
Size	O.D	Pressure	L		
mm/in	mm/in	PSI/MPa	mm/in		
50	60.3	300	70	UL FM VdS LPCB	
2	2.375	2.07	2.75		
65	73.0	300	76	ULFM	
2½	2.875	2.07	3.00		
65	76.1	300	76	UL FM VdS LPCB	
2½	3.000	2.07	3.00		
80	88.9	300	85.5	UL FM VdS LPCB	
3	3.500	2.07	3.37		
100	108.0	500	101	ULFM	
4	4.500	3.45	3.98		
100	114.3	300	101	UL FM VdS LPCB	
4	4.500	2.07	3.98		
125	139.7	300	124	UL FM VdS LPCB	
5	5.500	2.07	4.88		
150	159.0	300	140	ULFM	
6	6.500	2.07	5.50		
150	165.1	300	140	UL FM LPCB	
6	6.500	2.07	5.50		
150	168.3	300	140	UL FM VdS LPCB	
6	6.625	2.07	5.50		
200	216.3	300	175	UL FM	
8	8.625	2.07	6.89		
200	219.1	300	175	UL FM VdS LPCB	
8	8.625	2.07	6.89		

# 130R Reducing Tee





Nominal	Pipe	Working	Dimensions	Dimensions	Certificate
Size	O.D	Pressure	L	L 1	
mm/in	mm/in	PSI/MPa	mm/in	mm/in	
65×65×80	76.1×76.1×88.9	500	108	95	
2½×2½×3	3.000×3.000×3.500	3.45	4.25	3.74	
65×65×100	76.1×76.1×114.3	500	127	102	
2½×2½×4	3.000×3.000×4.500	3.45	5.00	4.02	
80×80×100	88.9×88.9×114	500	127	102	_
3×3×4	3.500×3.500×4.500	3.45	5.00	4.02	











































130R

Reducing Tee







Nominal	Pipe	Working	Dimensions	Dimensions	Certificate
Size	O.D	Pressure	L 1	L 2	
mm/in	mm/in	PSI/MPa	mm/in	mm/in	
50×25	60.3×33.7	500	70	70	UL FM VdS LPCB
2×1	2.375×1.315	3.45	2.75	2.75	
50×40	60.3×48.3	500	70	70	UL FM VdS LPCB
2×1½	2.375×1.900	3.45	2.75	2.75	
65×40	73.0×48.3	500	76	76	UL FM
2½×1½	2.875×1.900	3.45	3.00	3.00	
65×50	73.0×60.3	500	69	76	UL FM
2½×2	2.875×2.375	3.45	2.72	3.00	
65×32	76.1×42.4	500	76	76	UL FM
2½×1¼	3.000×1.660	3.45	3.00	3.00	
65×40	76.1×48.3	500	76	76	UL FM VdS LPCB
2½×1½	3.000×1.900	3.45	3.00	3.00	
65×50	76.1×60.3	500	69	76	UL FM VdS LPCB
2½×2	3.000×2.375	3.45	2.72	3.00	
80×32	88.9×33.7	500	108	108	UL FM VdS LPCB
3×1	3.500×1.315	3.45	4.25	4.25	
80×32	88.9×42.4	500	85.5	85.5	UL FM
3×1¼	3.500×1.660	3.45	3.37	3.37	
80×40	88.9×48.3	500	85.5	85.5	UL FM VdS LPCB
3×1½	3.500×1.900	3.45	3.37	3.37	
80×50	88.9×60.3	500	85.5	85.5	UL FM VdS LPCB
3×2	3.500×2.375	3.45	3.37	3.37	UL FM
80×65	88.9×73.0	500	85.5	85.5	
3×2½	3.500×2.875	3.45	3.37	3.37	UL FM VdS LPCB
80×65	88.9×76.1	500	85.5	85.5	
3×2½	3.500×3.000	3.45	3.37	3.37	UL FM
100×50	108.0×60.3	500	101	101	
4×2	4.250×2.375	3.45	3.98	3.98	
100×80	108.0×88.9	500	101	101	
4×3	4.250×3.500	3.45	3.98	3.98	UL FM
100×25	114.3×33.7	500	101	101	
4×1 100×40	4.500×1.315	3.45	3.98	3.98	UL FM VdS LPCB
4×1½ 100×50	4.500×1.900	3.45 500	3.98 101	3.98 101	UL FM VdS LPCB
4×2 100×65	4.500×2.375	3.45 500	3.98	3.98	UL FM VdS LPCB
4×2½	4.500×2.875	3.45	101 3.98	3.98	UL FM
100×65	114.3×76.1	500	101	101	UL FM VdS LPCB
4×2½	4.500×3.000	3.45	3.98	3.98	
100×80	114.3×88.9	500	101	101	UL FM VdS LPCB
4×3	4.500×3.500	3.45	3.98	3.98	
125×50	133.0×60.3	500	124	124	UL FM
5×2	5.250×2.375	3.45	4.88	4.88	
125×65	133.0×76.1	500	124	124	UL FM
5×2½	5.250×3.000	3.45	4.88	4.88	
125×100	133.0×108.0	500	124	124	UL FM
5×4	5.250×4.250	3.45	4.88	4.88	
125×100	133.0×114.3	500	124	124	UL FM
5×4	5.250×4.500	3.45	4.88	4.88	
125×40	139.7×48.3	500	124	124	UL FM
5×1½	5.500×1.900	3.45	4.88	4.88	
125×50	139.7×60.3	500	124	124	UL FM
5×2	5.500×2.375	3.45	4.88	4.88	
125×65	139.7×76.1	500	124	124	UL FM
5×2%	5.500×3.000	3.45	4.88	4.88	
125×80	139.7×88.9	500	124	124	UL FM
5×3	5.500×3.500	3.45	4.88	4.88	
125×100	139.7×114.3	500	124	124	UL FM VdS LPCB
5×4	5.500×4.500	3.45	4.88	4.88	
125×50	141.3×60.3	500 3.45	124 4.88	124 4.88	UL FM
5×2 125×80	5.563×2.375 141.3×88.9	500	124	124	UL FM
5×3	5.563×3.500	3.45	4.88	4.88	UL FM
125×100	141.3×114.3	500	124	124	
5×4	5.563×4.500	3.45	4.88	4.88	ULFM
150×60	159.0×60.3	500	140	140	
6×2	6.250×2.375	3.45	5.50	5.50	UI FM
150×65	159.0×76.1	500	140	140	
6X2½	6.250×3.000	3.45	5.50	5.50	
150×80	159.0×88.9	500	140	140	
6×3	6.250×3.500	3.45	5.50	5.50	UL FM
150×100	159.0×108.0	500	140	140	
6×4	6.250×4.250	3.45	5.50	5.50	UL FM
150×100	159.0×114.3	500	140	140	
6×4	6.250×4.500	3.45	5.50	5.50	UL FM

# 130R

Reducing Tee







Nominal	Pipe	Working	Dimensions	Dimensions	Certificate
Size	O.D	Pressure	L 1	L 2	
mm/in	mm/in	PSI/MPa	mm/in	mm/in	
150×125	159.0×133.0	500	140	140	UL FM
6×5	6.250×5.250	3.45	5.50	5.50	
150×50	165.1×60.3	300	140	140	UL FM
6×2	6.500×2.375	2.07	5.50	5.50	
150×65	165.1×76.1	300	140	140	UL FM
6×2½	6.500×3.000	2.07	5.50	5.50	
150×80	165.1×88.9	300	140	140	UL FM LPCB
6×3	6.500×3.500	2.07	5.50	5.50	
150×100	165.1×114.3	300	140	140	UL FM LPCB
6×4	6.500×4.500	2.07	5.50	5.50	
150×125	165.1×139.7	300	140	140	UL FM LPCB
6×5	6.500×5.500	2.07	5.50	5.50	
165×133	165.1×133.0 6.500×5.250	300	140 5.50	140 5.50	UL
150×50	168.3×60.3	500	140	140	UL FM VdS LPCB
6×2	6.625×2.375	3.45	5.50	5.50	
150×65	168.3×73.0	500	140	140	UL FM
6×2%	6.625×2.875	3.45	5.50	5.50	
150×65	168.3×76.1	500	140	140	UL FM VdS LPCB
6×2%	6.625×3.000	3.45	5.50	5.50	
150×80	168.3×88.9	500	140	140	UL FM VdS LPCB
6×3	6.625×3.500	3.45	5.50	5.50	
150×100	168.3×114.3	500	140	140	UL FM VdS LPCB
6×4	6.625×4.500	3.45	5.50	5.50	
150×125	168.3×139.7	300	140	140	UL FM VdS LPCB
6×5	6.625×5.500	2.07	5.50	5.50	
150×125	168.3×141.3	300	140	140	UL FM
6×5	6.625×5.563	2.07	5.50	5.50	_
200×100	216.3×114.3	300	175	175	
8×4	8.516×4.500	2.07	6.89	6.89	UI FM
200×150	216.3×165.1	300	175	175	
8×6	8.516×6.500	2.07	6.89	6.89	UL FM VdS LPCB
200×50	219.1×60.3	500	175	175	
8×2 200×65	8.625×2.375 219.1×76.1	3.45	6.89 175	6.89 175	UL FM
8×2½	8.625×3.000	2.07	6.89	6.89	UL FM VdS LPCB
200×80	219.1×88.9	500	175	175	
8×3 200×100	8.625×3.500 219.1×108.0	3.45 500	6.89	6.89	
8×4 200×100	8.625×4.250 219.1×114.3	3.45	6.89 175	6.89 175	UL FM
8×4	8.625×4.500	3.45	6.89	6.89	UL FM VdS LPCB
200×125	219.1×133.0	300	175	175	
8×5 200×125	8.625×5.250 219.1×139.7	2.07	6.89	6.89	UL FM
8×5	8.625×5.500	2.07	6.89	6.89	UL FM
200×150	219.1×159.0	300	175	175	UL FM
8×6	8.625×6.250	2.07	6.89	6.89	
200×150	219.1×165.1	300	175	175	UL FM
8×6	8.625×6.500	2.07	6.89	6.89	
200×150	219.1×168.3	500	175	175	UL FM VdS LPCB
8×6	8.625×6.625	3.45	6.89	6.89	
250×150	273.0×159.0	500	229	229	UL FM
10×6	10.750×6.250	3.45	9.00	9.00	
250×150	273.0×165.1	300	229	229	UL FM
10×6	10.750×6.500	2.07	9.00	9.00	
250×150	273.0×168.3	300	229	229	UL FM VdS
10×6	10.750×6.625	2.07	9.00	9.00	
250×200	273.0×219.1	300	229	229	UL FM VdS
10×8	10.750×8.625	2.07	9.00	9.00	
300×150	323.9×165.1	300	254	254	UL FM
12×6	12.750×6.500	2.07	10	10	
300×150	323.9×168.3	300	254	254	_
12×6	12.750×6.625	2.07	10	10	
300×200	323.9×219.1	300	254	254	UL FM VdS
12×8	12.750×8.625	2.07	10	10	
300×250	323.9×273.0	300	254	254	UL FM VdS
12×10	12.750×10.750	2.07	10	10	
450×300	480.0×323.9	300	335	335	_
18×12	18.897×12.750	2.07	13.188	13.188	
450×350	480.0×377.0	300	335	335	_
18×14	18.897×14.840	2.07	13.188	13.188	

# 130R

Reducing Tee







Nominal	Pipe	Working	Dimensions	Dimensions	Certificate
Size	O.D	Pressure	L 1	L 2	
mm/in	mm/in	PSI/MPa	mm/in	mm/in	
350×150	355.6×168.3	300	279	238	_
14×6	14.000×6.625	2.07	10.98	9.37	
350×200	355.6×219.1	300	280	280	_
14×8	14.00×8.625	2.07	11.02	11.02	
350×250	355.6×273.0	300	279	257	_
14×10	14.000×10.750	2.07	10.98	10.12	
350×300	355.6×323.9	300	279	270	_
14×12	14.000×12.750	2.07	10.98	10.63	
350×125	377.0×133.0	300	240	265	
14×5	14.840 × 5.250	2.07	9.45	10.43	
350×150	377.0 × 159.0	300	240	265	
14×6	14.840×6.250	2.07	9.45	10.43	
350×200	377.0×219.1	300	240	265	
14×8 350×250	14.840 × 8.625 377.0 × 273.0	2.07	9.45	10.43	
14×10	14.840×10.750	2.07	240 9.45	265 10.43	_
350×300	377.0×323.9	300	240	265	_
14×12	14.840×12.750	2.07	9.45	10.43	
400×150	406.4×168.3	300	305	264	_
16×6	16.000×6.625	2.07	12.01	10.39	
400×200	406.4×219.1	300	305	273	_
16×8	16.000×8.625	2.07	12.01	10.75	
400×250	406.4×273.0	300	305	283	
16×10	16.000×10.750	2.07	12.01	11.14	
400×300	406.4×323.9	300	305	295	
16×12 400×350	16.000×12.750 406.4×355.6	2.07	12.01 305	11.61 305	
16×14 400×125	16.000×14.000 426.0×133.0	2.07	12.01 260	12.01	_
16×5	16.772×5.250	2.07	10.24	11.22	_
400×150	426.0×159.0	300	260	285	_
16×6	16.772×6.250	2.07	10.24	11.22	
400×200	426.0×219.1	300	260	285	_
16×8	16.772×8.625	2.07	10.24	11.22	
400×250	426.0×273.0	300	260	285	_
16×10	16.772×10.750	2.07	10.24	11.22	
400×300	426.0×323.9	300	260	285	_
16×12	16.772×12.750	2.07	10.24	11.22	
450×150	457.2×168.3	300	343	298	
18×6	18.000×6.625	2.07	13.50	11.73	
450×200	457.2×219.1	300	343	298	
18×8	18.000 × 8.625	2.07	13.50	11.73	
450×250	457.2 × 273.0	300	343	308	
18×10 450×300	18.000×10.750 457.2×323.9	2.07	13.50 343	12.13 321	
18×12	18.000×12.750	2.07	13.50	12.64	
450×350	457.2×355.6	300	343	330	_
18×14	18.000×14.000	2.07	13.50	12.99	
450×400	457.2×406.4	300	343	330	
18×16	18.000×16.000	2.07	13.50	12.99	
500×150	508.0×168.3	300	381	324	_
20×6	20.000×6.625	2.07	15.00	12.76	
500×200	508.0×219.1	300	381	324	_
20×8	20.000×8.625	2.07	15.00	12.76	
500×250	508.0×273.0	300	381	333	
20×10	20.000×10.750	2.07	15.00	13.11	
500×300	508.0×323.9	300	381	346	
20×12	20.000×12.750	2.07	15.00	13.62	
500×350	508.0×355.6	300	381	356	
20×14 500×400	20.000×14.000 508.0×406.4	2.07	15.00 381	14.02 356	
20×16	20.000×16.000	2.07	15.00	14.02	
500×450	508.0×457.2	300	381	368	_
20×18	20.000×18.000	2.07	15.00	14.49	
600×150	609.6×168.3	300	432	384	_
24×6	24.000×6.625	2.07	17.01	15.12	
600×200	609.6×219.1	300	432	384	_
24×8	24.000×8.625	2.07	17.01	15.12	
600×250	609.6×273.0	300	432	384	_
24×10	24.000×10.750	2.07	17.01	15.12	
600×300	609.6×323.9	300	432	397	
24×12	24.000×12.750	2.07	17.01	15.63	_
600×350	609.6×355.6	300	432	406	
24×14 600×400	24.000×14.000 609.6×406.4	2.07	17.01 432	15.98 406	
24×16 600×450	24.000×16.000 609.6×457.2	2.07	17.01 432	15.98 419	
24×18	24.000 × 18.000	2.07	17.01	16.50	
600×500	609.6×508.0	300	432	432	_
24×20	24.000×20.000	2.07	17.01	17.01	


Segmental sizes are made of carbon steel pipe or fabricated from wrought carbon steel. Contact manufacturer for details.



Reducing Tee with Female Thread







Nominal	Pipe	Working	Dimensions	Dimensions	Certificate
Size	O.D	Pressure	L 1	L 2	
mm/in	mm/in	PSI/MPa	mm/in	mm/in	
50×25	60.3×33.7	500	70	70	UL FM
2×1	2.375×1.315	3.45	2.75	2.75	
50×32	60.3×42.4	500	70	70	_
2×1¼	2.375×1.660	3.45	2.75	2.75	
50×40	60.3×48.3	500	70	70	UL FM
2×1½	2.375×1.900	3.45	2.75	2.75	
50×50×65	60.3×60.3×76.1	300	66	76	
2×2×2½	2.375×2.375×3.000	2.07	2.59	2.99	
50×50×80	60.3×60.3×88.9	300	70	80	
2×2×3	2.375×2.375×3.500	2.07	2.755	3.149	
65×25	73.0×33.7	500	76	76	UL FM
2½×1	2.875×1.315	3.45	3.00	3.00	
65×40	73.0×48.3	300	76	76	_
2½×1½	2.875×1.900	2.07	3.00	3.00	
65×32	73.0×42.4	500	76	76	UL FM
2½×1¼	2.875×1.660	3.45	3.00	3.00	
65×25	76.1×33.7	500	76	76	UL FM
2½×1	3.000×1.315	3.45	3.00	3.00	
65×32	76.1×42.4	500	76	76	UL FM
2½×1¼	3.000×1.660	3.45	3.00	3.00	
65×40	76.1×48.3	500	76	76	UL FM
2½×1½	3.000×1.900	3.45	3.00	3.00	
65×50	76.1×60.3	500	76	76	UL FM
2½×2	3.000×2.375	3.45	3.00	3.00	
80×25	88.9×33.7	500	85.5	85.5	UL FM
3×1	3.500×1.315	3.45	3.37	3.37	
80×32	88.9×42.4	500	85.5	85.5	UL FM
3×1¼	3.500×1.660	3.45	3.37	3.37	
80×40	88.9×48.3	500	85.5	85.5	UL FM
3×1½	3.500×1.900	3.45	3.37	3.37	
80×50	88.9×60.3	500	85.5	85.5	UL FM
3×2	3.500×2.375	3.45	3.37	3.37	
80×65	88.9×76.1	500	85.5	85.5	UL FM
3×2½	3.500×3.000	3.45	3.37	3.37	
100×65	108.0×76.1	300	100	96	UL FM
4×2½	4.250×3.000	2.07	3.94	3.78	
100×80	108.0 × 88.9	300	100	96	UL FM
4×3	4.250 × 3.500	2.07	3.94	3.78	
100×65	114.3×76.1	300	100	96	UL FM
4×2½	4.500×3.000	2.07	3.94	3.78	
100×80	114.3×88.9	300	100	96	UL FM
4×3	4.500×3.500	2.07	3.94	3.78	
200×50	219.1×60.3	300	175	175	FM
8×2	8.625×2.375	2.07	6.89	6.89	
200×65	219.1×76.1	300	175	175	FM
8×2½	8.625×3.000	2.07	6.89	6.89	
200×80	219.1×88.9	300	175	175	FM
8×3	8.625×3.500	2.07	6.89	6.89	







131R

Reducing Tee with Female Thread








Nominal	Pipe	Working	Dimensions	Dimensions	Certificate
Size	O.D	Pressure	L 1	L 2	
mm/in	mm/in	PSI/MPa	mm/in	mm/in	
100×25	114.3×33.7	300	76	88	UL FM
4×1	4.500×1.315	2.07	2.99	3.47	
100×32	114.3×42.4	300	76	88	UL FM
4×1¼	4.500×1.660	2.07	2.99	3.47	
100×40	114.3×48.3	300	85	91	UL FM
4×1½	4.500×1.900	2.07	3.35	3.58	
100×50	108.0×60.3	300	85	91	UL FM
4×2	4.250×2.375	2.07	3.35	3.58	
100×50	114.3×60.3	300	85	91	UL FM
4×2	4.500×2.375	2.07	3.35	3.58	
125×50	133.0×60.3	300	86	106	UL FM
5×2	5.250×2.375	2.07	3.39	4.17	
125×65	133.0×76.1	300	102	111	UL FM
5×2½	5.250×3.000	2.07	4.02	4.37	
125×80	133.0×88.9	300	102	111	UL FM
5×3	5.250×3.500	2.07	4.02	4.37	
125×25	139.7×33.7	300	78	103	UL FM
5×1	5.500×1.315	2.07	3.07	4.06	
125×32	139.7×42.4	300	78	103	UL FM
5×1¼	5.500×1.660	2.07	3.07	4.06	
125×40	139.7×48.3	300	86	106	UL FM
5×1½	5.500×1.900	2.07	3.39	4.17	
125×50	139.7×60.3	300	86	106	UL FM
5×2	5.500×2.375	2.07	3.39	4.17	
125×65	139.7×76.1	300	102	111	UL FM
5×2½	5.500×3.000	2.07	4.02	4.37	
125×80	139.7×88.9	300	102	111	UL FM
5×3	5.500×3.500	2.07	4.02	4.37	
150×60	159.0×60.3	300	92	124	UL FM
6×2	6.250×2.375	2.07	3.62	4.88	
150×65	159.0×76.1	300	107	129	UL FM
6×2½	6.250×3.000	2.07	4.21	5.08	
150×80	159.0 × 88.9	300	107	129	UL FM
6×3	6.25 × 03.500	2.07	4.21	5.08	
150×25	165.1×33.7	300	83	121	UL FM
6×1	6.500×1.315	2.07	3.27	4.76	
150×32	165.1×42.4	300	83	121	UL FM
6×1¼	6.500×1.660	2.07	3.27	4.76	
150×40	165.1×48.3	300	92	124	UL FM
6×1½	6.500×1.900	2.07	3.62	4.88	
150×50	165.1×60.3	300	92	124	UL FM
6×2	6.500×2.375	2.07	3.62	4.88	
150×65	165.1×76.1	300	107	129	UL FM
6×2½	6.500×3.000	2.07	4,21	5.08	
150×80	165.1×88.9	300	107	129	UL FM
6×3	6.500×3.500	2.07	4.21	5.08	
150×50	168.3×60.3	300	92	124	UL FM
6×2	6.625×2.375	2.07	3.62	4.88	
150×65	168.3×76.1	300	107	129	UL FM
6×2½	6.625×3.000	2.07	4.21	5.08	
150×80	168.3×88.9	300	107	129	_
6×3	6.625×3.500	2.07	4.21	5.08	

180

Cross







Nominal	Pipe	Working	Dimensions	Certificate
Size	O.D	Pressure	L	
mm/in	mm/in	PSI/MPa	mm/in	
32	42.4	500	70	UL FM VdS LPCB
1¼	1.660	3.45	2.75	
40	48.3	500	70	UL FM VdS LPCB
1½	1.900	3.45	2.75	
50	60.3	500	70	UL FM VdS LPCB
2	2.375	3.45	2.75	
65	73.0	500	76	UL FM
2½	2.875	3.45	3.00	
65	76.1	500	76	UL FM VdS LPCB
2½	3.000	3.45	3.00	
80	88.9	500	85.5	UL FM VdS LPCB
3	3.500	3.45	3.37	
100	108.0	500	101	UL FM
4	4.250	3.45	3.98	
100	114.3	500	101	UL FM VdS LPCB
4	4.500	3.45	3.98	
125	139.7	500	124	UL FM VdS LPCB
5	5.500	3.45	4.88	
125	141.3	500	124	UL FM
5	5.563	3.45	4.88	
150	159.0	500	140	UL FM
6	6.250	3.45	5.50	
150	165.1	500	140	UL FM LPCB
6	6.500	3.45	5.50	
150	168.3	500	140	UL FM VdS LPCB
6	6.625	3.45	5.50	
200	219.1	500	175	UL FM VdS LPCB
8	8.625	3.45	6.89	
250	273.0	500	229	UL FM VdS
10	10.750	3.45	9.00	
300	323.9	500	254	UL FM VdS
12	12.750	3.45	10.00	
350	355.6	300	279	
14	14.000	2.07	10.98	
350	377.0	300	279	_
14	14.84	2.07	10.98	
400	406.4	300	305	_
16	16.000	2.07	12.01	
450	457.2	300	343	_
18	18.000	2.07	13.5	
500	508.0	300	381	_
20	20.000	2.07	15.00	
600	609.6	300	432	_
24	24.000	2.07	17.01	


Segmental sizes are made of carbon steel pipe or fabricated from wrought carbon steel. Contact manufacturer for details.



## 180R Reducing Cross








Nominal	Pipe	Working	Dimensions	Dimensions	Certificate
Size	O.D	Pressure	L 1	L 2	
mm/in	mm/in	PSI/MPa	mm/in	mm/in	
65×50	76.1×60.3	500	76	76	
2½×2	3.000×2.375	3.45	3.00	3.00	
80×50	88.9×60.3	500	85.5	85.5	UL FM
3×2	3.500×2.375	3.45	3.37	3.37	
100×50 4×2	114.3×60.3 4.500×2.375	500 3.45	5 3.98 3.98		UL FM
100×80	114.3×88.9	500	101	101	UL FM
4×3	4.500×3.500	3.45	3.98	3.98	
125×100	139.7×114.3	500	124	124	UL FM
5×4	5.500×4.500	3.45	4.88	4.88	
159×108	159.0×108.0 6.250×4.250	500 3.45	124 4.88	124 5.50	UL FM
150×50	165.1×60.3	500	140	140	UL FM
6×2	6.500×2.375	3.45	5.50	5.50	
150×65	165.1×76.1	500	140	140	UL FM
6×2½	6.500×3.000	3.45	5.50	5.50	
150×80	165.1×88.9	500	140	140	UL FM
6×3	6.500×3.500	3.45	5.50	5.50	
150×100	165.1×114.3	500	140	140	UL FM
6×4	6.500×4.500	3.45	5.50	5.50	
150×50	168×60.3	500	140	140	UL FM
6×2	6.625×2.375	3.45	5.50	5.50	
200×50	219.1×60.3	500	197	197	UL FM
8×2	8.625×2.375	3.45	7.75	7.75	
200×100	219.1×114.3	500	175	175	UL FM
8×4	8.625×4.500	3.45	6.89	6.89	
200×125	219.1×139.7	300	175	175	UL FM
8×5	8.625×5.500	2.07	6.89	6.89	
200×150	219.1×159.0	300	175	175	UL FM
8×6	8.625×6.250	2.07	6.89	6.89	
200×150	219.1×165.1	300	175	175	ULFM
8×6	8.625×6.500	2.07	6.89	6.89	

# 181 Reducing Cross with Female Thread







Nominal	Pipe	Working	Dimensions	Dimensions	Certificate
Size	O.D	Pressure	L 1	L 2	
mm/in	mm/in	PSI/MPa	mm/in	mm/in	
65×50	76.1×60.3	300	76	76	_
2½×2	3.000×2.375	2.07	3.00	3.00	
80×32	88.9×42.4	300	108 108		_
3×1¼	3.500×1.660	2.07	4.25 4.25		
80×40	88.9×48.3	300	85.5	85.5	_
3×1½	3.500×1.900	2.07	3.37	3.37	
80×50	88.9×60.3	300	85.5	85.5	_
3×2	3.500×2.375	2.07	3.37	3.37	
100×25 4×1	114.3×33.7 4.500×1.315	300 76 88		UL FM	
100×32	114.3×42.4	300	76	88	UL FM
4×1¼	4.500×1.660	2.07	2.99	3.47	
100×40	114.3×48.3	300	85	91	UL FM
4×1½	4.500×1.900	2.07	3.35	3.58	
100×50	114.3×60.3	300	85	91	UL FM
4×2	4.500×2.375	2.07	3.35	3.58	
100×65	114.3×76.1	300	101	96	_
4×2½	4.500×3.000	2.07	3.98	3.78	
100×80	114.3×88.9	300	101	96	_
4×3	4.500×3.500	2.07	3.98	3.78	
150×32	165.1×42.4	300	92	124	_
6×1¼	6.500×1.660	2.07	3.62	4.88	
150×40	165.1×48.3	300	92	124	_
6×1½	6.500×1.900	2.07	3.62	4.88	
150×50	165.1×60.3	300	92	124	UL FM
6×2	6.500×2.375	2.07	3.62	4.88	
150×65	165.1X 76.1	300	140	140	_
6×2½	6.500×3.000	2.07	5.50	5.50	
150×80	165.1×88.9	300	140	140	_
6×3	6.500×3.500	2.07	5.50	5.50	
200×80	219.1×88.9	300	175	175	_
8×3	8.625×3.500	2.07	6.89	6.89	

# 3L U-Bolt Mechanical Tee








				Dimensions			
Nominal Size mm/in	Hole Dia mm/in +1.6,0/+0.063,0	Working Pressure PSI/MPa	A B		C mm/in	U Bolt Size mm/in	Certificate
32X15	30	300	54.4	88.9	57.2	3/8X73	UL FM VdS
11/4X1/2	1.18	2.07	2.14	3.50	2.25	M10X73	
32X20	30	300	54.4	88.9	57.2	3/8X73	UL FM VdS
11/4X3/4	1.18	2.07	2.14	3.50	2.25	M10X73	
32X25	30	300	57.7	88.9	57.2	3/8X73	UL FM VdS
1¼X1	1.18	2.07	2.27	3.50	2.25	M10X73	
40X15	30	300	57.7	88.9	57.2	3/8X73	UL FM VdS
1½X1/2	1.18	2.07	2.27	3.50	2.25	M10X73	
40X20	30	300	57.7	88.9	57.2	3/8X73	UL FM VdS
1½X3/4	1.18	2.07	2.27	3.50	2.25	M10X73	
40X25	30	300	60.8	88.9	57.2	3/8X73	UL FM VdS
11/4X1	1.18	2.07	2.39	3.50	2.25	M10X73	
50X15	30	300	63.3	95.3	57.2	3/8X90	UL FM VdS
2X1/2	1.18	2.07	2.49	3.75	2.25	M10X90	
50X20	30	300	63.3	95.3	57.2	3/8X90	UL FM VdS
2X3/4	1.18	2.07	2.49	3.75	2.25	M10X90	
50X25	30	300	66.6	95.3	57.2	3/8X90	UL FM VdS
2X1	1.18	2.07	2.62	3.75	2.25	M10X90	
50X32 2X11/4	45 1.75	300 2.07	66.6 2.62	4.72 120	3.00 76	1/2X52	_
65X15	30	300	69.9	108.0	57.2	3/8X105	UL FM
2½X1/2	1.18	2.07	2.75	4.25	2.250	M10X105	
65X20	30	300	69.9	108.0	57.2	3/8X105	UL FM
21/2X3/4	1.18	2.07	2.75	4.25	2.250	M10X105	
65X25	30	300	73.2	108.0	57.2	3/8X105	UL FM
2½X1	1.18	2.07	2.88	4.25	2.25	M10X105	
65X15	30	300	69.9	108.0	57.2	3/8X105	UL FM VdS
76.1X1/2	1.18	2.07	2.75	4.25	2.250	M10X105	
65X20	30	300	69.9	108.0	57.2	3/8X105	UL FM VdS
76.1X3/4	1.18	2.07	2.75	4.25	2.250	M10X105	
65X25	30	300	73.2	108.0	57.2	3/8X105	UL FM VdS
76.1X1	1.18	2.07	2.88	4.25	2.25	M10X105	
80X25 88.9X1	38 1.5	300 2.07	79 3.11	145 5.70	73 2.87	1/2X58	UL FM VdS



3G Mechanical Tee **Grooved Outlet** 






Nominal	Pipe	Working	Hole Dia		Dimer	nsions		D. W.O.	
Size	O.D	Pressure	mm/in	A	B	C	D	Bolt Size	Certificate
mm/in	mm/in	PSI/MPa	+1.6,0/+0.063,0	mm/in	mm/in	mm/in	mm/in	mm/in	
50×32	60.3×42.4	300	45	116	76	69.5	39	3/8×55	UL FM VdS
2×1¼	2.375×1.660	2.07	1.75	4.57	2.99	2.74	1.54	M10X57	
50×40	60.3×48.3	300	45	116	76	69.5	39	3/8×55	UL FM VdS
2×1½	2.375×1.900	2.07	1.75	4.57	2.99	2.74	1.54	M10X57	
65×25	73.0×33.7	300	38	137	71	78	49	1/2×70	_
2½×1	2.875×1.315	2.07	1.50	5.39	2.80	3.07	1.93	M12X70	
65×32	73.0×42.4	300	51	137	84.5	78	49	1/2×70	UL FM
2½×1¼	2.875×1.660	2.07	2.00	5.39	3.33	3.07	1.93	M12X70	
65×40	73.0×48.3	300	51	137	84.5	78	49	1/2×70	UL FM
2½×1½	2.875×1.900	2.07	2.00	5.39	3.33	3.07	1.93	M12X70	
65×25	76.1×33.7	300	38	137	71	78	49.5	1/2×70	UL FM VdS
76.1×1	3.000×1.315	2.07	1.50	5.39	2.80	3.07	1.95	M12X70	
65×32	76.1×42.4	300	51	137	84.5	78	49.5	1/2×70	UL FM VdS
76.1×1¼	3.000×1.660	2.07	2.00	5.39	3.33	3.07	1.95	M12X70	
65×40	76.1×48.3	300	51	137	84.5	78	49.5	1/2×70	UL FM VdS
76.1×1½	3.000×1.900	2.07	2.00	5.39	3.33	3.07	1.95	M12X70	
80×25	88.9×33.7	300	38	152	72.5	84.5	56.5	1/2×75	UL FM VdS
3×1	3.500×1.315	2.07	1.50	5.98	2.85	3.33	2.22	M12X76	
80×32	88.9×42.4	300	51	152	85.5	84.5	56.5	1/2×75	UL FM VdS
3×1¼	3.500×1.660	2.07	2.00	5.98	3.37	3.33	2.22	M12X76	
80×40	88.9×48.3	300	51	152	85.5	84.5	56.5	1/2×75	UL FM VdS
3×1½	3.500×1.900	2.07	2.00	5.98	3.37	3.33	2.22	M12X76	
80×50 3×2	88.9×60.3 3.500×2.375	300 2.07	64 2.50	152 5.98	98 3.86	84.5 3.33	56.5 2.22	1/2×75	UL FM VdS
100×25 4×1	114.3×33.7 4.500×1.315	300 2.07	38 1.50	188 7.40	78.4 3.09	102 4.02	70 2.76	M12X76 1/2×75 M12X76	UL FM VdS
100×32	114.3X42.4	300	51	188	89	102	70	1/2×75	UL FM VdS
4×1¼ 100×40	4.500×1.660 114.3×48.3	300	2.00 51	7.40	3.50 89	102	2.76 70	M12X76 1/2×75	UL FM VdS
4×1½	4.500×1.900	2.07	2.00	7.40	3.50	4.02	2.76	M12X76	UL FM VdS
100×50	114.3×60.3	300	64	188	104.5	102	70	1/2×75	
4×2	4.500×2.375	2.07	2.5	7.40	4.11	4.02	2.76	M12X76	UL FM
100×65	114.3×73.0	300	70	188	104.5	102	70	1/2×75	
4×2½	4.500×2.875	2.07	2.75	7.40	4.11	4.02	2.76	M12X76	VdS LPCB
100×65	114.3×76.1	300	70	188	104.5	102	70	1/2×75	
4×76.1 100×80	4.500×3.000 114.3×88.9	2.07 300	2.75 89	7.40	4.11 128	4.02 102	2.76 70	M12X76 1/2×75	UL FM
4×3	4.500×3.500	2.07	3.50	7.40	5.03	4.02	2.76	M12X76	VdS LPCB
125×32	139.7×42.4	300	51	221.5	95	118	84	5/8×85	
139.7×1¼ 125×40	5.500×1.660 139.7×48.3	2.07 300	2.00	8.72 221.5	3.74 95	4.65 118	3.31 84	M16X85 5/8×85	
139.7×1½ 125×50	5.500×1.900 139.7×60.3	2.07	2.00	8.72 221.5	3.74 112.5	4.65	3.31	M16X85 5/8×85	UL FM
139.7×2	5.500×2.375	2.07	2.5	8.72	4.43	4.65	3.31	M16X85	UL FM VdS
125×65	139.7×76.1	300	70	221.5	112.5	118	84	5/8×85	VdS LPCB
139.7×76.1	5.500×3.000	2.07	2.75	8.72	4.43	4.65	3.31	M16X85	
125×80	139.7×88.9	300	89	221.5	132	118	84	5/8×85	UL FM
139.7×3	5.500×3.500	2.07	3.50	8.720	5.20	4.65	3.31	M16X85	VdS LPCB
125×100	139.7×114.3	300	114	221.5	160	125	84	5/8×85	UL FM
139.7×4	5.500×4.500	2.07	4.50	8.720	6.30	4.92	3.31	M16X85	VdS LPCB
150×50	159.1×60.3	300	64	244	112.5	125	94	5/8×105	
159.0×2	6.250×2.375	2.07	2.5	9.60	4.43	4.92	3.70	M16X108	
150×100	159.1×108.0	300	114	244	154	133	94	5/8×105	UL FM
159.0×108.0	6.250×4.250	2.07	4.50	9.60	6.06	5.24	3.70	M16X108	
150×100	159.1×114.3	300	114	244	159	125	94	5/8×105	UL FM
159.0×4	6.250×4.500	2.07	4.50	9.60	6.26	4.92	3.70	M16X108	
150×50	165.1×60.3	300	64	244	112.5	127	97.5	5/8×105	UL FM
165.1×2	6.500×2.375	2.07	2.5	9.60	4.43	5.00	3.84	M16X108	
150×65	165.1×76.1	300	70	244	112.5	130	97.5	5/8×105	UL FM LPCB
165.1×76.1	6.500×3.000	2.07	2.75	9.60	4.43	5.12	3.84	M16X108	
150×80	165.1×88.9	300	89	244	132	130	97.5	5/8×105	UL FM LPCB
6½0.D×3	6.500×3.500	2.07	3.50	9.60	5.20	5.12	3.84	M16X108	
150×100	165.1×114.3	300	114	244	154	135	97.5	5/8×105	UL FM LPCB
6½0.D×4	6.500×4.500	2.07	4.50	9.60	6.06	5.32	3.84	M16X108	
150×40	168.3×48.3	300	51	247	95	128	98.5	5/8×105	UL FM VdS
6×1½	6.500×1.900	2.07	2.00	9.72	3.74	5.04	3.88	M16X108	
150×50	168.3×60.3	300	64	247	114	134	98.5	5/8×105	UL FM VdS
6×2	6.625×2.375	2.07	2.5	9.72	4.49	5.28	3.88	M16X108	

#### 3G Mechanical Tee **Grooved Outlet**








Nominal	Pipe	Working	Hole Dia		Dimer	nsions		Bolt Size	
Size mm/in	O.D mm/in	Pressure PSI/MPa	mm/in +1.6,0/+0.063,0	A mm/in	B mm/in	C mm/in	D mm/in	mm/in	Certificate
150×65	168.3×73.0	300	70	247	112.5	135	98.5	5/8×105	UL FM
6×2½	6.625×2.875	2.07	2.75	9.72	4.43	5.32	3.88	M16X108	
150×65	168.3×76.1	300	70	247	112.5	135	98.5	5/8×105	VdS LPCB
6×2½	6.625×3.000	2.07	2.75	9.72	4.43	5.32	3.88	M16X108	
150×80	168.3×88.9	300	89	247	132	136.5	98.5	5/8×105	UL FM
6×3	6.625×3.500	2.07	3.50	9.72	5.20	5.37	3.88	M16X108	VdS LPCB
150×100	168.3×114.3	300	114	247	160	138	98.5	5/8×105	UL FM
6×4	6.625×4.500	2.07	4.50	9.72	6.30	5.43	3.88	M16X108	VdS LPCB
200×50	219.1×60.3	300	64	320	118	158	125	3/4 × 115	UL FM VdS
8×2	8.625×2.375	2.07	2.5	12.60	4.65	6.22	4.92	M20X115	
200×65	216.3×76.1	300	70	315	117	157	122	3/4 × 115	_
8×76.1	8.516×3.000	2.07	2.75	12.40	4.61	6.18	4.80	M20X115	
200×65	219.1×73.0	300	70	320	118	158	125	3/4 × 115	UL FM
8×21/2	8.625×2.875	2.07	2.75	12.60	4.65	6.22	4.92	M20X115	VdS LPCB
200×65	219.1×76.1	300	70	320	118	158	125	3/4 × 115	UL FM
8×76.1	8.625×3.000	2.07	2.75	12.60	4.65	6.22	4.92	M20X115	VdS LPCB
200×80	219.1×88.9	300	89	320	136.5	161	125	3/4 × 115	UL FM
8×3	8.625×3.500	2.07	3.50	12.60	5.37	6.34	4.92	M20X115	VdS LPCB
200×100	219.1×108.0	300	114	320	162	161	125	3/4 × 115	UL FM
8×4	8.625×4.250	2.07	4.50	12.60	6.38	6.34	4.92	M20X115	
200×100	219.1×114.3	300	114	320	162	161	125	3/4×115	UL FM
8×4	8.625×4.500	2.07	4.50	12.60	6.38	6.34	4.92	M20X115	VdS LPCB
250×65	273.0×76.1	300	70	376	118	189	155	3/4×120	
10×2½	10.75×3.000	2.07	2.75	14.80	4.65	7.44	6.10	M20X115	
250×80	273.0×88.9	300	89	376	136.5	189	155	3/4×120	_
10×3	10.75×3.500	2.07	3.50	14.80	5.37	7.44	6.10	M20X115	
250×100	273.0×108	300	114	376	164	189	155	3/4×120	UL FM
10×4	10.75×4.250	2.07	4.50	14.80	6.46	7.44	6.10	M20X115	
250×100	273.0×114.3	300	114	376	164	189	155	3/4×120	UL FM VdS
10×4	10.75×4.500	2.07	4.50	14.80	6.46	7.44	6.10	M20X115	

# 3GS

Light-duty Mechanical Tee **Grooved Outlet** 







Nominal	Pipe	Working	Hole Dia		Dimer	nsions		Bolt Size	
Size mm/in	O.D mm/in	Pressure PSI/MPa	mm/in +1.6,0/+0.063,0	A mm/in	B mm/in	C mm/in	D mm/in	mm/in	Certificate
80×25	88.9×33.7	365	38	150	71.0	84	55.5	1/2×75	UL FM
3×1	3.500×1.315	2.52	1.50	5.91	2.80	3.31	2.19	M12X76	
80×32	88.9×42.4	365	51	150	84.5	84	55.5	1/2×75	UL FM
3×1¼	3.500×1.660	2.52	2.00	5.91	3.33	3.31	2.19	M12X76	
80×40	88.9×48.3	365	51	150	84.5	84	55.5	1/2×75	UL FM
3×1½	3.500×1.900	2.52	2.00	5.91	3.33	3.31	2.19	M12X76	
80×50	88.9×60.3	365	64	150	98	84	55.5	1/2×75	UL FM
3×2	3.500×2.375	2.52	2.50	5.91	3.86	3.31	2.19	M12X76	
100×25	114.3×33.7	300	38	178	77.5	98	67.5	1/2×75	UL FM
4×1	4.500×1.315	2.07	1.50	7.01	3.05	3.86	2.66	M12X76	
100×40	114.3×48.3	300	51	178	88	98	67.5	1/2×75	UL FM
4×1½	4.500×1.900	2.07	2.00	7.01	3.46	3.86	2.66	M12X76	
100×50	114.3×60.3	300	64	178	103.5	98	67.5	1/2×75	UL FM
4×2	4.500×2.375	2.07	2.50	7.01	4.07	3.86	2.66	M12X76	
100×65	114.3×73.0	300	70	178	103.5	98	67.5	1/2×75	UL FM
4×2½	4.500×2.875	2.07	2.75	7.01	4.07	3.86	2.66	M12X76	
100×65	114.3×76.1	300	70	178	103.5	98	67.5	1/2×75	UL FM
4×76.1	4.500×3.000	2.07	2.75	7.01	4.07	3.86	2.66	M12X76	
100×80	114.3×88.9	300	89	178	124	98	67.5	1/2×75	UL FM
4×3	4.500×3.500	2.07	3.50	7.01	4.88	3.86	2.66	M12X76	
































Light-duty Mechanical Tee Grooved Outlet





Nominal	Pipe O.D	Working	Hole Dia		Dimer	nsions		Bolt Size	
Size mm/in	O.D mm/in	Pressure PSI/MPa	mm/in +1.6,0/+0.063,0	A mm/in	B mm/in	C mm/in	D mm/in	mm/in	Certificate
125×80	133.0×88.9	300	89	203	132	110	77.5	5/8×85	UL FM
133.0×3	5.250×3.500	2.07	3.50	7.99	5.12	4.33	3.05	M16X85	
125×32	139.7×42.4	300	51	210	91	113	82	5/8×85	UL FM
139.7×11/4	5.500×1.660	2.07	2.00	8.27	3.58	4.45	3.23	M16X85	
125×40	139.7×48.3	300	51	210	91	113	82	5/8×85	UL FM
139.7×11/2	5.500×1.900	2.07	2.00	8.27	3.58	4.45	3.23	M16X85	
125×50	139.7×60.3	300	64	210	110	113	82	5/8×85	UL FM
139.7×2	5.500×2.375	2.07	2.50	8.27	4.33	4.45	3.23	M16X85	
125×65	139.7×76.1	300	70	210	110	113	82	5/8×85	UL FM
139.7×76.1	5.500×3.000	2.07	2.75	8.27	4.33	4.45	3.23	M16X85	
125×80	139.7×88.9	300	89	210	130	113	82	5/8×85	UL FM
139.7×3	5.500×3.500	2.07	3.50	8.27	5.12	4.45	3.23	M16X85	
125×6	139.7×114.3	175	114	210	153	115	82	5/8×85	UL FM
139.7×4	5.500×4.500	1.21	4.50	8.27	6.02	4.52	3.23	M16X85	
150×65	159.1×76.1	300	70	227	110	122.5	91	5/8×105	UL FM
159.0×76.1	6.250×3.000	2.07	2.75	8.94	4.33	4.83	3.58	M16X108	
150×80	159.1×88.9	300	89	227	130	122.5	91	5/8×105	UL FM
159.0×88.9	6.250×3.500	2.07	3.50	8.94	5.11	4.83	3.58	M16X108	
150×100	159.1×108.0	300	114	227	155	122.5	91	5/8×105	UL FM
159.0×108.0	6.250×4.250	2.07	4.50	8.94	6.10	4.83	3.58	M16X108	
150×100	159.1×114.3	300	114	227	155	122.5	91	5/8×105	UL FM
159.0×4	6.250×4.500	2.07	4.50	8.94	6.10	4.83	3.58	M16X108	
150×32	165.1×42.4	300	51	235	92.5	124.5	94.5	5/8×105	UL FM
165.1×11/4	6.500×1.900	2.07	2.00	9.25	3.64	4.90	3.72	M16X108	
150×50	165.1×60.3	300	64	235	110	124.5	94.5	5/8×105	UL FM
165.1×2	6.500×2.375	2.07	2.50	9.25	4.33	4.90	3.72	M16X108	
150×65	165.1×76.1	300	70	235	110	124.5	94.5	5/8×105	UL FM
165.1×76.1	6.500×3.000	2.07	2.75	9.25	4.33	4.90	3.72	M16X108	
150×80	165.1×88.9	300	89	235	130	124.5	94.5	5/8×105	UL FM
165.1×3	6.500×3.500	2.07	3.50	9.25	5.12	4.90	3.72	M16X108	
150×100	165.1×108	300	114	235	155	126	94.5	5/8×105	_
165.1×4	6.500×4.250	2.07	4.50	9.25	6.10	4.96	3.72	M16X108	
150×100	165.1×114.3	300	114	235	155	126	94.5	5/8×105	UL FM
165.1×4	6.500×4.500	2.07	4.50	9.25	6.10	4.96	3.72	M16X108	
150×32	168.3×42.4	300	51	240	92.5	126	96.5	5/8×105	UL FM
6×1¼	6.500×1.660	2.07	2.00	9.45	3.64	4.96	3.80	M16X108	
150×40	168.3×48.3	300	51	240	92.5	126	96.5	5/8×105	UL FM
6×1½	6.500×1.900	2.07	2.00	9.45	3.64	4.96	3.80	M16X108	
150×50	168.3×60.3	300	64	240	110	126	96.5	5/8×105	UL FM
6×2	6.625×2.375	2.07	2.50	9.45	4.33	4.96	3.80	M16X108	
150×65	168.3×73.0	300	70	240	110	126	96.5	5/8×105	UL FM
6×2½	6.625×2.875	2.07	2.75	9.45	4.33	4.96	3.80	M16X108	
150×65	168.3×76.1	300	70	240	110	126	96.5	5/8×105	UL FM
6×76.1	6.625×3	2.07	2.75	9.45	4.33	4.96	3.80	M16X108	
150×80	168.3×88.9	300	89	240	130	126	96.5	5/8×105	UL FM
6×3	6.625×3.500	2.07	3.50	9.45	5.12	4.96	3.80	M16X108	
150×100	168.3×114.3	300	114	240	155	128	96.5	5/8×105	UL FM
6×4	6.625×4.500	2.07	4.50	9.45	6.10	5.04	3.80	M16X108	
200×50	219.1×60.3	300	64	300	117	155	123	5/8×105	UL FM
8×2	8.625×2.375	2.07	2.50	11.81	4.60	6.10	4.84	M16X108	
200×65	219.1×73	300	70	300	117	155	123	5/8×105	UL FM
8×2½	8.625×2.875	2.07	2.75	11.81	4.60	6.10	4.84	M16X108	
200×65	219.1×76.1	300	70	300	117	155	123	5/8×105	UL FM
8×76.1	8.625×3.000	2.07	2.75	11.81	4.60	6.10	4.84	M16X108	
200×80	219.1×88.9	300	89	300	135.5	155	123	5/8×105	UL FM
8×3	8.625×3.500	2.07	3.50	11.81	5.33	6.10	4.84	M16X108	
200×100	219.1×114.3	300	114	300	164	160	123	5/8×105	UL FM
8×4	8.625×4.500	2.07	4.50	11.81	6.46	6.30	4.84	M16X108	

# Mechanical Tee **Threaded Outlet**







Nominal	Pipe	Working	rking Hole Dia Dimensions					D. W. O.	
Size mm/in	O.D mm/in	Pressure PSI/MPa	mm/in +1.6,0/+0.063,0	A mm/in	B mm/in	C mm/in	D mm/in	Bolt Size mm/in	Certificate
25X10 1X3/8	33.7X17.2 1.315X0.677	300 2.07	23.5 0.92	86 3.38	46 1.81	26 1.02	24.5 0.96	M8X30	_
25X15 1X1/2	33.7X21.3 1.315X0.825	300 2.07	23.5 0.92	86 3.38	46 1.81	26 1.02	24.5 0.96	M8X30	VdS
25X20 1X3/4	33.7X26.9 1.315X1.050	300 2.07	23.5 0.92	86 3.38	52 2.05	41 1.61	24.5 0.96	M8X30	VdS
25X25 1X1	33.7X33.7 1.315X1.315	300 2.07	23.5 0.92	86 3.38	57 2.24	45 1.77	24.5 0.96	M8X30	VdS
32X10 11/4X3/8	42.4X17.2 1.660X0.677	300 2.07	30 1.18	95.5 3.76	53 2.09	32 1.26	29 1.14	M10X35	_
32X15 11/4X1/2	42.4X21.3 1.660X0.825	300 2.07	30 1,18	95.5 3.76	57 2.24	32 1.26	29 1.14	M10X35	VdS
32X20 11/4X3/4	42.4X26.9 1.660X1.050	300 2.07	30 1,18	95.5 3.76	57 2.24	44 1.73	29 1.14	M10X35	VdS
32X25 11/4X1	42.4X33.7 1.660X1.315	300 2.07	30 1,18	95.5 3.76	57 2.24	53 2.09	29	M10X35	VdS
40X10 11/2X3/8	48.3X17.2 1.900X0.677	300 2.07	30 1,18	101.5 3.99	53 2.09	34 1.34	32.5 1.28	M10X35	
40X15 11/2X1/2	48.3X21.3 1.900X0.825	300 2.07	30 1.18	101.5 3.99	57 2.24	35.5 1.40	32.5 1.28	M10X35	VdS
40X20 11/2X3/4	48.3X26.9 1.900X1.050	300 2.07	30 1.18	101.5 3.99	57 2.24	47.5 1.87	32.5 1.28	M10X35	VdS
40X25	48.3X33.7	300	30	101.5	57	56	32.5	M10X35	VdS
11/2X1 50×10	1.900X1.315 60.3×17.2	2.07 300	1.18	3.99 116	2.24 68	2.20 44	1.28	3/8×55	_
2×3/8 50×15	2.375×0.677 60.3×21.3	2.07 300	1.50 38	4.57 116	2.68 68	1.73 60	1.54 39	M10X57 3/8×55	UI FM VdS
2×½ 50×20	2.375×0.825 60.3×26.9	2.07 300	1.50 38	4.57 116	2.68 68	2.36 60	1.54	M10X57 3/8×55	UI FM VdS
2×% 50×25	2.375×1.050 60.3×33.7	2.07 300	1.50	4.57 116	2.68	2.36	1.54	M10X57 3/8×55	UL FM VdS
2×1 50×32	2.375×1.315 60.3×42.4	2.07 300	1.50 45	4.57 116	2.68 76	2.36 65	1.54	M10X57 3/8×55	
2×1% 50×40	2.375×1.660 60.3×48.3	2.07	1.75 45	4.57 116	2.99 76	2.56 65	1.54	M10X57 3/8×55	UL FM VdS
2×1½ 65×15	2.375×1.900 73.0×21.3	2.07	1.75	4.57	2.99	2.56	1.54	M10X57	UL FM VdS
2½×½ 65×20	2.875×0.825 73.0×26.9	2.07	1.50	5.39	2.76	2.67	1.93	M12X70 1/2×70	UL FM
2½×¾	2.875×1.050	2.07	1.50	5.39	2.76	2.67	1.93	M12X70	UL FM
65×25 2½×1	73.0×33.7 2.875×1.315	2.07	38 1.50	137 5.39	71 2.76	70 2.75	1.93	1/2×70 M12X70	UL FM
65×32 2½×1¼	73.0×42.4 2.875×1.660	300 2.07	51 2.00	137 5.397	84.5 3.33	73 2.87	49 1.93	1/2×70 M12X70	UL FM
65×40 2½×1½	73.0×48.3 2.875×1.900	300 2.07	51 2.00	137 5.39	84.5 3.33	73 2.87	49 1.93	1/2×70 M12X70	UL FM
65×15 76.1×½	76.1×21.3 3.000×0.825	300 2.07	38 1.50	137 5.39	71 2.80	61.5 2.42	49.5 1.95	1/2×70 M12X70	UL FM VdS
65×20 76.1×¾	76.1×26.9 3.000×1.050	300 2.07	38 1.50	137 5.39	71 2.80	68 2.67	49.5 1.95	1/2×70 M12X70	UL FM VdS
65×25 76.1×1	76.1×33.7 3.000×1.315	300 2.07	38 1.50	137 5.39	71 2.80	75 3.05	49.5 1.95	1/2×70 M12X70	UL FM VdS
65×32 76.1×1¼	76.1×42.4 3.000×1.660	300 2.07	51 2.00	137 5.39	84.5 3.33	75 3.05	49.5 1.95	1/2×70 M12X70	UL FM VdS
65×40 76.1×1½	76.1×48.3 3.000×1.900	300 2.07	51 2.00	137 5.39	84.5 3.33	75 3.05	49.5 1.95	1/2×70 M12X70	UL FM VdS
80×15 3×½	88.9×21.3 3.500×0.825	300 2.07	38 1.50	152 5.98	72.5 2.85	71.5 2.81	56.5 2.22	1/2×75 M12X76	UL FM VdS
80×20 3×¾	88.9×26.9 3.500×1.050	300 2.07	38 1.50	152 5.98	72.5 2.85	71.5 2.81	56.5 2.22	1/2×75 M12X76	UL FM VdS
80×25 3×1	88.9×33.7 3.500×1.315	300 2.07	38 1.50	152 5.98	72.5 2.85	80 3.15	56.5 2.22	1/2×75 M12X76	UL FM VdS
80×32 3×11/4	88.9×42.4 3.500×1.660	300 2.07	51 2.00	152 5.98	85.5 3.37	80 3.15	56.5 2.22	1/2×75 M12X76	UL FM VdS
80×40	88.9×48.3	300	51	152	85.5	80	56.5	1/2×75	UL FM VdS
80×50	88.9×60.3	300	64	152	98	80	56.5	1/2×75	UL FM VdS
3×1½	3.500×1.900	2.07	2.00	5.98	3.37	3.15	2.22	M12X76	



# Mechanical Tee **Threaded Outlet**









Nominal	Pipe O.D	Working	Hole Dia		Dimer	nsions		Bolt Size	
Size mm/in	O.D mm/in	Pressure PSI/MPa	mm/in +1.6,0/+0.063,0	A mm/in	B mm/in	C mm/in	D mm/in	mm/in	Certificate
100×15	108.1×21.3	300	38	172	78.5	87	64.5	1/2×75	UL FM
108.0×1/2	4.250×0.825	2.07	1.50	6.77	3.09	3.43	2.54	M12X76	
100×20	108.1×26.9	300	38	172	78.5	87	64.5	1/2×75	UL FM
108.0×3/4	4.250×1.050	2.07	1.50	6.77	3.09	3.43	2.54	M12X76	
100×25	108.1×33.7	300	38	172	78.5	87	64.5	1/2×75	UL FM
108.0×1	4.250×1.315	2.07	1.50	6.77	3.09	3.43	2.54	M12X76	
100×32	108.1×42.4	300	51	172	89	87	64.5	1/2×75	UL FM
108.0×11/4	4.250×1.660	2.07	2.00	6.77	3.50	3.43	2.54	M12X76	
100×40	108.0×48.3	300	51	172	89	87	64.5	1/2×75	UL FM
108.0×1½	4.250×1.900	2.07	2.00	6.77	3.50	3.43	2.54	M12X76	
100×50	108.0×60.3	300	64	172	106.5	92	64.5	1/2×75	UL FM
108.0×2	4.250×2.375	2.07	2.50	6.77	4.19	3.62	2.54	M12X76	
100×65	108.0×76.1	300	70	172	106.5	100	64.5	1/2×75	UL FM
108.0×76.1	4.250×3.000	2.07	2.75	6.77	4.19	3.94	2.54	M12X76	
100×15	114.3×21.3	300	38	188	78.5	90	70	1/2×75	UL FM VdS
4×½	4.500×0.825	2.07	1.50	7.40	3.09	3.54	2.76	M12X76	
100×20	114.3×26.9	300	38	188	78.5	90	70	1/2×75	UL FM VdS
4×¾	4.500×1.050	2.07	1.50	7.40	3.09	3.54	2.76	M12X76	
100×25	114.3×33.7	300	38	188	78.5	93	70	1/2×75	UL FM VdS
4×1	4.500×1.315	2.07	1.50	7.40	3.09	3.66	2.76	M12X76	
100×32	114.3×42.4	300	51	188	89	95	70	1/2×75	UL FM VdS
4×1¼	4.500×1.660	2.07	2.00	7.40	3.50	3.74	2.76	M12X76	
100×40	114.3×48.3	300	51	188	89	97	70	1/2×75	UL FM VdS
4×1½	4.500×1.900	2.07	2.00	7.40	3.50	3.82	2.76	M12X76	
100×50	114.3×60.3	300	64	188	104.5	100	70	1/2×75	UL FM VdS
4×2	4.500×2.375	2.07	2.50	7.40	4.11	3.94	2.76	M12X76	
100×65	114.3×73.0	300	70	188	104.5	102	70	1/2×7	UL FM
4×2½	4.500×2.875	2.07	2.75	7.40	4.11	4.02	2.76	M12X765	
100×65	114.3×76.1	300	70	188	104.5	102	70	1/2×75	UL FM
4×76.1	4.500×3.000	2.07	2.75	7.40	4.11	4.02	2.76	M12X76	VdS LPCB
100×80	114.3×88.9	300	89	188	128	102	70	1/2×75	UL FM
4×3	4.500×3.500	2.07	3.50	7.40	5.039	4.02	2.76	M12X76	VdS LPCB
125×32	133.0×42.4	300	51	209	93	105	77	5/8×85	UL FM
133.0×1.25	5.250×1.660	2.07	2.00	8.23	3.66	4.13	3.03	M16X85	
125×40	133.0×48.3	300	51	209	93	105	77	5/8×85	UL FM
133.0×1½	5.250×1.900	2.07	2.00	8.23	3.66	4.13	3.03	M16X85	
125×50	133.0×60.3	300	64	209	112.5	110	77	5/8×85	UL FM
133.0×2	5.250×2.375	2.07	2.50	8.23	4.43	4.33	3.03	M16X85	
125×15	139.7×21.3	300	38	221.5	78	110	84	5/8×85	UL FM VdS
139.7×1/2	5.500×0.825	2.07	1.50	8.72	3.07	4.33	3.31	M16X85	
125×20	139.7×26.9	300	38	221.5	78	110	84	5/8×85	UL FM VdS
139.7×3/4	5.500×1.050	2.07	1.50	8.72	3.07	4.33	3.31	M16X85	
125×25	139.7×33.7	300	38	221.5	78	110	84	5/8×85	UL FM VdS
139.7×1	5.500×1.315	2.07	1.50	8.72	3.07	4.33	3.31	M16X85	
125×32	139.7×42.4	300	51	221.5	95	112	84	5/8×85	UL FM VdS
139.7×11/4	5.500×1.660	2.07	2.00	8.72	3.74	4.41	3.31	M16X85	
125×40	139.7×48.3	300	51	221.5	95	112	84	5/8×85	UL FM VdS
139.7×1½	5.500×1.900	2.07	2.00	8.72	3.74	4.41	3.31	M16X85	
125×50	139.7×60.3	300	64	221.5	112.5	115	84	5/8×85	UL FM VdS
139.7×2	5.500×2.375	2.07	2.50	8.72	4.43	4.53	3.31	M16X85	
125×65	139.7×76.1	300	70	221.5	112.5	115	84	5/8×85	UL FM
139.7×76.1	5.500×3.000	2.07	2.75	8.72	4.43	4.53	3.31	M16X85	VdS LPCB
125×80	139.7×88.9	300	89	221.5	132	120	84	5/8×85	UL FM
139.7×3	5.500×3.500	2.07	3.50	8.72	5.20	4.72	3.31	M16X85	VdS LPCB
125×100	139.7×114.3	300	114	221.5	156	125	84	5/8×85	UL FM
139.7×4	5.500×4.500	2.07	4.50	8.72	6.30	4.92	3.31	M16X85	VdS LPCB
150×15	159.0×21.3	300	38	244	78	116	94	5/8×105	UL FM
159.0×1/2	6.250×0.825	2.07	1.50	9.60	3.07	4.57	3.70	M16X108	
150×25	159.0×33.7	300	38	244	78	116	94	5/8×105	UL FM
159.0×1	6.250×1.315	2.07	1.50	9.60	3.07	4.57	3.70	M16X108	
150×32	159.0×42.4	300	51	244	93	118	94	5/8×105	UL FM
159.0×1¼	6.250×1.660	2.07	2.00	9.60	3.66	4.65	3.70	M16X108	
150×40	159.0×48.3	300	51	244	93	118	94	5/8×105	UL FM
159.0×1½	6.250×1.900	2.07	2.00	9.60	3.66	4.65	3.70	M16X108	

# Mechanical Tee **Threaded Outlet**









Nominal	Pipe O.D	Working	Hole Dia		Dimer	sions		Bolt Size	
Size mm/in	O.D mm/in	Pressure PSI/MPa	mm/in +1.6,0/+0.063,0	A mm/in	B mm/in	C mm/in	D mm/in	mm/in	Certificate
150×50	159.0×60.3	300	64	244	112.5	125	94	5/8×105	UL FM
159.0×2 150×65	6.250×2.375 159.0×76.1	300	2.50 70	9.60	4.43 112.5	4.92 125	3.70 94	M16X108 5/8×105	UL FM
159.0×76.1	6.250×3.000	2.07	2.75	9.60	4.43	4.92	3.70	M16X108	UL FM
150×80	159.0×88.9	300	89	244	133	125	94	5/8×105	
159.0×3 150×100	6.250×3.500 159.1×114.3	2.07 175	3.50 114	9.60	5.20 156.5	4.92 130	3.70 94	M16X108 5/8×105	ULFM
159.0×4 150×15	6.250×4.500 165.1×21.3	1.20	4.50	9.60	6.16 78	5.12 110	3.70 97.5	M16X108 5/8×105	
165.1×½ 125×20	6.500×0.825 165.1×26.9	2.07	1.50	9.60 244	3.07 78	4.33 110	3.84 97.5	M16X108 5/8×105	UL FM
165.1×¾	6.500×1.050	2.07	1.50	9.60	3.07	4.33	3.84 97.5	M16X108	UL FM
165.1×1	6.500×1.315	2.07	1.50	9.60	3.07	4.65	3.84	M16X108	UL FM
150×32	165.1×42.4	300	51	244	93	118	97.5	5/8×105	UL FM
165.1×1¼	6.500×1.660	2.07	2.00	9.60	3.66	4.65	3.84	M16X108	
150×40	165.1×48.3	300	51	244	93	118	97.5	5/8×105	UL FM
165.1×1½	6.500×1.900	2.07	2.00	9.60	3.66	4.65	3.84	M16X108	
150×50	165.1×60.3	300	64	244	112.5	128.5	97.5	5/8×105	ULFM
165.1×2	6.500×2.375	2.07	2.50	9.60	4.43	5.43	3.84	M16X108	
150×65	165.1×76.1	300	70	244	112.5	128.5	97.5	5/8×105	UL FM LPCE
65.1×76.1	6.500×3.000	2.07	2.75	9.60	4.43	5.43	3.84	M16X108	
150×80	165.1×88.9	300	89	244	132	128.5	97.5	5/8×105	UL FM LPCE
165.1×3	6.500×3.500	2.07	3.50	9.60	5.20	5.06	3.84	M16X108	
150×100 165.1×4	165.1×114.3 6.500×4.500	225	114 4.50	244 9.60	154 6.18	135	97.5 3.84	5/8×105 M16X108	UL FM LPCE
150×32	168.3×42.4	300	51	247	95	122	98.5	5/8×105	UL FM VdS
6×1¼	6.500×1.660	2.07	2.00	9.72	3.74	4.80	3.88	M16X108	UL FM VdS
150×40	168.3×48.3	300	51	247	95	122	98.5	5/8×105	
6×1½ 150×50	6.500×1.900 168.3×60.3	2.07 300	2.00	9.72	3.74 112.5	4.80	3.88 98.5	M16X108 5/8×105	UL FM VdS
6×2	6.625×2.375	2.07	2.50	9.72	4.43	5.20	3.88	M16X108	
150×65	168.3×73.0	300	70	247	112.5	132	98.5	5/8×105	
6×2½ 150×65	6.625×2.875 168.3×76.1	2.07	2.75	9.72	4.43	5.20	3.88	M16X108 5/8×105	UL FM
6×76.1	6.625×3.000	2.07	2.75	9.72	4.43	5.20	3.88	M16X108	VdS LPCB
150×80	168.3×88.9	300	89	247	132	140	98.5	5/8×105	UL FM
6×3	6.625×3.500	2.07	3.50	9.72	5.20	5.51	3.88	M16X108	VdS LPCB
150×100	168.3×114.3	300	114	247	160	140	98.5	5/8×105	UL FM
6×4	6.625×4.500	2.07	4.50	9.72	6.30	5.51	3.88	M16X108	VdS LPCB
200×25	219.1 × 33.7	300	38	320	79.5	150	125	3/4 × 115	UL FM VdS
8×1	8.625 × 1.315	2.07	1.50	12.60	3.13	5.91	4.92	M20X115	
200×32	219.1×42.4	300	51	320	96.5	150	125	3/4 × 115	UL FM VdS
8×1¼	8.625×1.660	2.07	2.00	12.60	3.80	5.91	4.92	M20X115	
200×40	219.1×48.3	300	51	320	96.5	150	125	3/4 × 115	UL FM VdS
8×1½	8.625×1.900	2.07	2.00	12.60	3.80	5.91	4.92	M20X115	
200×50	219.1×60.3	300	64	320	117	160	125	3/4×115	UL FM VdS
8×2	8.625×2.375	2.07	2.50	12.60	4.61	6.30	4.92	M20X115	
200×65	219.1×73.0	300	70	320	118	160	125	3/4×115	UL FM
8×2½	8.625×2.875	2.07	2.75	12.60	4.65	6.30	4.92	M20X115	
200×65 8×76.1	219.1×76.1 8.625×3.000	300 2.07	70	320 12.60	118 4.65	160 6.30	125 4.92	3/4×115 M20X115	UL FM
200×80	219.1×88.9	300	2.75 89	320	136.5	160	125	3/4×115	VdS LPCB UL FM
8×3	8.625×3.500	2.07	3.50	12.60	5.37	6.30	4.92	M20X115	VdS LPCB
200×100	219.1×114.3	300	114	320	164	160	125	3/4×115	UL FM
8×4 250×40	8.625×4.500 273.0×48.3	2.07	4.50 51	12.60 376	6.46 95.5	6.30 180	4.92 155	M20X115 3/4×120	VdS LPCB
10×1½ 250×50	10.750×1.900 273.0×60.3	2.07	2.00	14.80 376	3.76	7.09	6.10	M20X115 3/4×120	UL FM
10×2	10.750×2.375	2.07	2.50	14.80	4.65	7.28	6.10	M20X115	UL FM VdS
250×65	273.0×76.1	300	70	376	118	190	155	3/4×120	UL FM VdS
10×76.1	10.750×3.000	2.07	2.75	14.80	4.65	7.48	6.10	M20X115	
250×80	273.0×88.9	300	89	376	136.5	190	155	3/4×120	UL FM VdS
10×3	10.750×3.500	2.07	3.50	14.80	5.37	7.48	6.10	M20X115	
250×100	273.0×114.3	300	114	376	164	190	155	3/4 × 120	UL FM VdS
10×4	10.750×4.500	2.07	4.50	14.80	6.46	7.48	6.10	M20X115	







# **3JS**

Light-duty Mechanical Tee Threaded Outlet







Nominal	Pipe	Working	Hole Dia		Dimer	nsions		D. # 0	
Size	O.D	Pressure	mm/in	A	B	C	D	Bolt Size	Certificate
mm/in	mm/in	PSI/MPa	+1.6,0/+0.063,0	mm/in	mm/in	mm/in	mm/in	mm/in	
80×15	88.9×21.3	300	38	150	71.0	68	55.5	1/2×75	UL FM
3×½	3.500×0.825	2.07	1.50	5.91	2.80	2.68	2.19	M12X76	
80×20	88.9×26.9	300	38	150	71.0	68	55.5	1/2×75	UL FM
3×¾	3.500×1.050	2.07	1.50	5.91	2.80	2.68	2.19	M12X76	
80×25	88.9×33.7	300	38	150	71.0	71.0	55.5	1/2×75	UL FM
3×1	3.500×1.315	2.07	1.50	5.91	2.80	2.80	2.19	M12X76	
80×32	88.9×42.4	300	51	150	84.5	74	55.5	1/2×75	UL FM
3×1¼	3.500×1.660	2.07	2.00	5.91	3.33	2.91	2.19	M12X76	
80×40	88.9×48.3	300	51	150	84.5	74	55.5	1/2×75	UL FM
3×1½	3.500×1.900	2.07	2.00	5.91	3.33	2.91	2.19	M12X76	
80×50	88.9×60.3	300	64	150	98	77	55.5	1/2×75	UL FM
3×2	3.500×2.375	2.07	2.50	5.91	3.86	3.03	2.19	M12X76	
100×15	108.1×21.3	300	38	172	77.5	85	64.5	1/2×75	UL FM
108.0×1⁄2	4.250×0.825	2.07	1.50	6.77	3.05	3.35	2.54	M12X76	
100×25	108.1×33.7	300	38	172	77.5	85	64.5	1/2×75	UL FM
108.0×1	4.250×1.315	2.07	1.50	6.77	3.05	3.35	2.54	M12X76	
100×32	108.1×42.4	300	51	172	88	85	64.5	1/2×75	UL FM
108.0×11/4	4.250×1.660	2.07	2.00	6.77	3.46	3.35	2.54	M12X76	
100×40	108.0×48.3	300	51	172	88	85	64.5	1/2×75	UL FM
108.0×1½	4.250×1.900	2.07	2.00	6.77	3.46	3.35	2.54	M12X76	
100×50	108.0×60.3	300	64	172	103.5	90.5	64.5	1/2×75	UL FM
108.0×2	4.250×2.375	2.07	2.50	6.77	4.19	3.56	2.54	M12X76	
100×65	108.0×76.1	300	70	172	103.5	97.5	64.5	1/2×75	UL FM
108.0×76.1	4.250×3.000	2.07	2.75	6.77	4.07	3.84	2.54	M12X76	
100×25	114.3×33.7	300	38	178	77.5	89.5	67.5	1/2×75	UL FM
4×1	4.500×1.315	2.07	1.50	7.01	3.05	3.52	2.66	M12X76	
100×32	114.3×42.4	300	51	178	88	89.5	67.5	1/2×75	UL FM
4×11/4	4.500×1.660	2.07	2.00	7.01	3.46	3.53	2.66	M12X76	
100×40	114.3×48.3	300	51	178	88	89.5	67.5	1/2×75	UL FM
4×1½	4.500×1.900	2.07	2.00	7.01	3.46	3.53	2.66	M12X76	
100×50	114.3×60.3	300	64	178	103.5	92	67.5	1/2×75	UL FM
4×2	4.500×2.375	2.07	2.50	7.01	4.07	3.62	2.66	M12X76	
100×65	114.3×73.0	300	70	178	103.5	98	67.5	1/2×75	UL FM
4×2½	4.500×2.875	2.07	2.75	7.01	4.07	3.86	2.66	M12X76	
100×65	114.3×76.1	300	70	178	103.5	98	67.5	1/2×75	UL FM
4×76.1	4.500×3.000	2.07	2.75	7.01	4.07	3.86	2.66	M12X76	
100×80	114.3×88.9	300	89	178	124	98	67.5	1/2×75	UL FM
4×3	4.500×3.500	2.07	3.50	7.01	4.88	3.86	2.66	M12X76	
125×25 133.0×1	133.0×33.7 5.250×1.315	300 2.07	38 1.50	203 7.99	77 3.03	98 3.86	77.5 3.05	5/8×85	UL FM
125×32 133.0×1.25	133.0×42.4 5.250×1.660	300 2.07	51 2.00	203 7.99	91 3.58	102 4.01	77.5 3.05	5/8×85	UL FM
125×40 133.0×1½	133.0×48.3 5.250×1.900	300 2.07	51 2.00	203 7.99	91 3.58	102 4.01	77.5 3.05	5/8×85	UL FM
125×50 133.0×2	133.0×60.3 5.250×2.375	300 2.07	64 2.50	203 7.99	110 4.33	105 4.13	77.5 3.05	5/8×85	UL FM
125×65 133.0×76.1	133.0×76.1 5.250×3.000	300 2.07	70 2.75	203 7.99	110 4.33	113 4.45	77.5 3.05	5/8×85	UL FM
125×80 133.0×3	133.0×88.9 5.250×3.500	300 2.07	89 3.50	203 7.99	132 5.12	110 4.33	77.5 3.05	5/8×85	UL FM
125×25	139.7×33.7	300	38	210	77	100	82	5/8×85	UL FM
139.7×1	5.500×1.315	2.07	1.50	8.27	3.03	3.94	3.23	M16X85	
125×32	139.7×42.4	300	51	210	91	105	82	5/8×85	UL FM
139.7×11/4	5.500×1.660	2.07	2.00	8.27	3.58	4.13	3.23	M16X85	
125×40	139.7×48.3	300	51	210	91	105	82	5/8×85	UL FM
139.7×1½	5.500×1.900	2.07	2.00	8.27	3.58	4.13	3.23	M16X85	
125×50	139.7×60.3	300	64	210	110	108	82	5/8×85	UL FM
139.7×2	5.500×2.375	2.07	2.50	8.27	4.33	4.25	3.23	M16X85	
125×65	139.7×76.1	300	70	210	110	115	82	5/8×85	UL FM
139.7×76.1	5.500×3.000	2.07	2.75	8.27	4.33	4.53	3.23	M16X85	
125×80	139.7×88.9	300	89	210	130	115	82	5/8×85	UL FM
139.7×3	5.500×3.500	2.07	3.50	8.27	5.12	4.53	3.23	M16X85	
125×100	139.7×114.3	300	114	210	153	118	82	5/8×85	UL FM
139.7×4	5.500×4.500	2.07	4.50	8.27	6.02	4.65	3.23	M16X85	

# **3JS**

Light-duty Mechanical Tee Threaded Outlet









Nominal	Pine	Working	Hole Dia		Dimer	nsions			
Size mm/in	Pipe O.D mm/in	Pressure PSI/MPa	mm/in +1.6,0/+0.063,0	A mm/in	B mm/in	C mm/in	D mm/in	Bolt Size mm/in	Certificate
150×25	159.0×33.7	300	38	227	77	110	91	5/8×85	UL FM
159.0×1	6.250×1.315	2.07	1.50	8.94	3.03	4.33	3.58	M16X85	
150×32	159.0×42.4	300	51	227	92.5	112	91	5/8×105	UL FM
159.0×11/4	6.250×1.660	2.07	2.00	8.94	3.64	4.41	3.58	M16X108	
150×40	159.0×48.3	300	51	227	92.5	112	91	5/8×105	UL FM
159.0×1½	6.250×1.900	2.07	2.00	8.94	3.64	4.41	3.58	M16X108	
150×50	159.0×60.3	300	64	227	110	116.5	91	5/8×105	UL FM
159.0×2	6.250×2.375	2.07	2.50	8.94	4.33	4.59	3.58	M16X108	
150×65	159.0×76.1	300	70	227	110	121.5	91	5/8×105	UL FM
159.0×76.1	6.250×3.000	2.07	2.75	8.94	4.33	4.78	3.58	M16X108	
150×80	159.0×88.9	300	89	227	130	123.5	91	5/8×105	UL FM
159.0×3	6.250×3.500	2.07	3.50	8.94	5.12	4.86	3.58	M16X108	
150×100 159.0×4	159.1×114.3 6.250×4.500	300 2.07	114 4.50	227 8.94	155 6.10	127	91 3.58	5/8×105 M16X108	UL FM
150×15	165.1×21.3	300	38	235	77	115	94.5	5/8×105	UL FM
165.1×½	6.500×0.825	2.07	1.50	9.25	3.03	4.53	3.72	M16X108	
125×20	165.1×26.9	300	38	235	77	115	94.5	5/8×105	UL FM
165.1×¾	6.500×1.050	2.07	1.50	9.25	3.03	4.53	3.72	M16X108	
150×25	165.1×33.7	300	38	235	77	115	94.5	5/8×105	UL FM
165.1×1	6.500×1.315	2.07	1.50	9.25	3.03	4.53	3.72	M16X108	
150×32	165.1×42.4	300	51	235	92.5	115	94.5	5/8×105	UL FM
165.1×1¼	6.500×1.660	2.07	2.00	9.25	3.64	4.53	3.72	M16X108	
150×40	165.1×48.3	300	51	235	92.5	115	94.5	5/8×105	UL FM
165.1×1½	6.500×1.900	2.07	2.00	9.25	3.64	4.53	3.72	M16X108	
150×50	165.1×60.3	300	64	235	110	120	94.5	5/8×105	UL FM
165.1×2	6.500×2.375	2.07	2.50	9.25	4.33	4.72	3.72	M16X108	
150×65	165.1×76.1	300	70	235	110	125	94.5	5/8×105	UL FM
165.1×76.1	6.500×3.000	2.07	2.75	9.25	4.33	4.92	3.72	M16X108	
150×80 165.1×3	165.1×88.9 6.500×3.500	300 2.07	89 3.50	235 9.25	130	125 4.92	94.5 3.72	5/8×105 M16X108	UL FM
150×100 165.1×4	165.1×114.3 6.500×4.500	300 2.07	114 4.50	240 9.45	155 6.10	130	94.5	5/8×105 M16X108	UL FM
150×25	168.3×33.7	300	38	240	77	115	96.5	5/8×105	UL FM
6×1	6.500×1.315	2.07	1.50	9.45	3.03	4.53	3.80	M16X108	
150×32	168.3×42.4	300	51	240	92.5	115	96.5	5/8×105	UL FM
6×11/4	6.500×1.660	2.07	2.00	9.45	3.64	4.53	3.80	M16X108	
150×40	168.3×48.3	300	51	240	92.5	115	96.5	5/8×105	UL FM
6×1½	6.500×1.900	2.07	2.00	9.45	3.64	4.53	3.80	M16X108	
150×50	168.3×60.3	300	64	240	110	121	96.5	5/8×105	UL FM
6×2	6.625×2.375	2.07	2.50	9.45	4.33	4.76	3.80	M16X108	
150×65	168.3×73.0	300	70	240	110	127	96.5	5/8×105	UL FM
6×2½	6.625×2.875	2.07	2.75	9.45	4.33	5.00	3.80	M16X108	
150×65	168.3×76.0	300	70	240	110	127	96.5	5/8×105	_
6×2½	6.625×3.000	2.07	2.75	9.45	4.33	5.00	3.80	M16X108	
150×80	168.3×88.9	300	89	240	130	127	96.5	5/8×105	UL FM
6×3	6.625×3.500	2.07	3.50	9.45	5.12	5.00	3.80	M16X108	
150×100	168.3×114.3	300	114	240	155	130	96.5	5/8×105	UL FM
6×4	6.625×4.500	2.07	4.50	9.45	6.10	5.12	3.80	M16X108	
200×25	219.0×33.7	300	38	300	78	140	123	5/8×105	UL FM
8×1	8.625×1.315	2.07	1.50	11.81	3.07	5.51	4.84	M16X108	
200×32	219.1×42.4	300	51	300	96.5	140	123	5/8×105	UL FM
8×1¼	8.625×1.660	2.07	2.00	11.81	3.80	5.51	4.84	M16X108	
200×40	219.1×48.3	300	51	300	96.5	143	123	5/8×105	UL FM
8×1½	8.625×1.900	2.07	2.00	11.81	3.80	5.63	4.84	M16X108	
200×50	219.1×60.3	300	64	300	117	149	123	5/8×105	UL FM
8×2	8.625×2.375	2.07	2.50	11.81	4.61	5.87	4.84	M16X108	
200×65	219.1×73.0	300	70	300	117	155	123	5/8×105	UL FM
8×2½	8.625×2.875	2.07	2.75	11.81	4.61	6.10	4.84	M16X108	
200×65	219.1×76.1	300	70	300	117	155	123	5/8×105	UL FM
8×76.1	8.625×3.000	2.07	2.75	11.81	4.61	6.10	4.84	M16X108	
200×80	219.1×88.9	300	89	300	133.5	155	123	5/8×105	UL FM
8×3	8.625×3.500	2.07	3.50	11.81	5.25	6.10	4.84	M16X108	
200×100	219.1×114.3	300	114	300	164	160	123	5/8×105	UL FM
8×4	8.625×4.500	2.07	4.50	11.81	6.45	6.30	4.84	M16X108	






4G

**Mechanical Cross Grooved Outlet** 






Nominal	Pipe	Working	Hole Dia		Dime	nsions		D-W Ci
Size	O.D	Pressure	mm/in	A	B	C	D	Bolt Size
mm/in	mm/in	PSI/MPa	+1.6,0/+0.063,0	mm/in	mm/in	mm/in	mm/in	mm/in
65×32	73.0×42.4	300	51	144	84.5	75	75	1/2×70
2½×1¼	2.875×1.669	2.07	2	5.67	3.33	2.95	2.95	M12X70
65×25	76.1×33.7	300	38	137	71	78	78	1/2×70
2½×1	3.000×1.327	2.07	1.5	5.39	2.8	3.07	3.07	M12X70
65×32	76.1×42.4	300	51	137	84.5	78	78	1/2×70
2½×1¼	3.000×1.669	2.07	2	5.39	3.33	3.07	3.07	M12X70
80×25	88.9×33.7	300	38	152	72.5	84.5	84.5	1/2×75
3×1	3.500×1.327	2.07	1.5	5.98	2.85	3.33	3.33	M12X76
80×32	88.9×42.4	300	51	152	85.5	84.5	84.5	1/2×75
3×1¼	3.500×1.669	2.07	2	5.98	3.37	3.33	3.33	M12X76
80×40	88.9×48.3	300	51	152	85.5	84.5	84.5	1/2×75
3×1½	3.500×1.900	2.07	2	5.98	3.37	3.33	3.33	M12X76
100×25	114.3×33.7	300	38	188	78.4	102	102	1/2×75
4×1	4.500×1.327	2.07	1.5	7.4	3.09	4.02	4.02	M12X76
100×40	114.3×48.3	300	51	188	89	102	102	1/2×75
4×1½	4.500×1.900	2.07	2	7.4	3.5	4.02	4.02	M12X76
100×50	114.3×60.3	300	64	188	104.5	102	102	1/2×75
4×2	4.500×2.375	2.07	2.5	7.4	4.11	4.02	4.02	M12X76
125×50	139.7×60.3	300	64	221.5	112.5	118	118	5/8X85
5×2	5.500×2.375	2.07	2.5	8.72	4.43	4.65	4.65	M16X85
125×65	139.7×76.1	300	70	221.5	112.5	118	118	5/8X85
5×2½	5.500×3.000	2.07	2.75	8.72	4.43	4.65	4.65	M16X85
150×50	165.1×60.3	300	64	244	112.5	127	127	5/8X105
6×2	6.500×2.375	2.07	2.5	9.6	4.43	5	5	
150×65	165.1×76.1	300	70	244	112.5	127	127	5/8X105
6×2½	6.500×3.000	2.07	2.75	9.6	4.43	5	5	M16X108
150×80	165.1×88.9	300	89	244	132	141	141	5/8X105
6×3	6.500×3.500	2.07	3.5	9.6	5.2	5.55	5.55	M16X108
150×40	168.3×48.3	300	51	247	95	128	128	5/8X105
6×1½	6.625×1.900	2.07	2	9.72	3.74	5.04	5.04	M16X108
150×50	168.3×60.3	300	64	247	114	134	134	5/8X105
6×2	6.625×2.375	2.07	2.5	9.72	4.49	5.28	5.28	M16X108
150×65	168.3×73.0	300	70	247	115	134	134	5/8X105
6×2½	6.625×2.875	2.07	2.75	9.72	4.53	5.28	5.28	M16X108
150×80	168.3×88.9	300	89	247	132	141	141	5/8X105
6×3	6.625×3.500	2.07	3.5	9.72	5.2	5.55	5.55	M16X108
200×50	219.1×60.3	300	64	320	118	158	158	3/4X115
8×2	8.625×2.375	2.07	2.5	12.6	4.65	6.22	6.22	M20X115
200×65	219.1×76.1	300	70	320	118	158	158	3/4X115
8×2½	8.625×3.000	2.07	2.75	12.6	4.65	6.22	6.22	M20X115
200×80	219.1×88.9	300	89	320	136.5	161	161	3/4X115
8×3	8.625×3.500	2.07	3.5	12.6	5.37	6.34	6.34	M20X115
200×100	219.1×114.3	300	114	320	162	161	161	3/4X115
8×4	8.625×4.500	2.07	4.5	12.6	6.38	6.34	6.34	M20X115
250×65	273.0×76.1	300	70	376	118	189	189	3/4X120
10×2½	10.750×3.000	2.07	2.75	14.8	4.65	7.44	7.44	M20X115
250×80	273.0×88.9	300	89	376	136.5	189	189	3/4X120
10×3	10.750×3.500	2.07	3.5	14.8	5.37	7.44	7.44	M20X115
250×100	273.0×114.3	300	114	376	164	189	189	3/4X120
10×4	10.750×4.500	2.07	4.5	14.8	6.46	7.44	7.44	M20X115

# 4GS

Light-duty Mechanical Cross Grooved Outlet





Nominal	Pipe	Working	Hole Dia	Dimensions				Bolt Size
Size	O.D	Pressure	mm/in	A	B	C	D	mm/in
mm/in	mm/in	PSI/MPa	+1.6,0/+0.063,0	mm/in	mm/in	mm/in	mm/in	
80×25	88.9×33.7	300	38	150	71.0	84	84	1/2×70
3×1	3.500×1.315	2.07	1.50	5.91	2.80	3.31	3.31	M12X76
80×32	88.9×42.4	300	51	150	84.5	84	84	1/2×70
3×1¼	3.500×1.660	2.07	2.00	5.91	3.33	3.31	3.31	M12X76
80×40	88.9×48.3	300	51	150	84.5	84	84	1/2×70
3×1½	3.500×1.900	2.07	2.00	5.91	3.33	3.31	3.31	M12X76
100×25	114.3×33.7	300	38	178	77.5	98	98	1/2×70
4×1	4.500×1.315	2.07	1.50	7.01	3.05	3.86	3.86	M12X76
100×40	114.3×48.3	300	51	178	88	98	98	1/2×70
4×1½	4.500×1.900	2.07	2.00	7.01	3.46	3.86	3.86	M12X76
100×50	114.3×60.3	300	64	178	103.5	98	98	1/2×70
4×2	4.500×2.375	2.07	2.50	7.01	4.07	3.86	3.86	M12X76
125×50	139.7×60.3	300	64	210	110	113	113	5/8×85
139.7×2	5.500×2.375	2.07	2.50	8.27	4.33	4.45	4.45	M16X85
125×65	139.7×76.1	300	70	210	110	113	113	5/8×85
139.7×76.1	5.500×3.000	2.07	2.75	8.27	4.33	4.45	4.45	M16X85
150×50	165.1×60.3	300	64	235	110	124.5	124.5	5/8×105
165.1×2	6.500×2.375	2.07	2.50	9.25	4.33	4.90	4.90	M16X108
150×65	165.1×76.1	300	70	235	110	124.5	124.5	5/8×105
165.1×76.1	6.500×3.000	2.07	2.75	9.25	4.33	4.90	4.90	M16X108
150×80	165.1×88.9	300	89	235	130	124.5	124.5	5/8×105
165.1×3	6.500×3.500	2.07	3.50	9.25	5.12	4.90	4.90	M16X108
150×32	168.3×42.4	300	51	240	92.5	126	126	5/8×105
6×1¼	6.500×1.660	2.07	2.00	9.45	3.64	4.96	4.96	M16X108
150×40	168.3×48.3	300	51	240	92.5	126	126	5/8×105
6×1½	6.500×1.900	2.07	2.00	9.45	3.64	4.96	4.96	M16X108
150×50	168.3×60.3	300	64	240	110	126	126	5/8×105
6×2	6.625×2.375	2.07	2.50	9.45	4.33	4.96	4.96	M16X108
150×65	168.3×73.0	300	70	240	110	126	126	5/8×105
6×2½	6.625×2.875	2.07	2.75	9.45	4.33	4.96	4.96	M16X108
150×80	168.3×88.9	300	89	240	130	126	126	5/8×105
6×3	6.625×3.500	2.07	3.50	9.45	5.12	4.96	4.96	M16X108
200×50	219.1×60.3	300	64	300	115	155	155	5/8×105
8×2	8.625×2.375	2.07	2.50	11.81	4.53	6.10	6.10	M16X108
200×65	219.1×76.1	300	70	300	115	155	155	5/8×105
8×76.1	8.625×3.000	2.07	2.75	11.81	4.53	6.10	6.10	M16X108
200×80	219.1×88.9	300	89	300	133.5	155	155	5/8×105
8×3	8.625×3.500	2.07	3.50	11.81	5.25	6.10	6.10	M16X108
200×100	219.1×114.3	300	114	300	159.5	160	160	5/8×105
8×4	8.625×4.500	2.07	4.50	11.81	6.29	6.30	6.30	M16X108






























#### Mechanical Cross Threaded Outlet






Nominal	Pipe	Working	Hole Dia			Bolt Size		
Size	O.D	Pressure	mm/in	A	B	C	D	mm/in
mm/in	mm/in	PSI/MPa	+1.6,0/+0.063,0	mm/in	mm/in	mm/in	mm/in	
65×20	73.0×26.9	300	38	137	71	68	68	1/2×70
2½×¾	2.875×1.050	2.07	1.50	5.39	2.80	2.68	2.68	M12X70
65×25	73.0×33.7	300	38	137	71	70	70	1/2×70
2½×1	2.875×1.315	2.07	1,50	5.39	2.80	2.76	2.76	M12X70
65×32	73.0×42.4	300	51	137	84.5	73	73	1/2×70
2½×1¼	2.875×1.660	2.07	2.00	5.39	3.33	2.87	2.87	M12X70
65×15	76.1×21.3	300	38	137	71	61.5	61.5	1/2X70
2½×½	3.000×0.825	2.07	1.5	5.39	2.8	2.42	2.42	M12X70
65×20	76.1×26.9	300	38	137	71	75	75	1/2X70
2½×¾	3.000×1.059	2.07	1.5	5.39	2.8	3.05	3.05	M12X70
65×25	76.1×33.7	300	38	137	71	75	75	1/2X70
2½×1	3.000×1.327	2.07	1.5	5.39	2.8	3.05	3.05	M12X70
65×32	76.1×42.4	300	51	137	84.5	75	75	M12X70 1/2X70
2½×1¼ 80×15	3.000×1.669 88.9×21.3	2.07	2	5.39	3.33 72.5	3.05	3.05	M12X70
3×½	88.9×21.3 3.500×0.825	300 2.07	38 1.5	5.98	2.85	71.5 2.81	71.5 2.81	M12X76
80X20	88.9×26.9	300	38	152	72.5	71.5	71.5	1/2X75
3×¾	3.500×1.059	2.07	1.5	5.98	2.85	2.81	2.81	M12X76
80×25	88.9×33.7	300	38	152	72.5	80	80	1/2X75
3×1	3.500×1.327	2.07	1.5	5.98	2.85	3.15	3.15	M12X76
80×32	88.9×42.4	300	51	152	85.5	80	80	1/2X75
3×1¼	3.500×1.669	2.07	2	5.98	3.37	3.15	3.15	M12X76
80×40	88.9×48.3	300	51	152	85.5	80	80	1/2X75
3×1½	3.500×1.900	2.07	2	5.98	3.37	3.15	3.15	M12X76
100×32	108.1×42.4	300	51	172	89	87	87	1/2×75
108.0×1¼	4.250×1.660	2.07	2.00	6.77	3.50	3.43	3.43	M12X76
100×40	108.0×48.3	300	51	172	89	87	87	1/2×75
108.0×1½	4.250×1.900	2.07	2.00	6.77	3.50	3.43	3.43	M12X76
100×50	108.0×60.3	300	64	172	106.5	92	92	1/2×75
108.0×2	4.250×2.375	2.07	2.50	6.77	4.19	3.62	3.62	M12X76
100×15	114.3×21.3	300	38	188	78.5	90	90	1/2X75
4×½	4.500×0.825	2.07	1.5	7.4	3.09	3.54	3.54	M12X76
100×20	114.3×26.9	300	38	188	78.5	90	90	1/2X75
4×¾	4.500×1.059	2.07	1.5	7.4	3.09	3.54	3.54	M12X76
100×25	114.3×33.7	300	38	188	78.5	93	93	1/2X75
4×1	4.500×1.327	2.07	1.5	7.4	3.09	3.66	3.66	M12X76
100×32	114.3×42.4	300	51	188	89	95	95	1/2X75
4×1¼	4.500×1.669	2.07	2	7.4	3.5	3.74	3.74	M12X76
100×40	114.3×48.3	300	51	188	89	97	97	1/2X75
4×1½	4.500×1.900	2.07	2	7.4	3.5	3.82	3.82	M12X76
100×50	114.3×60.3	300	64	188	104.5	100	100	1/2X75\
4×2	4.500×2.375	2.07	2.5	7.4	4.11	3.94	3.94	M12X76
125×50	133.0×60.3	300	64	209	112.5	110	110	5/8×85
133.0×2	5.250×2.375	2.07	2.50	8.23	4.43	4.33	4.33	M16X85
125×25	139.7×33.7	300	38	221.5	78	110	110	5/8X85
5×1	5.500×1.327	2.07	1.5	8.72	3.07	4.33	4.33	M16X85
125×32	139.7×42.4	300	51	221.5	95	112	112	5/8X85
5×1¼	5.500×1.669	2.07	2	8.72	3.74	4.41	4.41	M16X85
125×40	139.7×48.3	300	51	221.5	95	112	112	5/8X85
5×1½	5.500×1.900	2.07	2	8.72	3.74	4.41	4.41	M16X85
125×50	139.7×60.3		64	221.5	112.5	115	115	5/8X85
5×2	5.500×2.375	2.07	2.5	8.72	4.43	4.53	4.53	M16X85
125×65	139.7×76.1	300	70	221.5	112.5	115	115	5/8X85
5×2½	5.500×3.000	2.07	2.75	8.72	4.43	4.53	4.53	M16X85
150×32	159.0 × 42.4	300	51	244	93	118	118	5/8×105
159.0×1¼	6.250 × 1.660	2.07	2.00	9.60	3.66	4.65	4.65	M16X108







Nominal	Pipe	Working	Hole Dia	Dimensions				Bolt Size
Size	O.D	Pressure	mm/in	A	B	C	D	mm/in
mm/in	mm/in	PSI/MPa	+1.6,0/+0.063,0	mm/in	mm/in	mm/in	mm/in	
150×40	159.0×48.3	300	51	244	93	118	118	5/8×105
159.0×1½	6.250×1.900	2.07	2.00	9.60	3.66	4.65	4.65	M16X108
150×50	159.0×60.3	300	64	244	112.5	125	125	5/8×105
159.0×2	6.250×2.375	2.07	2.50	9.60	4.43	4.92	4.92	M16X108
150×65	159.0×76.1	300	70	244	112.5	125	125	5/8×105
159.0×76.1	6.250×3.000	2.07	2.75	9.60	4.43	4.92	4.92	M16X108
150×15	165.1×21.3	300	38	244	78	110	110	5/8X105
6×½	6.500×0.825	2.07	1.5	9.6	3.07	4.33	4.33	M16X108
150×20	165.1×26.9	300	38	244	78	110	110	5/8X105
6×¾	6.500×1.059	2.07	1.5	9.6	3.07	4.33	4.33	M16X108
150×25	165.1×33.7	300	38	244	78	118	118	5/8X105
6×1	6.500×1.327	2.07	1.5	9.6	3.07	4.65	4.65	M16X108
150×32	165.1×42.4	300	51	244	93	118	118	5/8X105
6×11/4	6.500×1.669	2.07	2	9.6	3.66	4.65	4.65	M16X108
150×40	165.1×48.3	300	51	244	93	118	118	5/8X105
6×1½	6.500×1.900	2.07	2	9.6	3.66	4.65	4.65	M16X108
150×50	165.1×60.3	300	64	244	112.5	128.5	128.5	5/8X105
6×2	6.500×2.375	2.07	2.5	9.6	4.43	5.43	5.43	M16X108
150×65	165.1×76.1	300	70	244	112.5	128.5	128.5	5/8X105
6×2½	6.500×3.000	2.07	2.75	9.6	4.43	5.43	5.43	M16X108
150×80	165.1×88.9	300	89	244	132	128.5	128.5	5/8X105
6×3	6.500×3.500	2.07	3.5	9.6	5.2	5.06	5.06	M16X108
150×32	168.3×42.4	300	51	247	95	130	130	5/8X105
6×1¼	6.500×1.669	2.07	2	9.72	3.74	5.12	5.12	M16X108
150×40 6×1½	168.3×48.3 6.500×1.900	300 2.07	51	247 9.72	95 3.74	122	122	5/8X105 M16X108
150×50	168.3×60.3	300	64	247	112.5	132	132	5/8X105
6×2	6.625×2.375	2.07	2.5	9.72	4.43	5.2		M16X108
150×65	168.3×73.0	300	70	247	112.5	132	132	5/8X105
6×2½	6.625×2.875	2.07	2.75	9.72	4.43	5.2	5.2	M16X108
150×80	168.3×88.9	300	89	247	132	140	140	5/8X105
6×3	6.625×3.500	2.07	3.5	9.72		5.51	5.51	M16X108
200×25	219.0×33.7	300	38	320	79.5	150	150	3/4X115
8×1	8.625×1.327	2.07	1.5	12.60	3.13	5.91	5.91	M20X115
200×32	219.1×42.4	300	51	320	96.5	150	150	3/4X115
8×11/4	8.625×1.669	2.07	2	12.60	3.8	5.91	5.91	M20X115
200×40	219.1×48.3	300	51	320	96.5	150	150	3/4X115
8×1½	8.625×1.900	2.07		12.60	3.8	5.91	5.91	M20X115
200×50	219.1×60.3	300	64	320	117	160	160	3/4X115
8×2	8.625×2.375	2.07	2.5	12.60	4.61	6.3	6.3	M20X115
200×65	219.1×76.1	300	70	320	118	158.5	158.5	3/4X115
8×2½	8.625×3.000	2.07	2.75	12.60	4.65	6.24	6.24	M20X115
200×80	219.1×88.9	300	89	320	136.5	160	160	3/4X115
8×3	8.625×3.500	2.07	3.5	12.60	5.37	6.3	6.3	M20X115
200×100	219.1 × 114.3	300	114	320	164	160	160	3/4X115
8×4	8.625 × 4.500	2.07	4.5	12.60	6.46	6.3	6.3	M20X115
250×40	273.0×48.3	300	51	376	95.5	180	180	3/4X120
10×1½	10.750×1.900	2.07	2	14.8	3.76	7.09	7.09	M20X115
250×50	273.0×60.3	300	64	376	118	185	185	3/4X120
10×2	10.750×2.375	2.07	2.5	14.8	4.65	7.28	7.28	M20X115
250×65	273.0×76.1	300	70	376	118	190	190	3/4X120
10×2½	10.750×3.000	2.07	2.75	14.8	4.65	7.48	7.48	M20X115
250×80	273.0×88.9	300	89	376	136.5	190	190	3/4X120
250×100 10×4	273.0×114.3	300	114	376	164	190	190	3/4X120
10×3 250×100	10.750×3.500	2.07	3.5	14.8	5.37	7.48	7.48	M20X115










































# 4JS

Light-duty Mechanical Cross Threaded Outlet






Nominal	Pipe	Working	Hole Dia		Dimensio	onsmm/in		Bolt Size
Size	O.D	Pressure	mm/in	A	B	C	D	mm/in
mm/in	mm/in	PSI/MPa	+1.6,0/+0.063,0	mm/in	mm/in	mm/in	mm/in	
80×15	88.9×21.3	300	38	150	71.0	68	68	1/2×75
3×½	3.500×0.825	2.07	1.50	5.91	2.80	2.68	2.68	M12X76
80×20	88.9×26.9	300	38	150	71.0	68	68	1/2×75
3×¾	3.500×1.050	2.07	1.50	5.91	2.80	2.68	2.68	M12X76
80×25	88.9×33.7	300	38	150	71.0	71.0	71.0	1/2×75
3×1	3.500×1.315	2.07	1.50	5.91	2.80	2.80	2.80	M12X76
80×32	88.9×42.4	300	51	150	84.5	74	74	1/2×75
3×1¼	3.500×1.660	2.07	2.00	5.91	3.33	2.91	2.91	M12X76
80×40	88.9×48.3	300	51	150	84.5	74	74	1/2×75
3×1½	3.500×1.900	2.07	2.00	5.91	3.33	2.91	2.91	M12X76
100×25	108.1×33.7	300	38	172	77.5	85	85	1/2×75
108.0×1	4.250×1.315	2.07	1.50	6.77	3.05	3.35	3.35	M12X76
100×32	108.1×42.4	300	51	172	88	85	85	1/2×75
108.0×11/4	4.250×1.660	2.07	2.00	6.77	3.46	3.35	3.35	M12X76
100×40	108.0×48.3	300	51	172	88	85	85	1/2×75
108.0×1½	4.250×1.900	2.07	2.00	6.77	3.46	3.35	3.35	M12X76
100×50	108.0×60.3	300	64	172	103.5	89	89	1/2×75
108.0×2	4.250×2.375	2.07	2.50	6.77	4.19	3.50	3.50	M12X76
100×15	114.3×21.3	300	38	178	77.5	82	82	1/2×75
4×½	4.500×0.825	2.07	1.50	7.01	3.05	3.23	3.23	M12X76
100×20	114.3×26.9	300	38	178	77.5	82	82	1/2×75
4×¾	4.500×1.050	2.07	1.50	7.01	3.05	3.23	3.23	M12X76
100×25	114.3×33.7	300	38	178	77.5	82	82	1/2×75
4×1	4.500×1.315	2.07	1.50	7.01	3.05	3.23	3.23	M12X76
100×32	114.3×42.4	300	51	178	88	89.5	89.5	1/2×75
4×1¼	4.500×1.660	2.07	2.00	7.01	3.46	3.53	3.53	M12X76
100×40	114.3×48.3	300	51	178	88	89.5	89.5	1/2×75
4×1½	4.500×1.900	2.07	2.00	7.01	3.46	3.53	3.53	M12X76
100×50	114.3×60.3	300	64	178	103.5	92	92	1/2×75
4×2	4.500×2.375	2.07	2.50	7.01	4.07	3.62	3.62	M12X76
125×25	133.0×33.7	300	38	203	77	98	98	5/8×85
133.0×1	5.250×1.315	2.07	1.50	7.99	3.03	3.86	3.86	M16X85
125×32	133.0×42.4	300	51	203	91	102	102	5/8×85
133.0×1.25	5.250×1.660	2.07	2.00	7.99	3.58	4.01	4.01	M16X85
125×40	133.0×48.3	300	51	203	91	102	102	5/8×85
133.0×1½	5.250×1.900	2.07	2.00	7.99	3.58	4.01	4.01	M16X85
125×50	133.0×60.3	300	64	203	110	105	105	5/8×85
133.0×2	5.250×2.375	2.07	2.50	7.99	4.33	4.13	4.13	M16X85
125×65	133.0×76.1	300	70	203	110	110	110	5/8×85
133.0×76.1	5.250×3.000	2.07	2.75	7.99	4.33	4.33	4.33	M16X85
125×25	139.7×33.7	300	38	210	77	100	100	5/8×85
139.7×1	5.500×1.315	2.07	1.50	8.27	3.03	3.94	3.94	M16X85
125×32	139.7×42.4	300	51	210	91	105	105	5/8×85
139.7×1¼	5.500×1.660	2.07	2.00	8.27	3.58	4.13	4.13	M16X85
125×40	139.7×48.3	300	51	210	91	105	105	5/8×85
139.7×1½	5.500×1.900	2.07	2.00	8.27	3.58	4.13	4.13	M16X85
125×50	139.7×60.3	300	64	210	110	108	108	5/8×85
139.7×2	5.500×2.375	2.07	2.50	8.27	4.33	4.25	4.25	M16X85
125×65	139.7×76.1	300	70	210	110	115	115	5/8×85
139.7×76.1	5.500×3.000	2.07	2.75	8.27	4.33	4.53	4.53	M16X85
150×25	159.0×33.7	300	38	227	77	110	110	5/8×85
159.0×1	6.250×1.315	2.07	1.50	8.94	3.03	4.33	4.33	M16X85



Light-duty Mechanical Cross Threaded Outlet





Nominal	Pipe	Working	Hole Dia	Dimensionsmm/in			Bolt Size	
Size	O.D	Pressure	mm/in	A	B	C	D	mm/in
mm/in	mm/in	PSI/MPa	+1.6,0/+0.063,0	mm/in	mm/in	mm/in	mm/in	
150×32	159.0×42.4	300	51	227	92.5	112	112	5/8×85
159.0×1%	6.250×1.660	2.07	2.00	8.94	3.64	4.41	4.41	M16X85
150×40	159.0×48.3	300	51	227	92.5	112	112	5/8×105
159.0×1½	6.250×1.900	2.07	2.00	8.94	3.64	4.41	4.41	M16X108
150×50	159.0×60.3	300	64	227	110	116.5	116.5	5/8×105
159.0×2	6.250×2.375	2.07	2.50	8.94	4.33	4.59	4.59	M16X108
150×65	159.0×76.1	300	70	227	110	121.5	121.5	5/8×105
159.0×76.1	6.250×3.000	2.07	2.75	8.94	4.33	4.78	4.78	M16X108
150×80	159.0×88.9	300	89	227	130	123.5	123.5	5/8×105
159.0×3	6.250×3.500	2.07	3.50	8.94	5.12	4.86	4.86	M16X108
150×15	165.1×21.3	300	38	235	77	115	115	5/8×105
165.1×½	6.500×0.825	2.07	1.50	9.25	3.03	4.53	4.53	M16X108
125×20	165.1×26.9	300	38	235	77	115	115	5/8×105
165.1×¾	6.500×1.050	2.07	1.50	9.25	3.03	4.53	4.53	M16X108
150×25	165.1×33.7	300	38	235	77	115	115	5/8×105
165.1×1	6.500×1.315	2.07	1.50	9.25	3.03	4.53	4.53	M16X108
150×32	165.1×42.4	300	51	235	92.5	115	115	5/8×105
165.1×11/4	6.500×1.660	2.07	2.00	9.25	3.64	4.53	4.53	M16X108
150×40	165.1×48.3	300	51	235	92.5	115	115	5/8×105
165.1×1½	6.500×1.900	2.07	2.00	9.25	3.64	4.53	4.53	M16X108
150×50	165.1×60.3	300	64	235	110	120	120	5/8×105
165.1×2	6.500×2.375	2.07	2.50	9.25	4.33	4.72	4.72	M16X108
150×65	165.1×76.1	300	70	235	110	125	125	5/8×105
165.1×76.1	6.500×3.000	2.07	2.75	9.25	4.33	4.92	4.92	M16X108
150×80	165.1×88.9	300	89	235	130	125	125	5/8×105
165.1×3	6.500×3.500	2.07	3.50	9.25	5.12	4.92	4.92	M16X108
150×25	168.3×33.7	300	38	240	77	115	115	5/8×105
6×1	6.500×1.315	2.07	1.50	9.45	3.03	4.53	4.53	M16X108
150×32	168.3×42.4	300	51	240	92.5	115	115	5/8×105
6×11/4	6.500×1.660	2.07	2.00	9.45	3.64	4.53	4.53	M16X108
150×40	168.3×48.3	300	51	240	92.5	115	115	5/8×105
6×1½	6.500×1.900	2.07	2.00	9.45	3.64	4.53	4.53	M16X108
150×50	168.3×60.3	300	64	240	110	121	121	5/8×105
6×2	6.625×2.375	2.07	2.50	9.45	4.33	4.76	4.76	M16X108
150×65	168.3×73.0	300	70	240	110	127	127	5/8×105
6×2½	6.625×2.875	2.07	2.75	9.45	4.33	5.00	5.00	M16X108
150×80	168.3×88.9	300	89	240	130	127	127	5/8×105
6×3	6.625×3.500	2.07	3.50	9.45	5.12	5.00	5.00	M16X108
200×25	219.0×33.7	300	38	300	78	140	140	5/8×105
8×1	8.625×1.315	2.07	1.50	11.81	3.07	5.51	5.51	M16X108
200×32	219.1×42.4	300	51	300	93	140	140	5/8×105
8×1¼	8.625×1.660	2.07	2.00	11.81	3.66	5.51	5.51	M16X108
200×40	219.1×48.3	300	51	300	93	143	143	5/8×105
8×1½	8.625×1.900	2.07	2.00	11.81	3.66	5.63	5.63	M16X108
200×50	219.1×60.3	300	64	300	115	149	149	5/8×105
8×2	8.625×2.375	2.07	2.50	11.81	4.53	5.87	5.87	M16X108
200×65	219.1×76.1	300	70	300	115	155	155	5/8×105
8×76.1	8.625×3.000	2.07	2.75	11.81	4.53	6.10	6.10	M16X108
200×80	219.1×88.9	300	89	300	133.5	155	155	5/8×105
8×3	8.625×3.500	2.07	3.50	11.81	5.25	6.10	6.10	M16X108
200×100	219.1 × 114.3	300	114	300	159.5	160	160	5/8×105
8×4	8.625 × 4.500	2.07	4.50	11.81	6.29	6.30	6.30	M16X108



















## 230

#### Grooved Eccentric Reducer







Nominal	Pipe	Working	Dimensions	Certificate
Size	O.D	Pressure	L	
mm/in	mm/in	PSI/MPa	mm/in	
40X32	48.3X42.4	500	89	
1 <sup>1</sup> / <sub>2</sub> X1 <sup>1</sup> / <sub>4</sub>	1.900X1.660	3.45	3.50	
50X40	60.3X48.3	500	89	
2X1 <sup>1</sup> / <sub>2</sub>	2.375X1.900	3.45	3.50	_
80X50	88.9X60.3	500	89	
3X2	3.500X2.375	3.45	3.50	UL FM
100X65	108.0X76.1	500	102	UL FM
4X2 <sup>1</sup> / <sub>2</sub>	4.250X3.000	3.45	4.00	
100X80	108.0X88.9	500	102	UL FM
4X3	4.250X3.500	3.45	4.00	
100X50	114.3X60.3	500	102	UL FM
4X2	4.500X2.000	3.45	4.00	
100X65	114.3X76.1	300	102	UL FM
4X21/2	4.500X3.000	2.07	4.00	
100X80	114.3X88.9	500	102	UL FM
4X3	4.500X3.500	3.45	4.00	
125X100	139.7X114.3	300	127	UL FM
5X4	5.500X4.500	2.07	5.00	
150X100	159.0X108.0	300	140	UL FM
6X4	6.250X4.250	2.07	5.50	
150X100	159.0X114.3	300	140	UL FM
6X4	6.250X4.500	2.07	5.50	
150X80	165.1X88.9	300	140	
6X3	6.500X3.500	2.07	5.50	UL FM
150X100	165.1X114.3	300	140	UL FM
6X4	6.500X4.500	2.07	5.50	
150X125	165.1X139.7	300	140	UL FM
6X5	6.500X5.500	2.07	5.50	
150X80	168.3X88.9	300	140	UL FM
6X3	6.625X3.500	2.07	5.50	
150X100	168.3X114.3	300	140	UL FM
6X4	6.625X4.500	2.07	5.50	
150X125	168.3X139.7	300	140	UL FM
6X5	6.625X5.500	2.07	5.50	
200X100	219.1X114.3	300	215	UL FM
8X4	8.625X4.500	2.07	8.50	
200X100	219.1X165.1	300	215	_
8X6	8.625X6.50	2.07	8.50	
200X100	219.1X168.3	300	215	_
8X6	8.625X6.625	2.07	8.50	
200X100	273.0X219.1	300	215	UL FM
10X8 350X150	10.750X8.625 355.6X168.3	2.07	8.50 330	3E1111
14X6	14.000X6.625	2.07	12.99	_
350X200	355.6X219.1	300	330	_
14X8	14.000X8.625	2.07	12.99	
350X250	355.6X273.0	300	330	_
14X10	14.000X10.750	2.07	12.99	
350X300	355.6X323.9	300	330	_
14X12	14.000X12.750	2.07	12.99	
400X200	406.4X219.1	300	356	_
16X8	16.000X8.625	2.07	14.02	
400X250	406.4X273.0	300	356	_
16X10	16.000X10.750	2.07	14.02	
400X300	406.4X323.9	300	356	_
16X12	16.000X12.750	2.07	14.02	
400X350	406.4X355.6	300	356	_
16X14	16.000X14.000	2.07	14.02	
450X150	457.2X168.3	300	381	_
18X6	18.000X6.625	2.07	15.00	
450X250	457.2X273.0	300	381	_
18X10	18.000X10.750	2.07	15.00	
450X300	457.2X323.9	300	381	_
18X12	18.000X12.750	2.07	15.00	
450X350	457.2X355.6	300	381	
18X14 450X400	18.000X14.000 457.2X406.4	2.07	15.00 381	
18X16	18.000X16.000	2.07	15.00	_

# 230

#### **Grooved Eccentric** Reducer







Nominal	Pipe	Working	Dimensions	Certificate
Size	O.D	Pressure	L	
mm/in	mm/in	PSI/MPa	mm/in	
500X300	508.0X323.9	300	508	_
20X12	20.000X12.750	2.07	20.00	
500X350	508.0X355.6	300	508	_
20X14	20.000X14.000	2.07	20.00	
500X400	508.0X406.4	300	508	_
20X16	20.000X16.000	2.07	20.00	
500X450	508.0X457.2	300	508	_
20X18	20.000X18.000	2.07	20.00	
600X400	609.6X406.4	300	508	_
24X16	24.000X16.000	2.07	20.00	
600X450	609.6X457.2	300	508	_
24X18	24.000X18.000	2.07	20.00	
600X500	609.6X508.0	300	508	_
24X20	24.000X20.000	2.07	20.00	

Segmental sizes are made of carbon steel pipe or fabricated from wrought carbon steel. Contact manufacturer for details.

# 230N

Grooved Eccentric Reducer with Female Thread







Nominal Size mm/in	Pipe O.D mm/in	Working Pressure PSI/MPa	Dimensions L mm/in	Certificate
100X65 4X2 <sup>1</sup> / <sub>2</sub>	114.3X76.1 4.500X3.000	300 2.07	102 4.00	ULFM
125X80 5X3	139.7X88.9 5.500X3.500	300 2.07	127 5.00	ULFM
150X80	165.1X88.9	300	140	UL FM









































240

**Grooved Concentric** Reducer







Nominal	Pipe	Working	Dimensions	Certificate
Size	O.D	Pressure	L	
mm/in	mm/in	PSI/MPa	mm/in	
32X25	42.4X33.7	500	64	UL FM VdS LPCB
1 <sup>1</sup> / <sub>4</sub> X1	1.660X1.315	3.45	2.50	
40X25	48.3X33.7	500	64	UL FM VdS LPCB
1½X1	1.900X1.315	3.45	2.50	
40X32	48.3X42.4	500	64	UL FM VdS LPCB
1½X1¼	1.900X1.660	3.45	2.50	
50X25	60.3X33.7	500	64	UL FM VdS LPCB
2X1	2.375X1.315	3.45	2.50	
50X32	60.3X42.4	500	64	UL FM VdS LPCB
2X11/4	2.375X1.660	3.45	2.50	
50X40	60.3X48.3	500	64	UL FM VdS LPCB
2X1½	2.375X1.900	3.45	2.50	
65X25	73.0x33.7	500	64	UL FM
2½X1	2.875X1.315	3.45	2.50	
65X32	73.0X42.4	500	64	UL FM
2½X1¼	2.875X1.660	3.45	2.50	
65X40	73.0X48.3	500	64	UL FM
21/2X11/2	2.875X1.900	3.45	2.50	
65X50	73.0X60.3	500	64	UL FM
2½X2	2.875X2.375	3.45	2.50	
65X25	76.1 X33.7	500	64	_
2½X1	3.000X1.315	3.45	2.50	
65X32	76.1X42.4	500	64	UL FM VdS LPCB
2½X1¼	3.000X1.660	3.45	2.50	
65X40	76.1X48.3	500	64	UL FM VdS LPCB
2½X1½	3.000X1.900	3.45	2.50	
65X50	76.1X60.3	500	64	UL FM VdS LPCB
2½X2	3.000X2.375	3.45	2.50	
80X25	88.9X33.7	500	64	UL FM VdS
3X1	3.500X1.315	3.45	2.50	
80X32	88.9X42.4	500	64	UL FM
3X1¼	3.500X1.660	3.45	2.50	
80X40	88.9X48.3	500	64	UL FM VdS
3X1½	3.500X1.900	3.45	2.50	
80X50	88.9X60.3	500	64	UL FM VdS LPCB
3X2	3.500X2.375	3.45	2.50	
80X65	88.9X73.0	500	64	UL FM
3X2½	3.500X2.875	3.45	2.50	
80X65	88.9X76.1	500	64	UL FM VdS LPCB
3X2½	3.500X3.000	3.45	2.50	
100X50	108.0X60.3	500	76	UL FM
4X2	4.250X2.375	3.45	3.00	
100X65	108.0X73.0	500	76	UL FM
4X2½	4.250X2.875	3.45	3.00	
100X65	108.0X76.1	500	76	UL FM
4X2½	4.250X3.000	3.45	3.00	
100X80	108.0X88.9	500	76	UL FM
4X3	4.250X3.500	3.45	3.00	
100X32	114.3X42.4	500	76	UL FM VdS
4X1¼	4.500X1.660	3.45	3.00	
100X40	114.3X48.3	500	76	UL FM VdS LPCB
4X1½	4.500X1.900	3.45	3.00	
100X50	114.3X60.3	500	76	UL FM VdS LPCB
4X2	4.500X2.375	3.45	3.00	
100X65	114.3X73.0	500	76	UL FM
4X2½	4.500X2.875	3.45	3.00	
100X65	114.3X76.1	500	76	UL FM VdS LPCB
4X2½	4.500X3.000	3.45	3.00	
100X80	114.3X88.9	500	76	UL FM VdS LPCB
4X3	4.500X3.500	3.45	3.00	
125X100	133.0X108.0	500	89	UL FM
5X4	5.250X4.250	3.45	3.50	
125X100	133.0X114.3	500	89	UL FM
15X4	5.250X4.500	3.45	3.50	
125X50	139.7X60.3	500	89	UL FM
5X2	5.500X2.375	3.45	3.50	
125X65	139.7X76.1	500	89	UL FM VdS
5X2½	5.500X3.000	3.45	3.50	
125X80	139.7X88.9	500	89	UL FM VdS
5X3	5.500X3.500	3.45	3.50	

# 240

# Grooved Concentric Reducer







Nominal	Pipe	Working	Dimensions	Certificate
Size	O.D	Pressure	L	
mm/in	mm/in	PSI/MPa	mm/in	
125X100	139.7X114.3	500	89	UL FM VdS LPCB
5X4	5.500X4.500	3.45	3.50	
125X65	141.3X73.0	500	89	UL FM
5X2½	5.563X2.875	3.45	3.50	
125X80	141.3X88.9	500	89	UL FM
5X3	5.563X3.500	3.45	3.50	
125X100	141.3X114.3	500	89	UL FM
5X4	5.563X4.500	3.45	3.50	
150X50	159.0X60.3	500	102	UL FM
6X2	6.250X2.375	3.45	4.00	
150X65	159.0X76.1	500	102	UL FM
159.0X2½	6.250X3.000	3.45	4.00	
150X80	159.0X88.9	500	102	UL FM
6X3	6.250X3.500	3.45	4.00	
150X100	159.0X108	500	102	UL FM
6X4	6.250X4.250	3.45	4.00	
150X100	159.0X114.3	500	102	UL FM
6X4	6.250X4.500	3.45	4.00	
150X125	159.0X133.0	500	102	UL FM
6X5	6.250X5.250	3.45	4.00	
150X50	165.1X60.3	500	102	UL FM
6X2	6.500X2.375	3.45	4.00	
150X65	165.1X76.1	500	102	UL FM
6X2½	6.500X3.000	3.45	4.00	
150X80	165.1X88.9	500	102	UL FM LPCB
6X3	6.500X3.500	3.45	4.00	
150X100	165.1X108.0	500	102	
6X4	6.500X4.250	3.45	4.00	
150X100	165.1X114.3	500	102	UL FM LPCB
6X4	6.500X4.500	3.45	4.00	
150X125	165.1X139.7	500	102	UL FM LPCB
6X5	6.500X5.500	3.45	4.00	
150X125	165.1X141.3	500	102	_
6X5	6.500X5.563	3.45	4.00	
150X50	168.3X60.3	500	102	UL FM VdS
6X2	6.625X2.375	3.45	4.00	
150X65	168.3X73.0	500	102	UL FM
6X2½	6.625X2.875	3.45	4.00	
150X65	168.3X76.1	500	102	UL FM VdS
6X2½	6.625X3.000	3.45	4.00	
150X80	168.3X88.9	500	102	UL FM VdS
6X3	6.625X3.500	3.45	4.00	
150X100	168.3X114.3	500	102	UL FM VdS LPCB
6X4	6.625X4.500	3.45	4.00	
150X125	168.3X139.7	500	102	UL FM VdS LPCB
6X5	6.625X5.500	3.45	4.00	
150X125	168.3X141.3	500	102	UL FM
6X5	6.625X5.563	3.45	4.00	
200X100	216.3X114.3	500	127	UL FM
8X4	8.516X4.500	3.45	5.00	
200X150	216.3X165.1	500	127	UL FM
8X6	8.516X6.500	3.45	5.00	
200X65	219.1X73.0	500	127	UL FM
8X2½	8.625X2.875	3.45	5.00	
200X80	219.1X88.9	500	127	UL FM VdS LPCB
8X3	8.625X3.500	3.45	5.00	
200X100	219.1X108.0	500	127	UL FM
8X4	8.625X4.250	3.45	5.00	
200X100	219.1X114.3	500	127	UL FM VdS LPCB
8X4	8.625X4.500	3.45	5.00	
200X125	219.1X139.7	500	127	UL FM VdS LPCB
8X5	8.625X5.500	3.45	5.00	
200X125	219.1X141.3	500	127	UL FM
8X5	8.625X5.563	3.45	5.00	
200X150	219.1X159.0	500	127	UL FM
8X6	8.625X6.250	3.45	5.00	
200X150	219.1X165.1	500	127	UL FM
8X6	8.625X6.500	3.45	5.00	
200X150	219.1X168.3	500	127	UL FM VdS LPCB
8X6	8.625X6.625	3.45	5.00	



240

Grooved Concentric Reducer







Nominal	Pipe	Working	Dimensions	Certificate
Size	O.D	Pressure	L	
mm/in	mm/in	PSI/MPa	mm/in	
250X150	273.0X159.0	500	152	UL FM
10X6	10.750X6.250	3.45	6.00	
250X150	273.0X165.1	500	152	UL FM
10X6	10.750X6.500	3.45	6.00	
250X150	273.0X168.3	500	152	UL FM VdS
10X6	10.750X6.625	3.45	6.00	
250X200	273.0X219.1	500	152	UL FM VdS
10X8	10.750X8.625	3.45	6.00	
300X200	323.9X219.1	500	178	UL FM VdS
12X8	12.750X8.625	3.45	7.00	
300X250	323.9X273.0	500	178	UL FM VdS
12X10	12.750X10.750	3.45	7.00	
350X125	377.0X133.0	300	127	_
14X5	14.850X5.250	2.07	5.00	
350X150	377.0X159.0	300	127	
14X6	14.850X6.250	2.07	5.00	
350X150	355.6X168.3	300	330	_
14X6	14.000X6.625	2.07	12.99	
350X200	355.6X219.1	300	203	_
14X8	14.000X8.625	2.07	7.99	
350X250	355.6X273.0	300	203	_
14X10	14.000X10.750	2.07	7.99	
350X300	355.6X323.9	300	203	_
14X12	14.000X12.750	2.07	7.99	
400X200	406.4X219.1	300	229	_
16X8	16.000X8.625	2.07	9.00	
400X250	406.4X273.0	300	229	_
16X10	16.000X10.750	2.07	9.00	
400X300	406.4X323.9	300	229	_
16X12	16.000X12.750	2.07	9.00	
400X350	406.4X355.6	300	229	_
16X14	16.000X14.000	2.07	9.00	
450X150	457.2X168.3	300	381	_
18X6	18.000X6.625	2.07	15.00	
450X250	457.2X273.0	300	381	_
18X10	18.000X10.750	2.07	15.00	
450X300	457.2X323.9	300	241	_
18X12	18.000X12.750	2.07	9.50	
450X350	457.2X355.6	300	241	_
18X14	18.000X14.000	2.07	9.50	
450X400	457.2X406.4	300	241	
18X16	18.000X16.000	2.07	9.50	
500X200	530.0X219.1	300	135	
20X8	20.866X8.625	2.07	5.31	
500X300	508.0X323.9	300	254	
20X12	20.000X12.750	2.07	10.00	
500X350	508.0X355.6	300	254	
20X14	20.000X14.000	2.07	10.00	
500X400	508.0X406.4	300	254	
20X16	20.000X16.000	2.07	10.00	
500X450	508.0X457.2	300	254	_
20X18	20.000X18.000	2.07	10.00	
600X400	609.6X406.4	300	305	_
24X16	24.000X16.000	2.07	12.00	
600X450	609.6X457.2	300	305	_
24X18	24.000X18.000	2.07	12.00	
600X500	609.6X508.0	300	305	_
24X20	24.000X20.000	2.07	12.00	

Segmental sizes are made of carbon steel pipe or fabricated from wrought carbon steel. Contact manufacturer for details.

## 240N

Grooved Concentric Reducer with Female Thread







Nominal	Pipe	Working	Dimensions	Certificate	
Size	O.D	Pressure	L		
mm/in	mm/in	PSI/MPa	mm/in		
50X15	60.3X21.3	500	64	VdS	
2X1/2	2.375X0.825	3.45	2.50		
50X20	60.3X26.9	500	64	UL FM VdS LPC	
2X3/4	2.375X1.05	3.45	2.50		
50X25	60.3X33.7	500	64	UL FM VdS LPC	
2X1	2.375X1.315	3.45	2.50		
50X32	60.3X42.4	500	64		
2X1¼	2.375X1.660	3.45	2.50	UL FM VdS LPC	
50X40	60.3X48.3	500	64		
2X11/2	2.375X1.900	3.45	2.50	UL FM VdS LPC	
65X25	73.0X33.7	500	64	UL FM	
2½X1	2.875X1.315	3.45	2.50		
65X25	73.0X42.4	500	64	UL FM	
2½X1¼	2.875X1.660	3.45	2.50		
65X40	73.0X48.3	500	64	ULFM	
2½X1½	2.875X1.900	3.45	2.50		
65X50	73.0X60.3	500	64	ULFM	
21/x2	2.875X2.375	3.45	2.50		
65X15	76.1X21.3	500	64		
21/2X1/2	3.000X0.825 76.1X26.9	3.45 500	2.50	UL FM VdS	
65X20 21/2X3/4	3.000X1.05	3.45	2.50	UL FM VdS	
65X25	76.1X33.7	500	64	UL FM VdS	
2½X1	3.000X1.315	3.45	2.50		
65X32	76.1X42.4	500	64	UL FM VdS LPC	
2½X1¼	3.000X1.660	3.45	2.50		
65X40	76.1X48.3	500	64 2.50	FM VdS LPCE	
2½X1½ 65X50	3.000X1.900 76.1X60.3	3.45 500	64	UL FM VdS I PO	
2½X2	3.000X2.375	3.45	2.50		
80X15	88.9X21.3	500	64		
3X1/2 80X20	3.500X0.825 88.9X26.9	3.45 500	2.50	VdS	
3X3/4	3.500X1.05	3.45	2.50	UL FM VdS	
80X25	88.9X33.7	500	64	UL FM VdS	
3X1	3.500X1.315	3.45	2.50		
80X32	88.9X42.4	500	64	VdS	
3X1¼	3.500X1.660	3.45	2.50		
80X40	88.9X48.3	500	64	UL FM VdS	
3X1½	3.500X1.900	3.45	2.50	UL FM VdS LPC	
80X50	88.9X60.3	500	64		
3X2 80X65	3.500X2.375 88.9X73.0	3.45 500	2.50		
3X2½ 80X65	3.500X2.875 88.9X76.1	3.45 500	2.50	ULFM	
3X21/2	3.500X3.000	3.45	2.50	UL FM VdS LPC	
100X25	108.0X33.7	500	76	UL FM	
4X1	4.250X1.315	3.45	3.00		
100X32	108.0X42.4	500	76	UL FM	
4X1¼	4.250X1.660	3.45	3.00		
100X40	108.0X48.3	500	76	UL FM	
4X1½	4.250X1.900	3.45	3.00	UL FM	
100X50	108.0X60.3	500	76		
4X2	4.250X2.375	3.45	3.00		
100X65	108.0X76.1	500	76		
4X2½	4.250X3.000	3.45	3.00	ULFM	
100X80	108.0X88.9	500	76		
4X3	4.250X3.500	3.45	3.00	UL FM	
100X15	114.3X21.3	500	76	UL FM VdS	
4X1/2	4.500X0.825	3.45	3.00		
100X20	114.3X26.9	500	76	UL FM VdS	
4X3/4	4.500X1.05	3.45	3.00		
100X25	114.3X33.7	500	76	UL FM VdS	
4X1	4.500X1.315	3.45	3.00		
100X32	114.3X42.4	500	76	UL FM VdS	
4X1¼	4.500X1.660	3.45	3.00		
100X40	114.3X48.3	500	76		
4X1½	4.500X1.900	3.45	3.00	UL FM VdS LPC	
100X50	114.3X60.3	500	76		
4X2	4.500X2.375	3.45	3.00	UL FM VdS LPC	
100X65	114.3X73.0	500	76	ULFM	
4X2½	4.500X2.875	3.45	3.00		
100X65	114.3X76.1	500	76	UL FM VdS LPCB	
4X2½	4.500X3.000	3.45	3.00		
100X80	114.3X88.9	500	76	UL FM VdS LPC	
4X3	4.500X3.500	3.45	3.00	UI FM	
125X40	133.0X48.3	500	89		
5X1½	5.250X1.900	3.45	3.50	ULFM	





## 240N

**Grooved Concentric** Reducer with Female Thread














Nominal	Pipe	Working	Certificate	
Size	O.D	Pressure		
mm/in	mm/in	PSI/MPa		
125X40	133.0X60.3	500	89	_
5X2	5.250X2.375	3.45	3.50	
125X65	133.0X76.1	500	89	UL FM
5X21/2	5.250X3.000	3.45	3.50	
125X65	133.0X88.9	500	89	_
5X3	5.250X3.500	3.45	3.50	
125X25	139.7X33.7	500	89	UL FM VdS
5X1	5.500X1.315	3.45	3.50	
125X32	139.7X42.4	500	89	UL FM VdS
5X1¼	5.500X1.660	3.45	3.50	
125X40	139.7X48.3	500	89	UL FM VdS
5X1½	5.500X1.900	3.45	3.50	
125X50	139.7X60.3	500	89	UL FM VdS
5X2	5.500X2.375	3.45	3.50	
125X65	139.7X76.1	500	89	UL FM VdS
5X21/2	5.500X3.000	3.45	3.50	
125X80	139.7X88.9	500	89	UL FM VdS
5X3	5.500X3.500	3.45	3.50	
125X100	139.7X114.3	500	89	UL FM VdS LPCB
5X4	5.500X4.500	3.45	3.50	
125X100	141.3X114.3	500	89	UL FM
5X4	5.563X4.500	3.45	3.50	
150X20	159.0X26.9	500	102	UL FM
6X3/4	6.250X1.05	3.45	4.00	
150X25	159.0X33.7	500	102	UL FM
6X1	6.250X1.315	3.45	4.00	
150X32	159.0X42.4	500	102	UL FM
6X1¼	6.250X1.660	3.45	4.00	
150X40	159.0X48.3	500	102	UL FM
6X1½	6.250X1.900	3.45	4.00	
150X50	159.0X60.3	500	102	UL FM
6X2	6.250X2.375	3.45	4.00	
150X65	159.0X76.1	500	102	UL FM
6X2½	6.250X3.000	3.45	4.00	
150X80	159.0X88.9	500	102	UL FM
6X3	6.250X3.500	3.45	4.00	
150X100	159.0X114.3	500	102	UL FM
6X4	6.250X4.500	3.45	4.00	
150X15	165.1X21.3	500	102	UL FM
6X1/2	6.500X0.825	3.45	4.00	
150X20	165.1X26.9	500	102	UL FM
6X3/4	6.500X1.05	3.45	4.00	
150X25	165.1X33.7	500	102	UL FM
6X1	6.500X1.315	3.45	4.00	
150X32	165.1X42.4	500	102	UL FM
6X1¼	6.500X1.660	3.45	4.00	
150X40	165.1X48.3	500	102	UL FM
6X1½	6.500X1.900	3.45	4.00	
150X50	165.1X60.3	500	102	UL FM
6X2	6.500X2.375	3.45	4.00	
150X65	165.1X76.1	500	102	UL FM
6X2½	6.500X3.000	3.45	4.00	
150X80	165.1X88.9	500	102	UL FM LPCB
6X3	6.500X3.500	3.45	4.00	
150X100	165.1X114.3	500	102	UL FM
6X4	6.500X4.500	3.45	4.00	
150X25	168.3X33.7	500	102	UL FM
6X1	6.625X1.315	3.45	4.00	
150X50	168.3X60.3	500	102	UL FM VdS
6X2	6.625X2.375	3.45	4.00	
200X40	219.1X48.3	500	127	UL FM
8X1½	8.625X1.900	3.45	5.00	
200X50	219.1X60.3	500	127	UL FM VdS
8X2	8.625X2.375	3.45	5.00	
200X65	219.1X76.1	500	127	UL FM VdS
8X2½	8.625X3.000	3.45	5.00	
200X80	219.1X88.9	500	127	UL FM VdS LPCB
8X3	8.625X3.500	3.45	5.00	
200X100	219.1X114.3	500	127	UL FM
8X4	8.625X4.500	3.45	5.00	

# 240W

**Grooved Concentric** Reducer with Male Thread



Nominal	Pipe	Working	Dimensions	Certificate
Size	O.D	Pressure	L	
mm/in	mm/in	PSI/MPa	mm/in	
65X50	73.0X60.3	500	64	UL FM
2 <sup>1</sup> / <sub>2</sub> X2	2.875X2.375	3.45	2.50	
65X50	76.1X60.3	500	64	UL FM
2 <sup>1</sup> / <sub>2</sub> X2	3.000X2.375	3.45	2.50	
80X25	88.9X33.7	500	64	UL FM
3X1	3.500X1.315	3.45	2.50	
100X50	114.3X60.3	500	76	UL FM
4X2	4.500X2.375	3.45	3.00	



300

Cap





Nominal Size mm/in	Pipe O.D mm/in	O.D Pressure L mm/in PSI/MPa mm/in		Certificate	
25	33.7	500	22.1	UL FM VdS LPCB	
1	1.315	3.45	0.87		
32	42.4	500	23.5	UL FM VdS LPCB	
1¼	1.660	3.45	0.93		
40	48.3	500	23.5	UL FM VdS LPCB	
1½	1.900	3.45	0.93		
50	60.3	500	23.5	UL FM VdS LPCB	
2	2.375	3.45	0.93		
65	73.0	500	23.5	UL FM	
2½	2.875	3.45	0.93		
65	76.1	500	24.5	UL FM VdS LPCB	
2½	3.000	3.45	0.96		
80	88.9 3.500	500 3.45	24 0.94	UL FM VdS LPCB	
100	108.0 4.250	500 3.45	27 1.06	UL FM	
100	114.3	500	27	UL FM VdS LPCB	
4	4.500	3.45	1.06		
25	133.0	500	25.5	UL FM	
5	5.250	3.45	1.00		
125	139.7	500	25.5	UL FM VdS LPCB	
5	5.500	3.45	1.00		
125	141.3	500	25.5	UL FM	
5	5.563	3.45	1.00		
150	159.0	500	27	UL FM	
6	6.250	3.45	1.06		
150	165.1	500	27	UL FM LPCB	
6	6.500	3.45	1.06		
150	168.3	500	24.5	UL FM VdS LPCB	
6	6.625	3.45	0.97		
200	216.3	500	30	UL FM	
8	8.516	3.45	1.18		
200	219.1	500	30	UL FM VdS LPCB	
8	8.625	3.45	1.18		
250	273.0	500	32	UL FM VdS LPCB	
10	10.750	3.45	1.26		
300	323.9	500	32	UL FM VdS	
12	12.750	3.45	1.26		
350	355.6	300	165	_	
14	14.000	2.07	6.50		
400	406.4	300	178	_	
16	16.000	2.07	7.00		
450	457.2	300	203	_	
18	18.000	2.07	8.00		
500	508.0	300	229	_	
20	20.000	2.07	9.00		
600	609.6	300	267	_	
24	24.000	2.07	10.50		

Segmental sizes are made of carbon steel pipe or fabricated from wrought carbon steel. Contact manufacturer for details.












## 300

Cap with Concentric Hole








Nominal Size mm/in	Pipe O.D mm/in	Working Pressure PSI/MPa	Dimensions L mm/in	Certificate
50X25	60.3X33.7	500	23.5	
2X1	2.375X1.315	3.45	0.93	
65X25	76.1X33.7	500	24.5	
2½×1	3.000X1.315	3.45	0.96	
65×40	76.1×48.3	500 3.45	23.5 0.925	UL FM
2½×1½	3.000×1.900			
65X50	76.1X60.3	500	24	
2½×2	3.000X2.375	3.45	0.94	
80X15	88.9X21.3	500	25.4	UL FM
3X1/2	3.500X0.825	3.45	1.00	
80X25	88.9X33.7	500	24	UL FM
3X1	3.500X1.315	3.45	0.94	
80X40	88.9X48.3	500	23.5	UL FM
3X1½	3.500X1.900	3.45	0.925	
80×50	88.9×60.3	500	23.5	UL FM
3×2	3.500×2.375	3.45	0.925	
100×15	114.3×21.3	500	27.0	UL FM
4×1/2	4.500×0.825	3.45	1.06	
100×25	114.3×33.7	500	27.0	UL FM
4×1	4.500×1.315	3.45	1.06	
100X40	114.3X48.3	500	25.4	UL FM
4X1½	4.500X1.900	3.45	1.00	
100×50	114.3×60.3	500	25.4	
4×2	4.500×2.375	3.45	1.00	
125×50	139.7×60.3	500	27	UL FM
5×2	5.500×2.375	3.45	1.06	
150×15	165.1×21.3	500	27	UL FM
6×1/2	6.500×0.825	3.45	1.06	-
150×25	165.1×33.7	500	27	UL FM
6×1	6.500×1.315	3.45	1.06	
150×50	165.1×60.3	500	27	UL FM
6×2	6.500×2.375	3.45	1.06	
150X40	168.3x48.3	500	27	
6X11/2	6.625X1.900	3.45	1.06	
150×50	168.3×60.3	500	27	
6×2	6.625×2.375	3.45	1.06	
200X25	219.1X33.7	500	30	
8X1	8.625X1.315	3.45	1.18	

## 300PX

Cap with Eccentric Hole








Nominal	Pipe	Working	Dimensions	Certificate
Size	O.D	Pressure	L	
mm/in	mm/in	PSI/MPa	mm/in	
65X25	76.1X33.7	500	23.5	_
21/2X1	3000X1.315	3.45	0.925	
65X40	76.1X48.3	500	23.5	_
21/2X11/2	3.000X1.900	3.45	0.925	
80X25	88.9X33.7	500	23.5	
3X1	3.500X1.315	3.45	0.925	
80X40	88.9X48.3	500	23.5	UL FM
3X1½	3.500X1.900	3.45	0.925	
80×50	88.9×60.3	500	23.5	UL FM
3×2	3.500×2.375	3.45	0.925	
100X25	114.3X33.7	500	27	
4X1	4.500X1.315	3.45	1.06	
100X40	114.3X48.3	500	25.4	UL FM
4X1½	4.500X1.900	3.45	1.00	
100×50	114.3×60.3	500	25.4	UL FM
4×2	4.500×2.375	3.45	1.00	
125×40	139.7×48.3	500	25.4	UL FM
5×1½	5.500×1.900	3.45	1.00	
125×50	139.7×60.3	500	25.4	ULFM
5×2	5.500×2.375	3.45	1.00	
150×40	165.1×48.3	500	25.4	UL FM
6×1½	6.500×1.900	3.45	1.00	
150×40	168.3×48.3	500	25.4	UL FM
6×1½	6.625×1.900	3.45	1.00	
150×50	168.3X60.3	500	25.4	UL FM
6×2	6.625X2.375	3.45	1.00	
200×40	219.1×48.3	500	30.2	UL FM
8×1½	8.625×1.900	3.45	1.19	
200×50	219.1×60.3	500	30.2	UL FM
8×2	8.625×2.375	3.45	1.19	

## 321 PN16 Grooved Flange








Nominal	Pipe	Working			Dimension	S		Bol			
Size mm/in	O.D mm/in	Pressure PSI/MPa	A mm/in	B mm/in	C mm/in	D mm/in	E mm/in		SIZE nm	Certificate	
40 1½	48.3 1.900	300 2.07	195 7.68	18.5 0.73	150 5.90	110 4.33	45.4 1.78	2-M10X50	4-M16	UL FM VdS	
50 2	60.3 2.375	300 2.07	220 8.66	18.5 0.73	165 6.50	125 4.92	57.5 2.26	2-M10X50	4-M16	UL FM VdS	
65 76.1	76.1 3.000	300 2.07	235 9.25	18.5 0.73	185 7.28	145 5.71	72.7 2.86	2-M10X50	4-M16	UL FM VdS	
80 3	88.9 3.500	300 2.07	255 10.04	18.5 0.73	195 7.68	160 6.30	85.5 3.37	2-M10X50	8-M16	UL FM VdS	
100 108.0	108.0 4.250	300 2.07	279 10.98	18.5 0.73	220 8.66	180 7.09	104.5 4.11	2-M10X50	8-M16	UL FM	
100 4	114.3 4.500	300 2.07	279 10.98	18.5 0.73	224 8.82	180 7.09	110.5 4.35	2-M10X50	8-M16	UL FM VdS	
125 5	133.0 5.250	300 2.07	312 12.28	21.5 0.85	250 9.84	210 8.27	129.2 5.08	2-M12X65	8-M16	UL FM	
125 5	139.7 5.500	300 2.07	320 12.60	23 0.91	250 9.84	210 8.27	135.5 5.33	2-M12X65	8-M16	UL FM	
150 6	159.0 6.25	300 2.07	346 13.62	21.5 0.85	280 11.00	240 9.45	154.8 6.10	2-M12X65	8-M20	UL FM	
150 6	165.1 6.500	300 2.07	346 13.62	21.5 0.85	280 11.00	240 9.45	160.8 6.33	2-M12X65	8-M20	UL FM	
150 6	168.3 6.625	300 2.07	346 13.62	24 0.94	280 11.00	240 9.45	164.3 6.47	2-M12X65	8-M20	UL FM	
200 8	219.1 8.625	300 2.07	414.3 16.31	30 1.18	340 13.39	295 11.61	214.9 8.46	2-3/8X70 2-M10X70	12-M20	UL FM VdS	
250 10	273.0 10.750	300 2.07	480 18.90	25.5 1.00	405 15.94	355 13.98	268.9 10.59	2-3/8X70 2-M10X70	12-M24	UL FM VdS	
300 12	323.9 12.750	300 2.07	530.5 20.88	25.5 1.00	460 18.11	410 16.14	318.9 12.56	2-3/8X70 2-M10X70	12-M24	UL FM	
350 14	355.6 12.750	300 2.07	580 22.83	30 1.18	520 20.47	470 18.50	350.6 13.80	_	16-M24		
400 16	406.4 16.000	300 2.07	630 24.80	32 1.26	580 22.83	525 20.67	401.5 15.81	_	16-M27	_	
450 18	457.2 18.000	300 2.07	693 27.28	36 1.42	640 25.20	585 23.03	452.2 17.80	_	20-M27	_	
500 20	508.0 20.000	300 2.07	770 30.31	36 1.42	715 28.15	650 25.59	503 19.80	_	20-M30	_	
600 24	609.6 24.000	300 2.07	895 35.24	40 1.57	840 33.07	770 30.31	601.6 23.69	_	20-M33		

#### 321H PN25 Grooved Flange





Nominal	Pipe	Working		C	imension	s		Bolt/			
Size mm/in	O.D mm/in	Pressure PSI/MPa	A mm/in	B mm/in	C mm/in	D mm/in	E mm/in	NoSIZE mm		Certificate	
100 108.0	108.0 4.250	362 2.5	290 11.41	21.5 0.85	230 9.06	190 7.48	104.5 4.11	2-M10X50	8-M20	UL FM	
150 165.1	165.1 6.500	362 2.5	365 14.37	21.5 0.85	300 11.80	250 9.84	160.8 6.33	2-M12X65	8-M24	UL FM	





## 321A ANSI 125/150 Grooved Flange





Nominal	Pipe	Working			imensior			Bolt/	Nut	
Size mm/in	O.D mm/in	Pressure PSI/MPa	A mm/in	B mm/in	C mm/in	D mm/in	E mm/in	NoS		Certificate
50 2	60.3 2.375	300 2.07	206 8.11	19 0.75	152 5.98	121 4.76	57.5 2.26	2-M10X50	4-5/8	UL FM
65 2½	73.0 2.875	300 2.07	230 9.05	19 0.75	178 7.00	140 5.51	69.8 2.74	2-M10X50	4-5/8	UL FM
65 2½	76.1 3.000	300 2.07	230 9.05	19 0.75	178 7.00	140 5.51	72.7 2.86	2-M10X50	4-5/8	
80 3	88.9 3.500	300 2.07	246 9.68	19 0.75	191 7.52	152 5.98	85.5 3.37	2-M10X50	4-5/8	UL FM
100 4	114.3 4.500	300 2.07	280 11.02	19 0.75	229 9.00	191 7.52	110.5 4.35	2-M12X55	8-5/8	UL FM
125 5	141.3 5.563	300 2.07	320 12.60	22 0.87	254 10.00	216 8.50	137.4 5.41	2-M12X65	8-3/4	UL FM
150 6	168.3 6.625	300 2.07	346 13.62	24 0.94	280 11.00	241.3 9.50	164.3 6.47	2-M12X65	8-3/4	UL FM
200 8	219.1 8.625	300 2.07	414.3 16.31	30 1.18	341.4 13.44	298.5 11.75	214.9 8.46	2-3/8X70 2-M10X70	8-3/4	UL FM
250 10	273.0 10.750	300 2.07	481.2 18.94	30.3 1.19	405.6 15.97	361.95 14.25	268.9 10.59	2-3/8X70 2-M10X70	12-7/8	UL FM
300 12	323.9 12.750	300 2.07	553.3 21.78	30.4 1.20	482.6 19.00	431.8 17.00	318.9 12.56	2-3/8X70 2-M10X70	12-7/8	UL FM
350 14	355.6 12.750	300 2.0	590 23.22	37 1.44	535 21.00	476.3 18.75	350.6 13.80		12-1	
400 16	406.4 16.000	300 2.0	650 25.59	37 1.44	595 23.50	539.8 21.25	401.5 15.81		16-1	_
450 18	457.2 18.000	300 2.0	690 27.17	40 1.56	635 25.80	577.8 22.75	452.2 17.80		16-11/8	_
500 20	508.0 20.000	300 2.0	765 30.12	43 1.69	700 27.50	635 25.00	503 19.80	_	20-11/8	
600 24	609.6 24.000	300 2.0	875 34.45	49 1.94	815 32.00	749.3 29.50	601.6 23.69	_	20-11/4	_

#### 321E BS.TABLE'E' Grooved Flange





Nominal	Pipe	Working			imension			Bolt/	Nut	
Size mm/in	O.D mm/in	Pressure PSI/MPa	A mm/in	B mm/in	C mm/in	D mm/in	E mm/in	NoS mr		Certificate
50 2	60.3 2.375	300 2.07	211 8.31	18.5 0.73	150 5.91	114 4.49	57.5 2.26	2-M10X50	4-M16	_
80 3	88.9 3.500	300 2.07	241 9.49	18.5 0.73	185 7.28	146 5.75	85.5 3.37	2-M10X50	4-M16	_
100 4	114.3 4.500	300 2.07	270 10.63	18.5 0.73	216 8.50	178 7.00	110.5 4.35	2-M10X50	8-M16	_
150 6	165.1 6.500	300 2.07	346 13.62	21.5 0.85	280 11.02	235 9.25	160.8 6.33	2-M12X65	8-M20	_
200 8	219.1 8.625	300 2.07	408 16.06	24 0.94	335 13.19	292 11.50	214.9 8.46	2-3/8X70	8-M20	
250 10	273.0 14.000	200 1.4	480 18.90	25.5 1.00	406 16.00	356 14.00	268.9 10.59	_	12-3/4	_
300 12	323.9 10.750	200 1.4	530.5 20.88	25.5 1.00	457 18.00	406 16.00	318.9 12.56		12-7/8	
350 14	355.6 12.750	200 1.4	580 22.83	32 1.26	527 20.75	470 18.50	350.6 13.80	_	12-7/8	_
400 16	406.4 16.000	200 1.4	630 24.80	32 1.26	578 22.76	521 20.51	401.5 15.81	_	12-7/8	_
450 18	457.2 18.000	200 1.4	693 27.28	36 1.42	641 25.24	584 23.00	452.2 17.80	_	16-7/8	_
500 20	508.0 20.000	200 1.4	770 30.31	38 1.50	705 27.76	641 25.24	503 19.80	_	16-7/8	_
600 24	609.6 24.000	200 1.4	880 34.65	42 1.65	826 32.52	756 29.76	601.6 23.69	_	16-11/8	_

## 321G PN16 Adaptor Flange









Nominal	Pipe	Working		Dimer	nsions		Bolt/Nut	
Size mm/in	O.D mm/in	Pressure PSI/MPa	L mm/in	X mm/in	Y mm/in	Z mm/in	NoSIZE mm	Certificate
25 1	33.7 1.327	300 2.0	60.5 2.382	115 4.53	85 3.35	16 0.63	4-M12	UL FM VdS LPCB
32 1¼	42.4 1.669	300 2.0	60.5 2.382	140 5.51	100 3.94	16 0.63	4-M16	UL FM VdS LPCB
40 1½	48.3 1.902	300 2.0	60.5 2.382	150 5.91	110 4.33	16 0.63	4-M16	UL FM VdS LPCB
50 2	60.3 2.375	500 3.45	65 2.559	165 6.50	125 4.92	16 0.63	4-M16	UL FM VdS LPCB
65 21/2	73.0 2.875	500 3.45	65 2.559	165 6.50	145 5.70	16 0.63	4-M16	UL FM
65 76.1	76.1 3.000	500 3.45	65 2.559	185 7.28	145 5.70	16 0.63	4-M16	UL FM VdS LPCB
80 3	88.9 3.500	500 3.45	65 2.559	200 7.87	160 6.30	16 0.63	8-M16	UL FM VdS LPCB
100 108.0	108.0 4.250	300 2.0	70 2.756	220 8.66	180 7.09	16 0.63	8-M16	UL FM
100 4	114.3 4.500	300 2.0	70 2.756	220 8.66	180 7.09	16 0.63	8-M16	UL FM VdS LPCB
125 133.0	133 5.250	300 2.0	70 2.756	250 9.84	210 8.27	18 0.71	8-M16	UL FM
125 139.7	139.7 5.500	300 2.0	70 2.756	250 9.84	210 8.27	18 0.71	8-M16	UL FM VdS LPCB
150 159.1	159.0 6.250	500 3.45	70 2.756	285 11.22	240 9.45	18 0.71	8-M20	UL FM
150 165.1	165.1 6.500	500 3.45	70 2.756	285 11.22	240 9.45	18 0.71	8-M20	UL FM LPCB
150 6	168.3 6.625	500 3.45	70 2.756	285 11.22	240 9.45	18 0.71	8-M20	UL FM VdS LPCB
200 8	219.1 8.625	300 2.0	80 3.150	340 13.39	295 11.61	19 0.75	12-M20	UL FM VdS LPCB
250 10	273.0 10.750	300 2.0	85 3.346	405 15.94	355 13.98	21 0.83	12-M24	UL FM VdS
300 12	323.9 12.750	225 1.6	90 3.543	460 18.11	410 16.14	24 0.94	12-M24	UL FM VdS
350 14	377.0 14.843	225 1.6	100 3.937	520 20.47	470 18.50	25 1.00	16-M24	UL FM
400 16	426.0 16.772	225 1.6	110 4.331	580 22.83	525 20.67	27 1.06	16-M27	UL FM
450 18	480 18.897	225 1.6	115 4.528	640 25.196	585 23.03	20 0.787	20-M27	_

## 321GH PN25 Adaptor Flange







Nominal	Pipe	Working		Dimensions			Bolt/Nut	
Size mm/in	O.D mm/in	Pressure PSI/MPa	L mm/in	X mm/in	Y mm/in	Z mm/in	NoSIZE mm	Certificate
100 108.0	108.0 4.250	362 2.5	70 2.756	230 9.05	190 7.48	18 0.71	8-M20	UL FM
100 4	114.3 4.500	362 2.5	70 2.756	235 9.25	190 7.48	16 0.63	8-M20	UL FM
150 159.0	159.0 6.250	362 2.5	70 2.756	300 11.80	250 9.85	20 0.79	8-M24	UL FM
150 165.1	165.1 6.500	362 2.5	70 2.756	300 11.80	250 9.84	18 0.71	8-M24	UL FM
200 8	219.1 8.625	362 2.5	80 3.150	360 14.17	310 12.20	19 0.75	12-M24	UL FM
250 10	273.0 10.75	362 2.5	85 3.346	425 16.73	370 14.57	22 0.87	12-M27	_
300 12	323.9 12.750	362 2.5	88 3.46	485 19.09	430 16.93	23.5 0.93	16-M27	_
350 14	355.6 12.750	362 2.5	100 3.94	555 21.85	490 19.29	26 1.02	16-M30	_
400 16	406.4 16.000	362 2.5	110 4.33	620 24.41	550 21.65	28 1.10	16-M33	_



321GA ANSI 125/150 Adaptor Flange Class 125/150







Nominal	Pipe	Working		Dimer	nsions		Bolt/Nut	
Size mm/in	O.D mm/in	Pressure PSI/MPa	L mm/in	X mm/in	Y mm/in	Z mm/in	NoSIZE mm	Certificate
50 2	60.3 2.375	300 2.07	65 2.559	152 6.0	120.5 4.74	16 0.63	4-5/8	UL FM
65 2½	73.0 2.875	300 2.07	65 2.559	185 7.28	139.7 5.50	16 0.63	4-5/8	UL FM
80 3	88.9 3.500	300 2.07	65 2.559	200 7.87	152.4 6.00	16 0.63	8-5/8	UL FM
100 4	114.3 4.500	300 2.07	70 2.756	229 9.01	190.5 7.50	16 0.63	8-5/8	UL FM
150 6	168.3 6.625	300 2.07	70 2.756	282 11.10	241.3 9.50	18 0.71	8-3/4	UL FM
200 8	219.1 8.625	300 2.07	75 2.953	340 13.39	298.5 11.75	19 0.75	8-3/4	UL FM
250 10	273.0 10.75	300 2.07	85 3.35	406 15.98	362 14.25	21 0.826	12-7/8	UL FM
350 14	355.6 12.750	300 2.0	127 5.00	535 21.00	476.3 18.75	37 1.44	12-1	
400 16	406.4 16.000	300 2.0	127 5.00	595 23.50	539.8 21.25	37 1.44	16-1	_
450 18	457.2 18.000	300 2.0	140 5.50	642 25.28	577.8 22.75	40 1.56	16-11/8	_
500 20	508.0 20.000	300 2.0	152 6.00	700 27.50	635 25.00	43 1.69	20-11/8	_
600 24	609.6 24.000	300 2.0	152 6.00	815 32.00	749.3 29.50	49 1.94	20-11/4	_

340 13.39

405 15.94

75 2.95

85 3.346

295 11.61

350 13.78

19 0.75

21 0.83

No.-SIZE mm

8-M20

12-M20

UL FM

UL FM

## 321GL PN10 Adaptor Flange



0	
1	-12/







Pipe O.D mm/in

219.1 8.625

273.0 10.750

323.9 12.750

## 321G BS.TABLE 'E' Adaptor Flange






W.	

Nominal	Pipe	Working		Dime	nsions		Bolt/Nut	
Size mm/in	O.D mm/in	Pressure PSI/MPa	L mm/in	X mm/in	Y mm/in	Z mm/in	NoSIZE mm	Certificate
50 2	60.3 2.375	225 1.6	65 2.56	152 5.98	114 4.49	16 0.63	4-M16	_
65 76.1	76.1 3.000	225 1.6	70 2.756	165 6.50	127 5.00	16 0.63	4-M16	_
80 3	88.9 3.500	225 1.6	70 2.756	184 7.24	146 5.75	16 0.63	4-M16	
100 4	114.3 4.500	225 1.6	70 2.756	216 8.50	178 7.00	16 0.63	8-M16	FM
150 165.1	165.1 6.500	225 1.6	70 2.756	280 11.02	235 9.25	21 0.71	8-M20	FM
200 8	219.1 8.625	225 1.6	102 4.02	337 13.27	292 11.50	19 0.75	8-M20	_
250 10	273.0 10.75	225 1.6	85 3.35	405 15.94	356 14.02	25 0.98	12-M20	_
300 12	323.9 10.750	200 1.4	102 4.02	457 18.00	406 16.00	25.5 1.00	12-7/8	_
350 14	355.6 12.750	200 1.4	127 5.00	527 20.75	470 18.50	32 1.26	12-7/8	_
400 16	406.4 16.000	200 1.4	127 5.00	578 22.76	521 20.51	32 1.26	12-7/8	_
450 18	457.2 18.000	200 1.4	140 5.50	641 25.24	584 23.00	36 1.42	16-7/8	_

321GJ JIS 10K Adaptor Flange



Nominal				Dimer	nsions		Bolt/Nut	
Size mm/in	O.D mm/in	Pressure PSI/MPa	L mm/in	X mm/in	Y mm/in	Z mm/in	NoSIZE mm	Certificate
65 2½	76.3 3.00	145 1.0	65 2.559	175 6.89	140 5.51	18 0.71	4-M16	_
80 3	89.1 3.50	145 1.0	65 2.559	185 7.28	150 5.91	18 0.71	8- M16	_
100 4	114.3 4.50	145 1.0	70 2.756	210 8.27	175 6.89	18 0.71	8- M16	_
125 5	139.8 5.50	145 1.0	70 2.756	250 9.84	210 8.27	20 0.79	8-M20	_
150 6	165.2 6.50	145 1.0	70 2.756	280 11.02	240 9.45	20 0.79	8- M20	_







Nominal	Pipe O.D	Working		Dimer	nsions		Bolt/Nut	
Size mm/in	O.D mm/in	Pressure PSI/MPa	L mm/in	X mm/in	Y mm/in	Z mm/in	NoSIZE mm	Certificate
80 3	88.9 3.500	225 1.6	65 2.559	200 7.87	160 6.30	17 0.67	8-M20	_
100 4	114.3 4.500	225 1.6	70 2.756	225 8.86	185 7.28	19 0.75	8-M20	_
150 165.1	165.1 6.500	225 1.6	70 2.756	305 12.00	260 10.236	21 0.827	12-M22	_







321GJ JIS 20K Adaptor Flange

Nominal	Pipe	Working		Dimer	nsions		Bolt/Nut	
Size mm/in	O.D mm/in	Pressure PSI/MPa	L mm/in	X mm/in	Y mm/in	Z mm/in	NoSIZE mm	Certificate
100 4	114.3 4.500	300 2.0	70 2.756	225 8.86	185 7.28	19 0.75	8-M20	_
150 165.1	165.1 6.500	300 2.0	70 2.756	305 12.00	260 10.236	21 0.827	12-M22	_







#### **Gasket Data**









Gasket	Name	Temperature Range	General Service Recommendations	Color Mark
E	EPDM	-34~+110°C (-30~+230°F)	Recommended for hot water service within the specified temperature range plus a variety of dilute acids,oil-free air and many chemical services.UL classified in accordance with ANSI/NSF 61or cold+86° F(+30°) and hot +180° F(+82°C) potable water service.Not recommended for petroleum service.	Black Green Strip
D	NBR	-29~+82°C (-20~+180°F)	Recommended for petroleum products, air with oil vapors, vegetable and mineral oils within the specified temperature range. Not recommended for hot water services.	Orange Strip
S	Silicone	-40~+177°C (-40~+350° F)	Recommended for high temperature dry air and some high temperature chemical products.	White








































#### **ANSI Heavy Hex Nut**








- 1. Material: SAE J995 2.
- 2.Thread: ANSI B 1.1-1982, class 2B.
- 3.Surface Treatment: Zinc electroplated per ASTM B633 CLASS FE/ZN5 TYPE III, thickness ≥5 µ m per class SC1.

d	F		(	3	н	
u	Min	Max	Min	Max		Max
3/8-16UNC	16.99	17.47	19.38	20.17	8.66	9.57
1/2-13UNC	21.59	22.22	24.61	25.65	11.78	12.80
5/8-11UNC	26.19	26.97	29.85	31.16	14.90	16.02
3/4-10UNC	30.78	31.75	35.10	36.65	18.03	19.25
7/8-9UNC	35.41	36.53	40.36	42.16	21.16	22.48

#### Metric Heavy Hex Nut







- 2.Thread: ISO 261, tolerance 6h for M10& M12, 7h for M16 and above.
- 3. Surface Treatment: Zinc Electroplated followed by a yellow chromate dip per ISO 2081 FE/ZN5, ISO4520 CLASS 1A.

d	1	=	G	н		
a	Min	Max	Min	Min	Max	
M10	15.73	16.0	17.7	8.0	8.4	
M12	21.16	22.0	23.9	9.34	10.0	
M16	23.16	24.0	26.17	14.1	15.9	
M20	29.16	30.0	32.95	16.9	19.0	
M22	33.0	34.0	37.29	18.1	20.2	

#### Hexagon Flange Nut







#### Dimension according to DIN6923.

d	:	5	D	h		
a	Min	Max	Max	Min	Max	
M8	12.3	13	17.9	7.6	8	
M10	14.73	15.0	21.8	9.64	10	
M12	17.73	18.0	26.0	11.57	12.0	

## 

#### **ANSI Oval Neck Track Bolt**




- 1.Material: SAE J429 5.
- 2.Thread: UNC thread per ANSI B 1.1 Class 2A.
- 3.Surface Treatment: Silver chromate electroplated per ASTM B633 CLASS FE/ZN5 TYPE III, thickness ≥5 µ m per class SC1.

					L
3/8-16UNC	19	13.9	9.50	6.0	55/70
1/2-13UNC	22.5	16	12.70	8.0	70/75
5/8-11UNC	27.4	19.8	15.90	10.0	80/85/105
3/4-10UNC	32.5	26.2	19.05	12.0	115/120
7/8-9UNC	37.7	28.8	22.20	14.0	125/140

#### Metric Oval Neck Track Bolt





- 1.Material: ISO 898-1:1992 \ GB/T3098.1-2000 Class 8.8.
- 2.Thread: ISO metric thread per ISO 261, tolerance 6h.
- 3.Surface Treatment: Yellow chromate electroplated per ISO 2081 FE/ZN5, ISO4520 CLASS 1A.

d	A	С	F	н	L
M10	18.5	13.5	9.5	5	50/57/63/70/89
M12	23.5	17.5	12.3	8	70/76/82/89/108
M16	29.5	20.5	15.7	10	85/89/95/108
M20	38	27	18.3	12.5	110/115
M22	42.2	31	21.4	14	125/140/150






















## Hole Diameter of pipe





Hole-cutting Machine


Run Nominal Sine mm/in	Outlet Nominal Size mm/in	Hole Dia. +3.2,0+0.13,0 mm/in	Run Nominal Size mm/in	Outlet Nominal Size mm/in	Hole Dia. +3.2,0+0.13,0 mm/in	Run Nominal Size mm/in	Outlet Nominal Size mm/in	Hole Dia. +3.2,0+0.13,0 mm/in
	10 3/8			15 1/2			15 1/2	
25	15 1/2	23.5		20 3/4	38 1.50 A89		20 3/4	38 1.50 A89
1"/33.7	20 3/4	0.925 A89	80	25 1			25 1	
	25 1		3"/88.9	32 11/4	51		32 11/4	51
	10 3/8			40 11/2	2.00 A102	150 159.0 165.1	40 11/2	2.00 A102
32	15 1/2			50 2	64 2.50 A114	6"/168.3	50 2	64 2.50 A114
11/4"/42.4	20 3/4		100 108.0 47/114.3	15 1/2			65 21/2/76	70 2.75 A120 89 3.50 A140
	25 1			20 3/4	38 1.50 A89		80 3	
40	10 3/8	30 1.18 A89 38 1.50 A89		25 1	700		100 108.0/4	114 4.50 A165
	15 1/2			32 11/4	51		25 1	38 1.50 A89
11/2"/48.3	20 3/4			40 11/2	2.00 A102		32 11/4	51
	25 1			50 2	64 2.50 A114	200 8"/219.1 250 10"/273.0	40 11/2	2.00 A102
	15 1/2			65 21/2/76	70 2.75 A120		50 2	64 2.50 A114
	20 3/4			80 3	89 3.50 A140		65 21/2/76	70 2.75 A120
50 2"/60.3	25 1	, Aug		15 1/2	Alau		80 3	89 3.50 A140
	32 11/4	45		20 3/4	38 1.50 A89		100 108.0/4	114 4.50 A165
	40 11/2	1.75 A102		25 1	700			Allo
	15 1/2		125 133.0 139.7	32 11/4	51			
65 21/2 <sup>-</sup> /73.0 76.1	20 3/4	38 1.50 A89	5*/141.3	40 11/2	2.00 A102			
	25 1	, no		50 2	64 2.50 A114			
	32 11/4	51		65 21/2/76	70 2.75 A120			
	40 11/2	2.00 A102		80 3	89 3.50 A140			

The outside surface of the pie within 16mm from the hole must be clean and smooth.



#### **Roll Groove Dimensions**





Roll Grooving Machine

Nominal		Pipe OD		Gasket seat A	Groove Width B	Gro	ove Dia C	Groove Depth	MaxAllow Flare	Min.Allow wall
Size	Basic		rence	±0.76/±0.03	±0.76/±0.03	Basic	Tolerence	D(ref)	Dia F	thickness T
mm/in	mm/in		n/in	mm/in	mm/in	mm/in	mm/in	mm/in	mm/in	mm/in
25	33.7	+0.41	-0.68	15.88	7.14	30.23	-0.38	1.60	34.5	1.8
1	1.327	+0.016	-0.026	0.625	0.281	1.190	-0.015	0.063	1.358	0.071
32	42.4	+0.50	-0.60	15.88	7.14	38.99	-0.38	1.60	43.3	1.8
11/4	1.669	0.020	-0.023	0.625	0.281	1.535	-0.015	0.063	1.705	0.071
40	48.3	+0.44	-0.52	15.88	7.14	45.09	-0.38	1.60	49.4	1.8
11/2	1.900	0.017	-0.020	0.625	0.281	1.775	-0.015	0.063	1.945	0.071
50	60.3	+0.61	-0.61	15.88	8.74	57.15	-0.38	1.60	62.2	1.8
2	2.375	+0.024	-0.024	0.625	0.344	2.250	-0.015	0.063	2.449	0.071
65	73.0	+0.74	-0.74	15.88	8.74	69.09	-0.46	1.98	75.2	2.3
2-1/2	2.875	+0.029	-0.029	0.625	0.344	2.720	-0.018	0.078	2.961	0.091
65	76.1	+0.76	-0.76	15.88	8.74	72.26	-0.46	1.99	77.7	2.3
2½	3.000	+0.030	-0.030	0.625	0.344	2.845	-0.018	0.078	3.059	0.091
80	88.9 3.500	+0.89	-0.79 -0.031	15.88 0.625	8.74 0.344	84.94 3.344	-0.46 -0.018	1.98 0.078	90.6 3.567	2.3 0.091
100	108.0	+1.07	-0.79	15.88	8.74	103.73	-0.51	2.11	109.7	2.3
4	4.250	+0.042	-0.031	0.625	0.344	4.084	-0.020	0.083	4.319	0.091
100	114.3	+1.14	-0.79	15.88	8.74	110.08	-0.51	2.11	116.2	2.3
4	4.500	+0.045	-0.031	0.625	0.344	4.334	-0.020	0.083	4.575	0.091
125	133.0	+1.32	-0.79	15.88	8.74	129.13	-0.51	2.11	134.9	2.9
5	5.250	+0.052	-0.031	0.625	0.344	5.084	-0.020	0.083	5.311	0.114
125	139.7	+1.40	-0.79	15.88	8.74	135.48	-0.51	2.11	141.7	2.9
5	5.500	+0.055	-0.031	0.625	0.344	5.334	-0.020	0.083	5.579	0.114
125	141.3	+1.42	-0.79	15.88	8.74	137.03	-0.56	2.13	143.5	2.9
5	5.563	+0.056	-0.031	0.625	0.344		-0.022	0.084	5.650	0.114
150	159.0	+1.60	-0.79	15.88	8.74	154.50	-0.56	2.16	161.0	2.9
6	6.250	+0.063	-0.031	0.625	0.344	6.083	-0.022	0.085	6.339	0.114
150	165.1	+1.60	-0.79	15.88	8.74	160.8	-0.56	2.16	167.1	2.9
6	6.500	+0.063	-0.031	0.625	0.344	6.330	-0.022	0.085	6.579	0.114
150	168.3	+1.60	-0.79	15.88	8.74	163.96	-0.56	2.16	170.7	2.9
6	6.625	+0.063	-0.031	0.625	0.344	6.455	-0.022	0.085	6.720	0.114
200A	216.3	+1.60	-0.79	19.05	11.91	211.60	-0.64	2.35	219.8	2.9
8	8.516	+0.063	-0.031	0.750	0.469	8.331	-0.025	0.093	8.653	0.114
200	219.1	+1.60	-0.79	19.05	11.91	214.40	-0.64	2.34	221.5	2.9
8	8.625	+0.063	-0.031	0.750	0.469	8.441	-0.025	0.092	8.720	0.114
250A	267.4	+1.60	-0.79	19.05	11.91	262.60	-0.69	2.40	270.9	3.6
10	10.528	+0.063	-0.031	0.750	0.469	10.339	-0.027	0.095	10.665	0.142
250	273.0	+1.60	-0.79	19.05	11.91	268.28	-0.69	2.39	275.4	3.6
10	10.750	+0.063	-0.031	0.750	0.469	10.562	-0.027	0.094	10.842	0.142
300A	318.5	+1.60	-0.79	19.05	11.91	312.90	-0.76	2.77	322.0	4.0
12	12.539	+0.063	-0.031	0.750	0.469	12.319	-0.030	0.109	12.677	0.158
300	323.9	+1.60	-0.79	19.05	11.91	318.29	-0.76	2.77	326.2	4.0
12	12.750	+0.063	-0.031	0.750	0.469	12.531	-0.030	0.109	12.842	0.158
350	355.6	+1.60	-0.79	23.83	11.91	350.04	-0.76	2.77	359.7	4.0
14	14.000	+0.063	-0.031	0.938	0.469	13.781	-0.030	0.109	14.16	0.158
350	377.0	+1.60	-0.79	23.83	11.91	371.44	-0.76	2.77	379.5	4.5
14	14.842	+0.063	-0.031	0.938	0.469	14.623	-0.030	0.109	14.941	0.177
400	406.4	+1.60	-0.79	23.83	11.91	400.84	-0.76	2.77	410.5	4.2
16	16.000	+0.063	-0.031	0.938	0.469	15.781	-0.030	0.109	16.16	0.165
400	426.0	+1.60	-0.79	23.83	11.91	420.46	-0.76	2.77	428.5	4.5
16	16.772	+0.063	-0.031	0.938	0.469	16.553	-0.030	0.109	16.870	0.177
450	457.2	+1.60	-0.79	25.40	11.91	451.64	-0.76	2.77	461.3	4.2
18	18.000	+0.063	-0.031	1.000	0.469	17.781	-0.030	0.109	18.16	0.165
450	480	+1.60	-0.79	25.40	11.91	469	-0.76	5.50	484.1	4.2
18	18.897	+0.063	-0.031	1.000	0.469	18.465	-0.030	0.216	19.06	0.165
500	508.0	+1.60	-0.79	25.40	11.91	502.44	-0.76	2.77	512.1	4.8
20	20.000	+0.063	-0.031	1.000	0.469	19.781	-0.030	0.109	20.16	0.188
500	530	+1.60	-0.79	25.40	11.91	522	-0.76	4.0	535.1	5.0
20	20.866	+0.063	-0.031	1.000	0.469	20.55	-0.030	0.157	21.067	0.197
600	609.6	+1.60	-0.79	25.40	12.7	600.9	0.76	4.35	614.7	4.8
24	24.000	+0.063	-0.031	1.000	0.500	23.656	-0.030	0.172	24.20	0.188
600	630	+1.60	-0.79	25.40	12.7	620.9	0.76	4.55	635.1	4.8
24	24.803	+0.063	-0.031	1.000	0.500	24.445	-0.030	0.179	25.00	0.188



## Pressure Ratings and End Loads for Mech Couplings on Steel Pipe







1GS L/Duty Rigid

				10	;	1GS	;	1NR	
Nom. Size	Pipe O.D	Pipe Sched	Wall Thick.	Roll Gre	poved	Roll Grooved		Roll Grooved	
				Max.Work Press.	Max.End Load	Max.Work Press.	Max.End Load	Max.Work Press.	Max.End Load
DN/in	mm	(Sch)	mm	Bar/Psi	kN/Lbs	Bar/Psi	kN/Lbs	Bar/Psi	kN/Lbs
25	22.7	40	3.38	35/500	3.0/680	-	-	20/300	1.8/410
25	33.7	10	2.77	35/500	3.0/680		-	20/300	1.8/410
32	42.4	40	3.56	35/500	4.8/1080	-		20/300	2.9/650
32	42.4	10	2.77	35/500	4.8/1080	-	-	20/300	2.9/650
40	48.3	40	3.68	35/500	6.3/1420	-	-	20/300	3.8/850
40	40.3	10	2.77	35/500	6.3/1420	-		20/300	3.8/850
		40	3.91	35/500	9.8/2210	-		20/300	5.9/1330
50	60.3	10	2.77	35/500	9.8/2210	-	-	20/300	5.9/1330
		40	5.16	35/500	14.4/3240	-		20/300	8.7/1950
65	73	10	3.05	35/500	14.4/3240	-		20/300	8.7/1950
			6.35	-		-			-
65	76.1		5.08	35/500	15.7/3520	-		20/300	9.4/2120
			3.81	35/500	15.7/3520	-		20/300	9.4/2120
		40	5.49	35/500	21.4/4810	24/350	15.0/3360	20/300	12.8/2885
80	88.9	10	3.05	35/500	21.4/4810	24/350	15.0/3360	20/300	12.8/2885
		40	6.02	35/500	35.4/7960	24/350	24.7/5560	20/300	21.2/4770
100	114.3	10	3.05	35/500	35.4/7960	24/350	24.7/5560	20/300	21.2/4770
		40	6.55	35/500	54.1/12100	24/350	37.8/8490	20/300	32.4/7290
125	141.3	10	3.4	35/500	54.1/12100	24/350	37.8/8490	20/300	32.4/7290
450	405.4		6.35	35/500	73.8/16610	24/350	51.6/11600	20/300	44.3/9960
150	165.1		5.08	35/500	73.8/16610	24/350	51.6/11600	20/300	44.3/9960
		40	7.11	35/500	76.7/17260	24/350	53.6/12000	20/300	46.0/10340
150	168.3	10	3.4	35/500	76.7/17260	24/350	53.6/12000	20/300	46.0/10340
		40	8.18	31/450	116.9/26280	24/350	90.8/20430	-	
200	219.1	30	7.04	31/450	116.9/26280	24/350	90.8/20430	-	-
		10	4.77	20/300	77.8/17500	24/350	90.8/20430	-	-
		40	9.27	28/400	163.8/36800	-			-
250	273	30	7.8	20/300	121.0/27210	-	-		-
		10	4.77	20/300	121.0/27210	-	-		-
		40	10.31	28/400	230.6/51880	-	-		-
200	202.0	STD	9.53	20/300	170.3/38280	-			-
300	323.9	30	6.35	20/300	170.3/38280	-	-		-
		10	4.77	20/300	170.3/38280	-			

# ( C S C C C VAS VAS VAS VAS NSF/ANSI 61 NSF/ANSI 372 ACS DVC V VIS 6 6 6 6

## Pressure Ratings and End Loads for Mech Couplings on Steel Pipe







1NH Heavy Duty Flexible

321 Flange

				1N					
Nom. Size	Pipe O.D	Pipe Sched	Wall Thick.	Roll Gro		Roll Gro	oved	Roll Gro	ooved
				Max.Work Press.	Max.End Load	Max.Work Press.	Max.End Load	Max.Work Press.	Max.End Load
DN/in	mm	(Sch)	mm	Bar/Psi	kN/Lbs	Bar/Psi	kN/Lbs	Bar/Psi	kN/Lbs
25	33.7	40	3.38	35/500	3.0/680	-	-		-
25	33.1	10	2.77	35/500	3.0/680	-	-		-
32	42.4	40	3.56	35/500	4.8/1080	-	-	-	-
32	42.4	10	2.77	35/500	4.8/1080	-	-		-
40	40.2	40	3.56	35/500	6.3/1420	-	-	16/225	3.2/710
40	48.3	10	2.77	35/500	6.3/1420	-	-	16/225	3.2/710
		40	3.91	35/500	9.8/2210	52/750	14.8/3320	16/225	4.4/1000
50	60.3	10	2.77	35/500	9.8/2210	35/500	9.8/2210	16/225	4.4/1000
		40	5.16	35/500	14.4/3240	52/750	21.6/4860	20/300	5.9/1330
65	73	10	3.05	35/500	14.4/3240	35/500	14.4/3240	20/300	5.9/1330
			6.35			-	-		
65	76.1		5.08	35/500	15.7/3520	52/750	23.5/5280	16/225	7.1/1590
			3.81	35/500	15.7/3520	35/500	15.7/3530	16/225	7.1/1590
		40	5.49	35/500	21.4/4810	52/750	32.1/7210	16/225	9.6/2165
80	88.9	10	3.05	35/500	21.4/4810	35/500	21.4/4800	16/225	9.6/2165
		40	6.02	35/500	35.4/7960	52/750	53.0/11900	16/225	15.9/3580
100	114.3	10	3.05	35/500	35.4/7960	35/500	35.4/7950	16/225	15.9/3580
		40	6.55	35/500	54.1/12100	52/750	81.0/18200	20/300	31.3/7035
125	141.3	10	3.4	35/500	54.1/12100	31/450	48.6/10930	20/300	31.3/7035
		-	6.35	35/500	73.8/16610	52/750	110.6/24800	16/225	33.2/7460
150	165.1		5.08	35/500	73.8/16610	31/450	66.4/14930	16/225	33.2/7460
		40	7.11	35/500	76.7/17260	52/750	115.0/25800	16/225	34.5/7750
150	168.3	10	3.4	35/500	76.7/17260	31/450	68.9/15500	16/225	34.5/7750
		40	8.18	31/450	116.9/26280	52/750	194.8/43800	16/225	58.4/13140
200	219.1	30	7.04	31/450	116.9/26280	35/500	130.0/29250	16/225	58.4/13140
		10	3.76	20/300	77.8/17500	20/300	77.8/17500	16/225	58.4/13140
		40	9.27	20/300	121.0/27210		-	16/225	90.8/20410
250	273	30	6.35	20/300	121.0/27210		-	16/225	90.8/20410
		10	4.19	20/300	121.0/27210		-	16/225	90.8/20410
		40	10.31	20/300	170.3/38280		-	16/225	127.7/28710
		STD	9.53	20/300	170.3/38280	-	-	16/225	127.7/28710
300	323.9	20	6.35	20/300	170.3/38280	-	-	16/225	127.7/28710
		10	4.57	20/300	170.3/38280	_		16/225	127.7/28710





#### Installation Instruction For Rigid & Flexible Coupling



#### 1.Pipe preparation

Check pipe end for proper groove dimensions and to assure that pipe end is free of indentations and projections that would prevent proper sealing.



#### 2.Lubricate gasket

Check gasket to be sure it's compatible for the intended service. Apply thin lubricant to the outside and sealing lips of the gasket.



3.Gasket installation

Slip the gasket over one pipe, making sure the gasket lip does not over-hang the pipe end.



#### 4.Alignment

After aligning two pipe ends together, pull the gasket into position, centering between the grooves on each pipe. The gasket should not extend into the groove on either pipe.



#### 5. Housing installation

Romove one bolt&nut and loosen the other nut. Place one housing over the gasket, making sure the housing keys fit into the pipe grooves. Swing the other housing over the gasket and into the grooves on both pipes. Re-insert the bolt and connect two housings.



Firstly hand tighten nuts and make sure oval neck bolt completely fits into bolt hole. Then securely tighten nuts alternatively and equally to the specified bolt torque by using spanner.



7 a. Assembly completed- Rigid Coupling

For Rigid Coupling, keep the gaps at bolt pads evenly spaced. Gaskets can't be seen visually.




7 b. Assembly completed- Flexible Coupling

For Flexible Coupling, two housings should be iron to iron connected. Gaskets can't be seen visually.

#### Caution

Proper torquing of bolts is required to obtain specified performance.

- Over torquing the bolts may result in damage to the bolt and / or casting which could result in pipe joint separation.
- Under torquing the bolts may result in lower pressure retention capabilities, lower bend load capabilities, joint leakage and pipe joint separation. Pipe joint separation may result in significant property damage and serious injury.



#### Installation Instruction For Threaded & Grooved Mechanical Tee



#### 1. Pipe preparation

Clean the gasket sealing surface within 16mm of the hole and visually inspect the sealing surface for defects that may prevent proper sealing of the gasket. Don't drill



2.Remove burrs

If any burrs or slug exists at the pipe hole, please remove them before assembly, to protect the gasket and avoid leakage.



3. Gasket installation

Insert the gasket into outlet housing making sure the tab in the gasket line up with the tab recesses in the housing. Align outlet housing over the pipe hole making sure that the locating collar is



4.Alignment

Align the strap around the pipe, inser the bolts and tighten the nuts finger tight.



5. Tighten nuts

Alternatively and evenly tighten the nuts to the specified bolt torque.



6.Assembly completed

There should be even gaps on two sides between upper and

#### Caution

Proper torquing of bolts is required to obtain specified performance.

- Over torquing the bolts may result in damage to the bolt and / or casting which could result in pipe joint separation.
- Under torquing the bolts may result in lower pressure retention capabilities, lower bend load capabilities, joint leakage and pipe joint separation. Pipe joint separation may result in significant property damage and serious injury.

Specified Bolt Torque								
ANSI BOLTS								
Bolt Size Specified Bolt Torque								
Inch	Lbs-Ft.	N.m						
3/8	30-45	40-60						
1/2	80-100	110-135						
5/8	100-130	135-175						
3/4								
7/8								





















































72

#### Installation Instruction For U-Bolt Mechanical Tee



#### 1.Pipe preparation

Clean the gasket sealing surface within 16mm of the hole and visually inspect the sealing surface for defects that may prevent proper sealing of the gasket. Don't drill the hole on weld line



2.Remove burrs

If any burrs or slug exists at the pipe hole, please remove them before assembly, to protect the gasket and avoid leakage.



3.Gasket installation

Insert the gasket into outlet housing properly. Align outlet housing over the pipe hole making sure that the locating collar is in the pipe hole.



Attach the U-bolt from the other side and tighten the nuts finger tight.



5. Tighten nuts

Alternatively and evenly tighten the nuts to the specified bolt torque.



6.Assembly completed

Assembly completed.

#### Caution

Proper torquing of bolts is required to obtain specified performance.

- Over torquing the bolts may result in damage to the bolt and / or casting which could result in pipe joint separation.
- Under torquing the bolts may result in lower pressure retention capabilities, lower bend load capabilities, joint leakage and pipe joint separation. Pipe joint separation may result in significant property damage and serious injury.

Specified Bolt Torque							
ANSI BOLTS							
Bolt Size Specified Bolt Torque							
Inch	Lbs-Ft.	N.m					
3/8	20-30	30-40					
1/2	80-100	110-135					
5/8	100-130	135-175					
3/4							
7/8							

#### Installation Instruction For Grooved Flange




1.Pipe preparation

Check pipe end for proper groove dimensions and to assure that pipe end is free of indentations and projections that would prevent proper sealing.



2.Lubricate gasket

Check gasket to be sure it's compatible for the intended service. Apply thin lubricant to the outside and sealing lips of the gasket.



3.Gasket installation

Slip the gasket over pipe end, with the gasket opening side towards "A". Make sure the gasket sealing lip is even with pipe



4. Housing installation

Romove bolts and nuts, place two housings over the gasket, making sure the housing keys fit into the pipe grooves. Re-insert the bolts and hand tighten the nuts.



5. Tighten nuts

Securely tighten nuts alternatively and equally to the specified bolt torque by using spanner.



#### 6.Connect mating flange

Align flange bolt holes with mating flange (or valve) bolt holes. Insert a standard flange bolt through bolt hole and hand tighten a nut. Insert another bolt opposite the first and hand tighten a nut. Continue this until all bolt holes are fitted. Tighten nuts evenly to specified bolt torque, so flange faces remain parallel. Assembly completed

#### Caution

Proper torquing of bolts is required to obtain specified performance.

- Over torquing the bolts may result in damage to the bolt and / or casting which could result in pipe joint separation.
- Under torquing the bolts may result in lower pressure retention capabilities, lower bend load capabilities, joint leakage and pipe joint separation. Pipe joint separation may result in significant property damage and serious injury.

	Specified Bolt Torque						
	ANSI BOLTS						
Bolt Size	Bolt Size Specified Bolt Torque						
Inch	Lbs-Ft.	N.m					
M10	30-45	40-60					
M12	80-100	110-135					
M16							
M20							
M22							
M24							



















































#### Flexible Coupling


1.A flexible coupling accommodates pipe deflection and or non-alignment as below: If nominal diameter <DN200, deflection angle is ≥1°; If nominal diameter ≥DN200, deflection angle is ≥0.5° but <1°.


4. With the removal of just a few bolts you can easily access the system for cleaning, maintenance, changes or system expansion.

2.The C-shaped rubber gasket

provides excellent self-sealing capabilities in both low and high pressure service as well as under certain vacuum conditions.


3. The design and construction of the coupling with elastomeric gaskets can provide significant noise and vibration absorption as well as seismic stress.



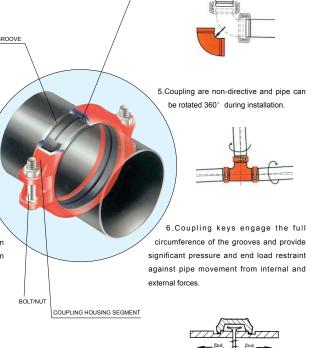

#### Rigid Coupling

1.The T&G mechanism in combination with a slightly shortened key diameter provides a mechanical and frictional interlock resulting in a rigid joint which reduces undesired angular

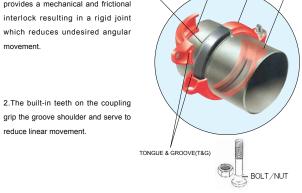

BUILT-IN TOOTH HOUSING COUPLING HOUSING SEGMENT


3.The T&G mechanism features a slight offset at the foot of the coupling halves which serve to protect the gasket from exposure

4. With the T&G style coupling no metalto-metal contact of the bolt pads is required. You will normally see a 1/16" -1/8" (1.6mm to 3.2mm) gap between the bold pads when installed.

#### Mechanical Tee Connection

The Mechanical Tee (3J, 3G, 3L) provide for a fast and easy grooved or threaded branch outlet and eliminate the need for welding or the use of a reducing tee and couplings. Simply cut a hole to the specified size at the expected location and fasten the mechanical tee to the pipe with the nuts and bolts provided. As the housing bolts are tightened, the pressure responsive gasket forms a leak-tight seal.















































#### Movement

Each flexible design coupling can provide for pipe system movement up to the design maximum for the specific size and type coupling being utilized. Movement is possible in the coupling due to two factors: (1) designed-in clearance between the key of the coupling and the groove diameter and groove width, and (2) the gap between pipe ends joined by the

#### 1.Linear Movement

Linear movement is accommodated within the coupling by allowing the pipe ends to move together or apart in response to pressure thrusts and temperature changes. The available linear movement provided by couplings is shown below:

size	1-1¼ (25-32MM)	1½-12 (40-300MM)
movement	0-4.0MM	0-6.4MM

#### 2.Angular Movement

Designed-in clearances allow limited deflection of the pipe joint within the coupling, without introducing eccentric loads into the coupling joint.

The maximum available angular movement of coupling joints is shown in the performance data for each coupling type. The amount of angular flexibility varies for each coupling size and type. For design purposes the published figures should be reduced by the below listed factors to account for pipe, groove and coupling tolerances.

size	1-3(IN)	4-12(IN)
Design factor	Reduce to 50%	Reduce to 75%

#### Flexible Couplings: **Linear Movement and Angular Movement**

			Cut		Roll Groove			
S	ize	Linear Angular Movement Movement		Linear Movement		jular ement		
Inch	mm	mm	Degree	mm/m	mm	Degree	mm/m	
1	33.7	2	2°-45'	48	1	1°-22'	24	
1 1/4	42.4	2	2°-10'	38	1	1°-05'	19	
1 1/2	48.3	3.2	1°-54'	33	1.6	0°-57'	16.5	
2	60.3	3.2	1°-31'	26	1.6	0°-45'	13	
2 1/2	73	3.2	1°-27'	25	1.6	0°-43'	12.5	
2 1/2	76.1	3.2	1°-12'	21	1.6	0°-36'	10.5	
3	88.9	3.2	1°-02'	18	1.6	0°-31'	9	
4	108	3.2	1°-51'	32	1.6	0°-55'	16	
4	114.3	3.2	1°-36'	28	1.6	0°-48'	14	
5	133	3.2	1°-41'	30	1.6	0°-50'	15	
5	139.7	3.2	1°-19'	23	1.6	0°-37'	11.5	
5	141.3	3.2	1°-03'	18	1.6	0°-30'	9	
6	159	3.2	1°-18'	23	1.6	0°-39'	11.5	
6	165.1	3.2	1°-05'	20	1.6	0°-35'	10	
6	168.3	3.2	1°-05'	19	1.6	0°-32'	9.5	
8	219.1	3.2	0°-50'	15	1.6	0°-25'	7.5	
10	273	3.2	0°-40'	12	1.6	0°-20'	6	
12	323.9	3.2	0°-34'	10	1.6	0°-18'	5	





















## Movement -Application

#### Thermal stress

Thermal stress is caused by changes in temperature, resulting in either expansion or contraction. When designing a system you must allow for this thermal movement. To determine the appropriate number of flexible couplings to allow for this thermal movement please refer to the following.



#### Example:

- 4" straight steel pipe, 30m long
- Anchored on both ends
- Minimum temperature (during installation) = 5°C
- Maximum working temperature = 55°C

From the thermal expansion table, we know the overall pipeline length will increase by 18mm (0.71"). You can also use Formula 1 or Table 3 to find the amount of thermal expansion. We want to know the number of couplings that are required to address this thermal movement problem.

The allowed movement of a 4" flexible coupling is :

Movement range x Adjustment = Allowed movement

4.3mm x 75% = 3.2mm

The appropriate number of coupling is:

Thermal expansion / Allowed movement = Number of couplings

18mm / 3.2mm = 5.6

Conclusion:

The appropriate number of coupling is 6.

#### Thermal Expansion

			Pipe ler	ngth (m)			
Temperature difference (°C)	1	5	10	20	30	40	Thermal Expansion Formula
			hermal Exp	ansion(mr			-
1	0.012	0.06	0.12	0.24	0.36	0.48	$\lambda = \alpha \times L \times T$
5	0.06	0.3	0.6	1.2	1.8	2.4	λ : Thermal Expansion
10	0.12	0.6	1.2	2.4	3.6	4.8	A : Memar Expansion
20	0.24	1.2	2.4	4.8	7.2	9.6	α : Linear Expansion
30	0.36	1.8	3.6	7.2	11	15	
40	0.48	2.4	4.8	9.6	14	20	coefficient for steel
50	0.6	3	6	12	18	24	L: Pipe length
60	0.72	3.6	7.2	14	22	29	
70	0.84	4.2	8.4	17	25	34	T: Temperature difference
80	0.96	4.8	9.6	19	29	39	

















#### Riser Design

Risers assembled with Flexible couplings are generally installed in either of two ways. In the most common method, the pipe ends are butted together within the coupling joint. Note that when installing risers, the gasket is first placed onto the lower pipe and rolled back away from the pipe end prior to positioning the upper pipe. Anchoring of the riser may be done prior to pressur-ization with the pipe ends butted or while pressurized, when, due to pressure thrust, the pipe ends will be fully separated.

An alternative method or riser installation is to place a metal spacer of a predetermined thickness, between the pipe ends when an additional length of pipe is added to the riser stack. The upper pipe length is anchored, the spacer removed and the coupling is then installed. This method creates a predetermined gap at each pipe joint which can be utilized in pipe systems where thermal move-ment is anticipated and in systems with rigid (threaded, welded, flanged) branch connections where shear forces due to pressure thrust could damage the rigid connections.

The following examples illustrate methods of installing commonly encountered riser designs.

#### Risers without Branch Connections

Install the riser with the pipe ends butted.

Locate an anchor at the base of the riser (A) to support the total weight of the pipe, couplings and fluid. Provide pipe guides on every other pipe length, as a minimum, to pre-vent possible deflection of the pipe line at the coupling joints as the riser expands due to pressure thrust or thermal growth. Note that no intermediate anchors are required.

When the system is pressurized the pipe stack will "grow" due to pres-sure thrust which causes maximum separation of pipe ends within the couplings. The maximum amount of stack growth can be predeter-mined (see Linear Movement). In this example the pipe length "L" at the top of the riser must be long enough to permit sufficient deflec-tion (see Angular Movement) to accommodate the total movement "M" from both pressure thrust and thermal gradients.

#### Risers with Branch Connections

Install the riser with the predetermined gap method. Anchor the pipe at or near the base with a pressure thrust anchor "A" capable of supporting the full pressure thrust, weight of pipe and the fluid column. Anchor at "B" with an anchor capable of withstanding full pressure thrust at the top of the riser plus weight of pipe column. Place intermediate anchors "C" as shown, between anchors "A" and "B". Also place intermediate clamps at every other pipe length as a minimum.

When this system is pressurized, the pipe movement due to pressure thrust will be strained and there will be no shear forces acting at the branch connections









#### Misalignment & Deflections

The angular movement capability of the flexible coupling permits the assembly of pipe joints where the piping is not properly aligned . At least two couplings are required to provide for lateral pipe misalignment . Deflection (longitudinal misalignment) may be accommodated within a single coupling as long as the angle of deflection does not exceed the value shown in the coupling performance data for the particular size and coupling type

A pipe joint that utilizes the angular deflection capability of the coupling will react to pressure and thermal forces dependent upon the manner in which it is restrained . An unrestrained joint will react to these forces by straightening, thus reducing, if not eliminating, the deflection at the joint . If joint deflection has been designed into the pipe layout and must be maintained, then sufficient anchors must be provided to resist the lateral forces and hold the joint in the

The amount of deflection from pipe run centerline can be calculated utilizing the following equations:

M=L Sinθ

θ=Sin-1 (G+D)

M= (G÷D) ×L

M = Misalignment (inches)

G = Maximum Allowable Pipe End Movement (Inches) as shown under "Performance Data" (Value to be reduced by Design Factor)

 $\theta$  = Maximum Deflection (Degrees) from centerline as shown under "Performance Data" (Value to be reduced by Design Factor)

D = Pipe Outside Diameter (Inches)

L = Pipe Length (Inches)

#### Curve Layout

Utilizing the angular deflection at each coupling joint curves may be laid out using straight pipe lengths and Couplings.

This example shows how to calculate the curve radius, required pipe lengths, and number of required couplings.

 $R = L / (2 \times Sin(\theta/2))$ 

 $L = 2 \times R \times Sin(\theta/2)$ 

 $N = T / \theta$ 

WHERE:

N = Number of Couplings

R = Radius of Curve (feet)

L = Pipe Length (feet)

 $\theta$ = Deflection from centerline (Degrees) of each Coupling

(See coupling performance data, value to be reduced by Design Factor)

T = Total Angular Deflection of all Couplings.





















































#### Anchoring and Supports

When designing the hangers, supports and anchors for a grooved end pipe system, the piping designer must consider certain unique characteristics of the grooved type coupling in additional to many universal pipe hanger and support design factors. As with any pipe system, the hanger or support system must provide for

1)the weight of the pipe, couplings, fluid and pipe system components;

2)reduce stresses at pipe joints; and


3)permit required pipe system movement to relieve stress.

The following chart shows the maximum span between pipe hangers, supports and anchors.

#### Max. Span between Supports (steel pipe)

Nominal Size (mm)		15	20	25	32	40	50	70	80	100	125	150	200	250	300
Max. Span Between	Insulating Pipe	2	2.5	2.5	2.5	3	3	4	4	4.5	6	7	7	8	8.5
Supports (m)	Non-insulating Pipe	2.5	3	3.5	4	4.5	5	6	6	6.5	7	8	9.5	11	12

Movement capability of couplings-expansion and contraction joints



Nominal Size	Pipe O.D. (mm)	Maximum Allowable Movement (mm)	L min. (mm)	L max. (mm)	Number of Couplings	Filled With Water Pressure
1	33.7	45	617	662	10	300
11/4	42.4	45	617	662	10	300
1½	48.3	45	617	662	10	300
2	60.3	45	617	662	10	300
2½	73.0	45	617	662	10	300
76.1	76.1	45	617	662	10	300
3	88.9	45	617	662	10	300
4	114.3	47	503	550	7	300
139.7	139.7	47	503	550	7	300
5	141.3	47	503	550	7	300
165.1	165.1	52	503	550	7	300
6	168.3	52	591	643	7	300
8	219.1	52	591	643	7	300
10	273.0	52	591	643	7	300
12	323.9	52	591	643	7	300

## **Engineering Test**

No.	Item	Standard Requirements
1	Vacuum Test	Grooved couplings, grooved reducing couplings, grooved split flanges, mechanical tees, and plain end couplings shall be able to withstand the effects of vacuum conditions encountered when sprinkler systems are drained. Samples of each nominal size and style of gasketed coupling and fitting shall be subjected to an internal vacuum of 25 inHg (85 kPa) for a duration of 5 minutes. Following the vacuum test, the test assembly shall be pneumatically pressurized from zero to 50 psi (345 kPa) while submerged in a water bath. There shall be no leakage or permanent deformation as a result of this test.
2	Hydrostatic Strength Test	All items shall be able to withstand an internal hydrostatic pressure equal to three-five times the rated working pressure without cracking, rupture, or permanent distortion. The test shall be conducted for a duration of 1 minute. (Test Size $6^{\prime\prime\prime}$ , Five time; $8^{\prime\prime\prime}$ - $10^{\prime\prime\prime}$ , 4time; $12^{\prime\prime\prime}$ , 3times)
3	Air Leakage Test	The coupling assembly shall be pressurised with air to 3 bar +0.5/-0 bar. The assembly shall be immersed in water to establish that there is no visible leakage
4	Moment Test	The moment resistance shall be demonstrated while the test assembly is internally pressurized to the rated working pressure. Then a force was applied to the test assembly. There shall be no leakage, cracking, or fitting or coupling pull-off as a result of this test.
5	Hot Gasket Test	Standard gaskets shall be assembled to short lengths of pipe, and subjected to 275° F (135° C) for a duration of 45 days. After exposure, the test assembly shall be submerged in a water bath and subjected to an air under water leakage test from zero to 50 psi (0 to 345 kPa) in order to evaluate for leakage. After the air under water testing is completed, the test assembly shall be disassembled and the gasket shall not crack when squeezed together from any two diametrically opposite points, or twisted into a figure-eight shape. The gasket shall then be visually inspected for signs of cracking, tearing, or excessive degradation as a result of this test.
6	Cold Gasket Test	The low temperature exposure shall consist of $40^\circ$ F ( $40^\circ$ C) air exposure for 4 days. After exposure, the assembly while submerged in $40^\circ$ F ( $40^\circ$ C) antifreeze, shall be pneumatically pressurized from 0 to 50 psi (0 - 345 kPa). No leakage shall occur. The assembly shall then be allowed to warm to ambient temperature and then be disassembled. The gasket, after removal from the assembly, shall not crack when squeezed together from any two diametrically opposite points, or twisted into a figure eight shape.
7	Flame test	The test shall be conducted in a room free from air draught., The test joint is mounted, U-bent on the test apparatus and filled with water. The angle corresponds to the angle documented as a result of the test Subsequently the test joint is drained. The fuel pan is placed centrally below the pipe joint Fuel is filled into the pan and the fuel is ginited. Burning time 5 min for nominal diameters C bN 100; 8 min for nominal diameters DN 100 For reducer couplings the dimension of the smaller nominal diameter shall apply for the determination of the burning time. The flame shall be extinguished immediately once the burning time has expired (5 min or 8 min) and the test joint shall be cooled down. For cooling the lest joint is immediately sprayed with water until steam formation is no longer visible, but at least for 3 min. The test joint is then filled completely with water and exposed to a test pressure which corresponds to the maximum permissible pressure and is checked visibly for leaks. Water may leak in form of drops, however, not in form of flowing water or a water spray. The test joint is then pressure relieved (force and internal pressure).
8	Cycling Pressure Resistance (Water Hammer Test)	Prior to the cycling, assemblies shall be subjected to a hydrostatic strength test to the rated working pressure, 175 psi (1205 kPa) minimum, for a duration of 5 minutes. Without leakage or cracking. Assemblies shall then be subjected to 20,000 cycles from zero pressure to the rated working pressure, 175 psi (1205 kPa) minimum. After cycling, the test assembly shall be tested Hydrostatic Strength and maintain 5minutes without leakage and cracking.











































## **Engineering Test**

No.	Item	Standard Requirements
9	Friction Loss Determination	The construction and installation of the coupling or fitting shall be such that obstruction to the passage of water through the coupling or fitting body is minimal. The loss in pressure through the coupling or fitting shall not exceed 5.0 psi (35 kPa) at a flow producing a velocity of 20 ft/s (6.1 m/s) in Schedule 40 steel pipe of the same nominal diameter as the coupling or fitting.
10	Leakage Test - Assembly without Gasket	Leakage from a gasket-less coupling assembly or fitting shall not exceed that of an operating sprinkler head whose discharge coefficient (K-factor) is 5.3 to 5.8 gal/min(ps)) 1/2 [76 - 84 L/min/(bar)1/2]. This test is for nominal pipe sizes normally associated with over-head piping, less than or equal to 12 in. NPS (300 mm).
11	Torsion test	This test relates to pipe joints DN 40 only. The test joint is filled with water and exposed once to the maximum permissible pressure and is then pressure relieved again. Subsequently the test joint is fixed on one pipe end and an increasing torque is applied to the other pipe end. At the pressure-less test joint the pipe joint shall be able to transmit a torque of up to 80 Nm from one pipe end to the other pipe end without any torsion of the pipe ends against each other.
12	Flexibility Test for Flexible Fittings	With the assembly pressurized to its rated pressure, a bending moment is to be applied to deflect the joint to the maximum angle specified by the manufacturer, while not less than 1 degree for nominal pipe diameters less than 8 inches (203.2 mm) or 0.5 degrees for 8 inches (203.2 mm) and larger. Observations are to be made for leakage or pipe damage.
13	Seismic Evaluation	In order to evaluate the use of grooved couplings in Earthquake zones 50 through 500 years, test assemblies utilizing flexible couplings and short lengths of steel pipe, in the same nominal size, will be subjected to cyclic testing. The test will deflect the assembly to the manufacturer's maximum recommended angle in the forward and reverse direction for a total 15 cycles with the internal pressure equal to the rated working pressure. There shall be no leakage, cracking, or rupture as a result of this test.
14	Lateral Displacement	The coupling shall not leak during any of the tests, within the manufacturer's stated limitations for angular deflection or lateral displacement of associated pipework.
15	Hydrostatic fluctuation pressure test	The coupling assembly shall be pressurised with water to a gauge pressure of 10 bar $\pm 1$ bar for 2min, +30s-0s to establish a datum. The assembly shall then be drained before being subjected to the greatest vacuum attainable to a maximum of 600mm afmercury or -0.8bar +0bar-0.1 bar for 2min +30s-0s, and allowed to return to atmospheric pressure in not less than 5s. The assembly shall then be pressurised with water to 10 bar $\pm 1$ bar for 2 min +30s-0s. The assembly shall be examined for leakage throughout the test. The relative movement of each pipe shall be recorded at the greatest vacuum and at each pressure. There shall be no leakage.
16	Fire Test	If a gasketed pipe coupling or fitting employs non-ferrous materials for its substantial structural components, or if in the judgment of FM Approvals, the design is otherwise suspect with respect to fire resistance, a fire test shall be conducted. A representative size assembled joint without a gastes shall be exposed to a 1000 ° F (538 ° C) fire environment for 5 minutes. The assembly shall be dry for the duration of this exposure. Immediately after the exposure, a water flow shall be introduced through the joint and sustained until the assembly is cool to the touch. No cracking or distortion of any component of the coupling or fitting shall then be disassembled and the gasket installed. After reassembly, the joint shall be hydrostatically tested, as described in to the hydrostatic test.





